

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789121

Luminaire Tested: LER6D10D010-EC6DR450210IC9040-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789121
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR450210IC9040-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2116.4 lumens
Efficiency: N/A
Efficacy: 180.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789121

CATALOG NUMBER: LER6D10D010-EC6DR450210IC9040-6LBDP1LI

Luminous Intensity Polar Plot

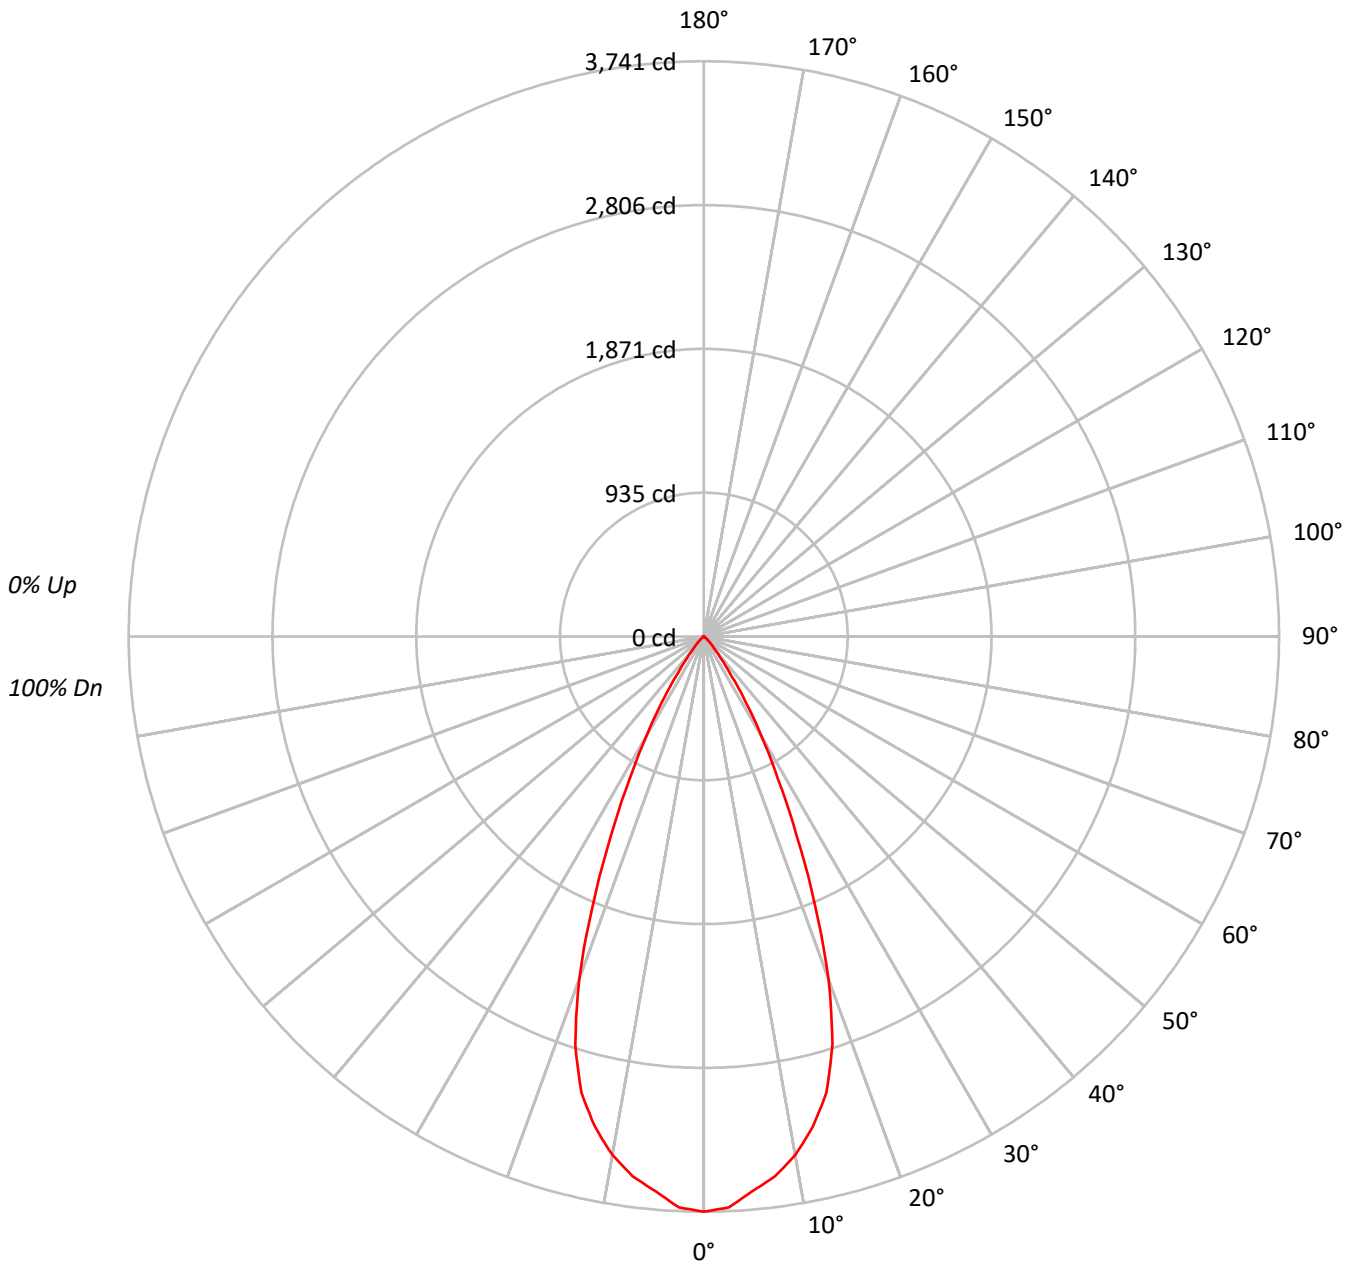



TEST NUMBER: P789121

CATALOG NUMBER: LER6D10D010-EC6DR450210IC9040-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	408712
5°	397079
10°	379891
15°	347682
20°	275834
25°	172202
30°	94913
35°	42616
40°	16788
45°	7911
50°	3757
55°	1962
60°	961
65°	233
70°	96
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 7911 cd/sqm



TEST NUMBER: P789121

CATALOG NUMBER: LER6D10D010-EC6DR450210IC9040-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	340.2	16.1
10°-20°	837.2	39.6
20°-30°	663.0	31.3
30°-40°	220.8	10.4
40°-50°	43.8	2.1
50°-60°	10.0	0.5
60°-70°	1.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1840.3	87.0
0°-40°	2061.1	97.4
0°-60°	2114.9	99.9
0°-90°	2116.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2116.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3741	
5°	3620	340
15°	3074	837
25°	1428	663
35°	320	221
45°	51	44
55°	10	10
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789121

CATALOG NUMBER: LER6D10D010-EC6DR450210IC9040-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	3740.7
2.5°	3716.3
5°	3620.4
7.5°	3541.2
10°	3424.1
12.5°	3268.2
15°	3073.7
17.5°	2781.3
20°	2372.3
22.5°	1885.1
25°	1428.4
27.5°	1046.0
30°	752.3
32.5°	511.7
35°	319.5
37.5°	189.5
40°	117.7
42.5°	77.4
45°	51.2
47.5°	33.0
50°	22.1
52.5°	14.7
55°	10.3
57.5°	6.8
60°	4.4
62.5°	2.4
65°	0.9
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)