

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789144

Luminaire Tested: LER6D10D010-EC6DR500210IC9027-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789144
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR500210IC9027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1822.5 lumens
Efficiency: N/A
Efficacy: 155.8 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789144

CATALOG NUMBER: LER6D10D010-EC6DR500210IC9027-6LBDP1H

Luminous Intensity Polar Plot

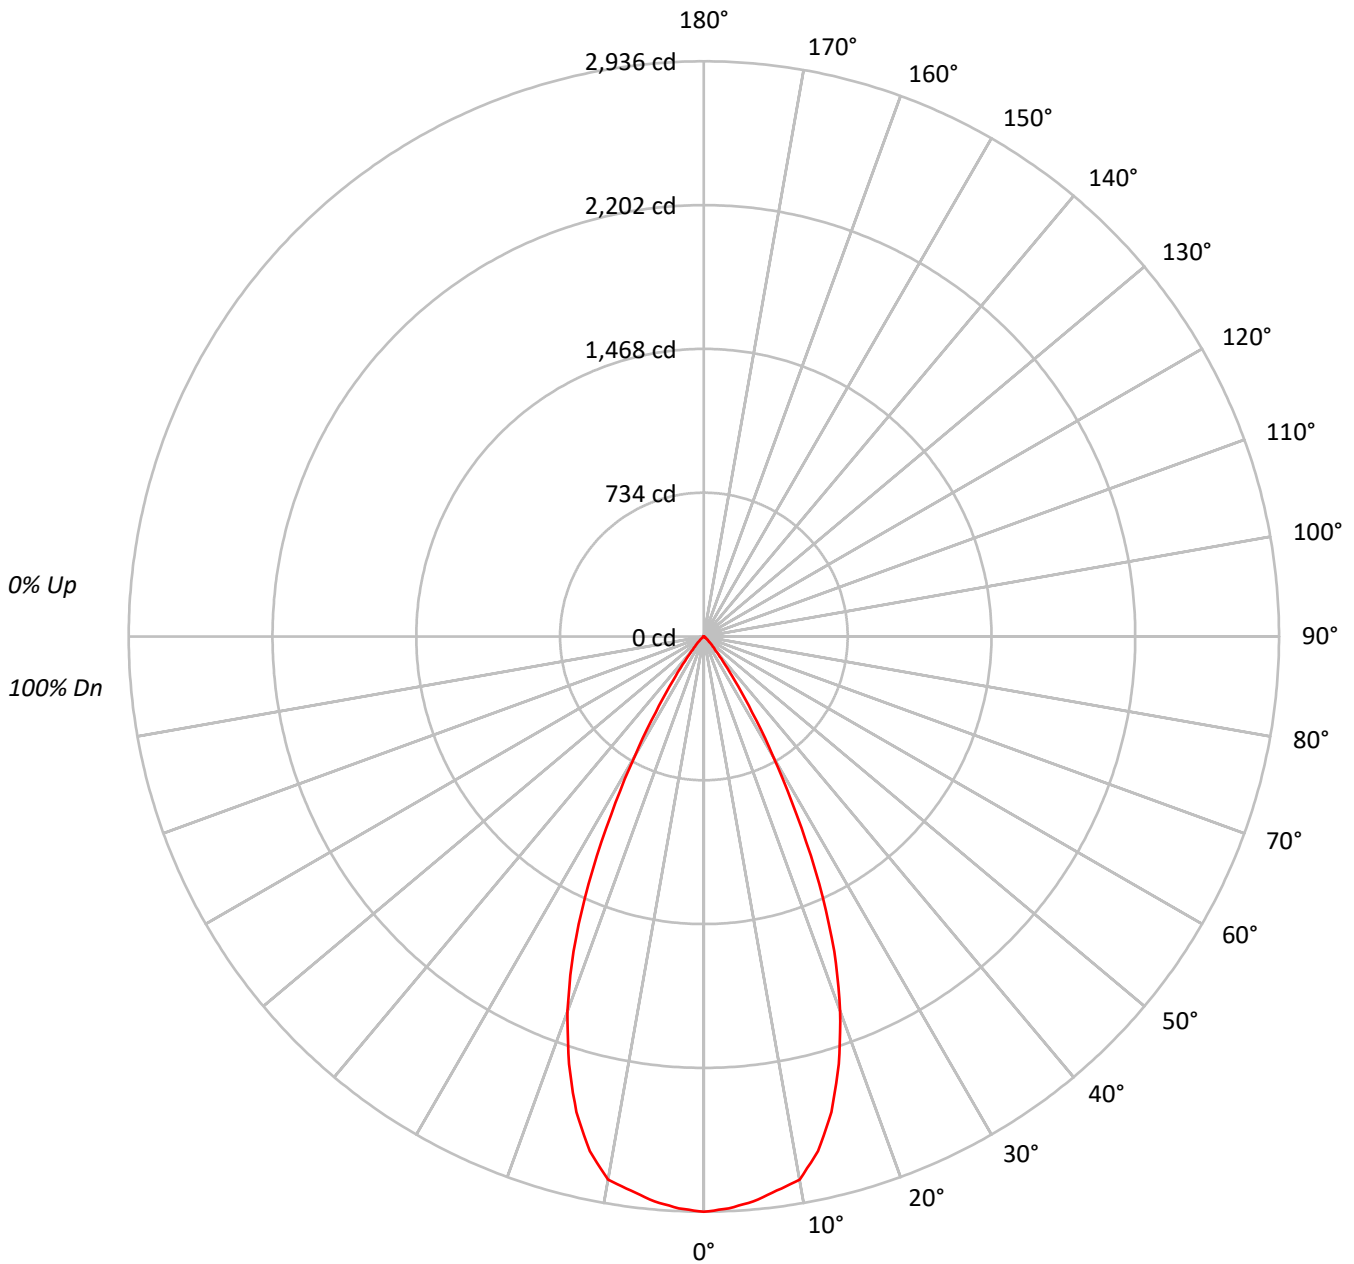



TEST NUMBER: P789144

CATALOG NUMBER: LER6D10D010-EC6DR500210IC9027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95		
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85		
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80		
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76		
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72		
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69		
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65		
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62		
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	320833
5°	317474
10°	312247
15°	284326
20°	236592
25°	167946
30°	88895
35°	36227
40°	13450
45°	6165
50°	2533
55°	1314
60°	656
65°	181
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6165 cd/sqm



TEST NUMBER: P789144

CATALOG NUMBER: LER6D10D010-EC6DR500210IC9027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.6	15.0
10°-20°	691.4	37.9
20°-30°	621.1	34.1
30°-40°	194.5	10.7
40°-50°	34.1	1.9
50°-60°	6.8	0.4
60°-70°	1.0	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1586.1	87.0
0°-40°	1780.6	97.7
0°-60°	1821.5	99.9
0°-90°	1822.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1822.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2936	
5°	2895	274
15°	2514	691
25°	1393	621
35°	272	194
45°	40	34
55°	7	7
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789144

CATALOG NUMBER: LER6D10D010-EC6DR500210IC9027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	2936.4
2.5°	2921.8
5°	2894.6
7.5°	2853.0
10°	2814.4
12.5°	2690.6
15°	2513.6
17.5°	2288.8
20°	2034.8
22.5°	1740.9
25°	1393.1
27.5°	1024.2
30°	704.6
32.5°	458.7
35°	271.6
37.5°	156.0
40°	94.3
42.5°	61.4
45°	39.9
47.5°	24.3
50°	14.9
52.5°	10.2
55°	6.9
57.5°	4.7
60°	3.0
62.5°	1.7
65°	0.7
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)