

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789240

Luminaire Tested: LER6D10D010-EC6DR600210IC9027-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P789240
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR600210IC9027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1761.8 lumens
Efficiency: N/A
Efficacy: 150.6 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.84
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789240

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9027-6LBDP1H

Luminous Intensity Polar Plot

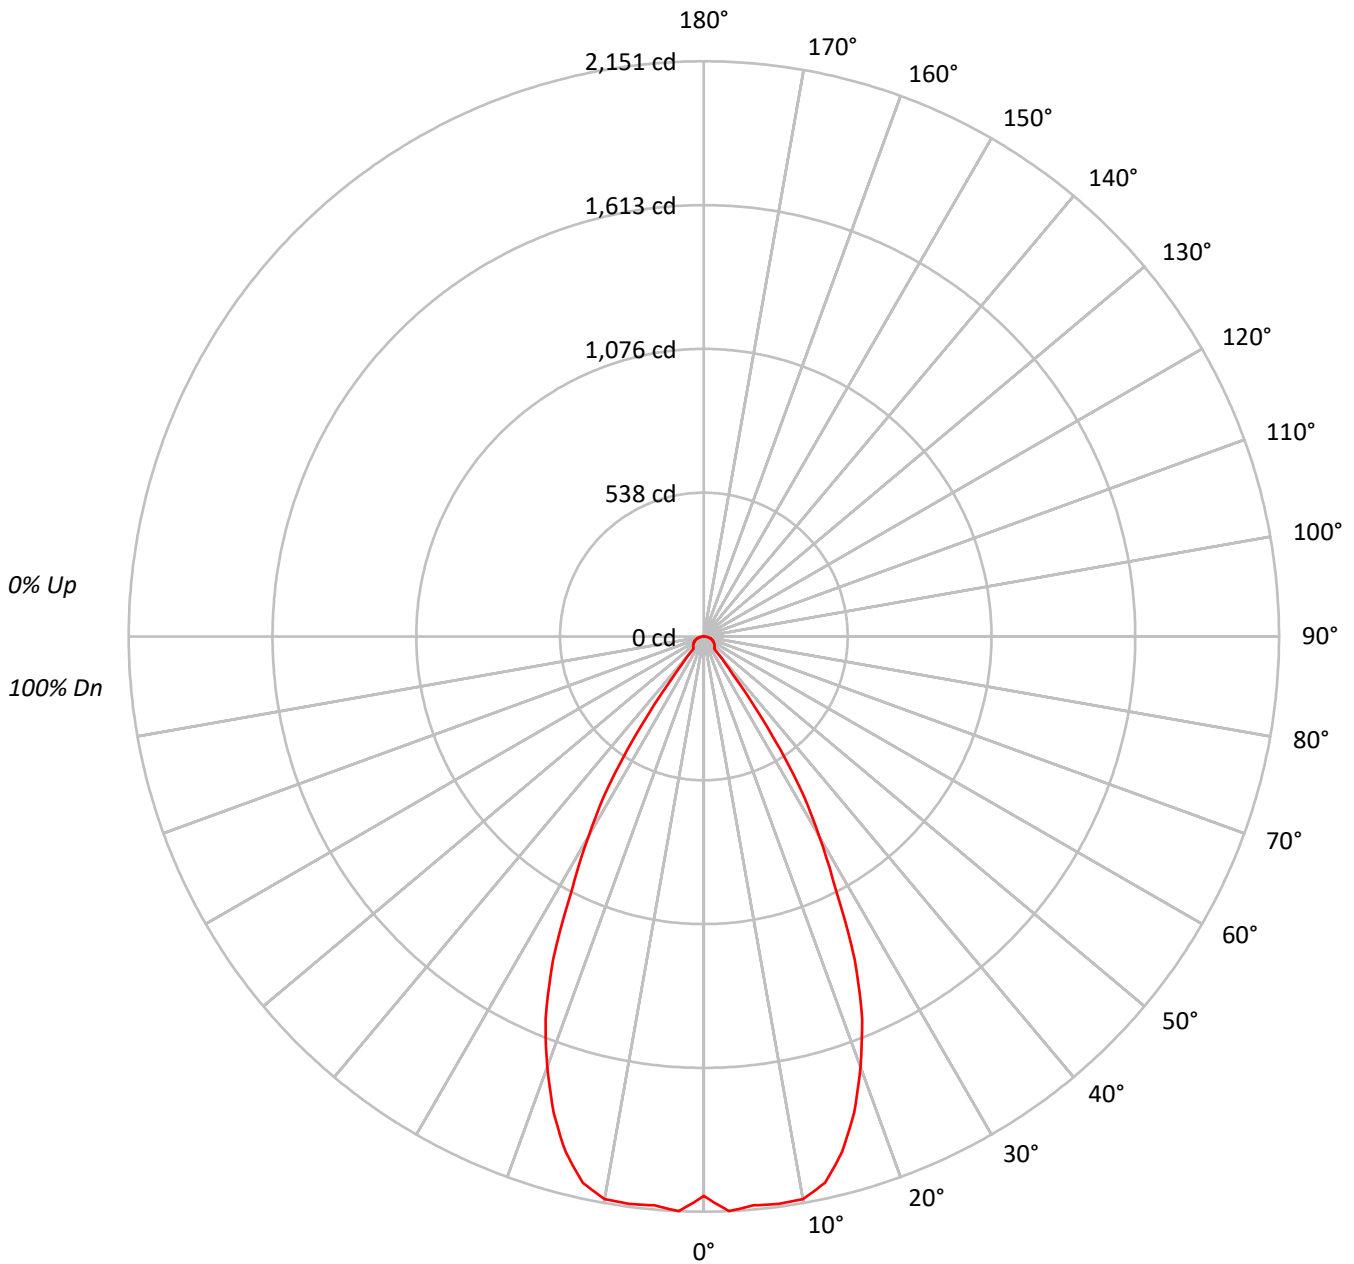



TEST NUMBER: P789240

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93																			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86																			
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80																			
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70																			
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66																			
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62																			
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59																			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55																			
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	228606
5°	234229
10°	237059
15°	225834
20°	199117
25°	161051
30°	108942
35°	54594
40°	8857
45°	8668
50°	8839
55°	8972
60°	9222
65°	9436
70°	9648
75°	9752
80°	9438
85°	7898

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 9752 cd/sqm



TEST NUMBER: P789240

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	204.1	11.6
10°-20°	552.2	31.3
20°-30°	594.2	33.7
30°-40°	258.3	14.7
40°-50°	43.4	2.5
50°-60°	42.2	2.4
60°-70°	36.1	2.0
70°-80°	24.1	1.4
80°-90°	7.2	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1350.5	76.7
0°-40°	1608.8	91.3
0°-60°	1694.4	96.2
0°-90°	1761.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1761.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2092	
5°	2136	204
15°	1996	552
25°	1336	594
35°	409	258
45°	56	43
55°	47	42
65°	36	36
75°	23	24
85°	6	7
90°	0	



TEST NUMBER: P789240

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	2092.3
2.5°	2151.2
5°	2135.6
7.5°	2140.5
10°	2136.7
12.5°	2092.6
15°	1996.5
17.5°	1867.4
20°	1712.5
22.5°	1546.7
25°	1335.9
27.5°	1068.5
30°	863.5
32.5°	665.5
35°	409.3
37.5°	175.1
40°	62.1
42.5°	57.2
45°	56.1
47.5°	54.2
50°	52.0
52.5°	49.6
55°	47.1
57.5°	44.7
60°	42.2
62.5°	39.5
65°	36.5
67.5°	33.5
70°	30.2
72.5°	26.7
75°	23.1
77.5°	19.1
80°	15.0
82.5°	10.6
85°	6.3
87.5°	2.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)