

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789250

Luminaire Tested: LER6D10D010-EC6DR600210IC9030-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P789250
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR600210IC9030-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1647.5 lumens
Efficiency: N/A
Efficacy: 140.8 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789250

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9030-6LBDP1MW

Luminous Intensity Polar Plot

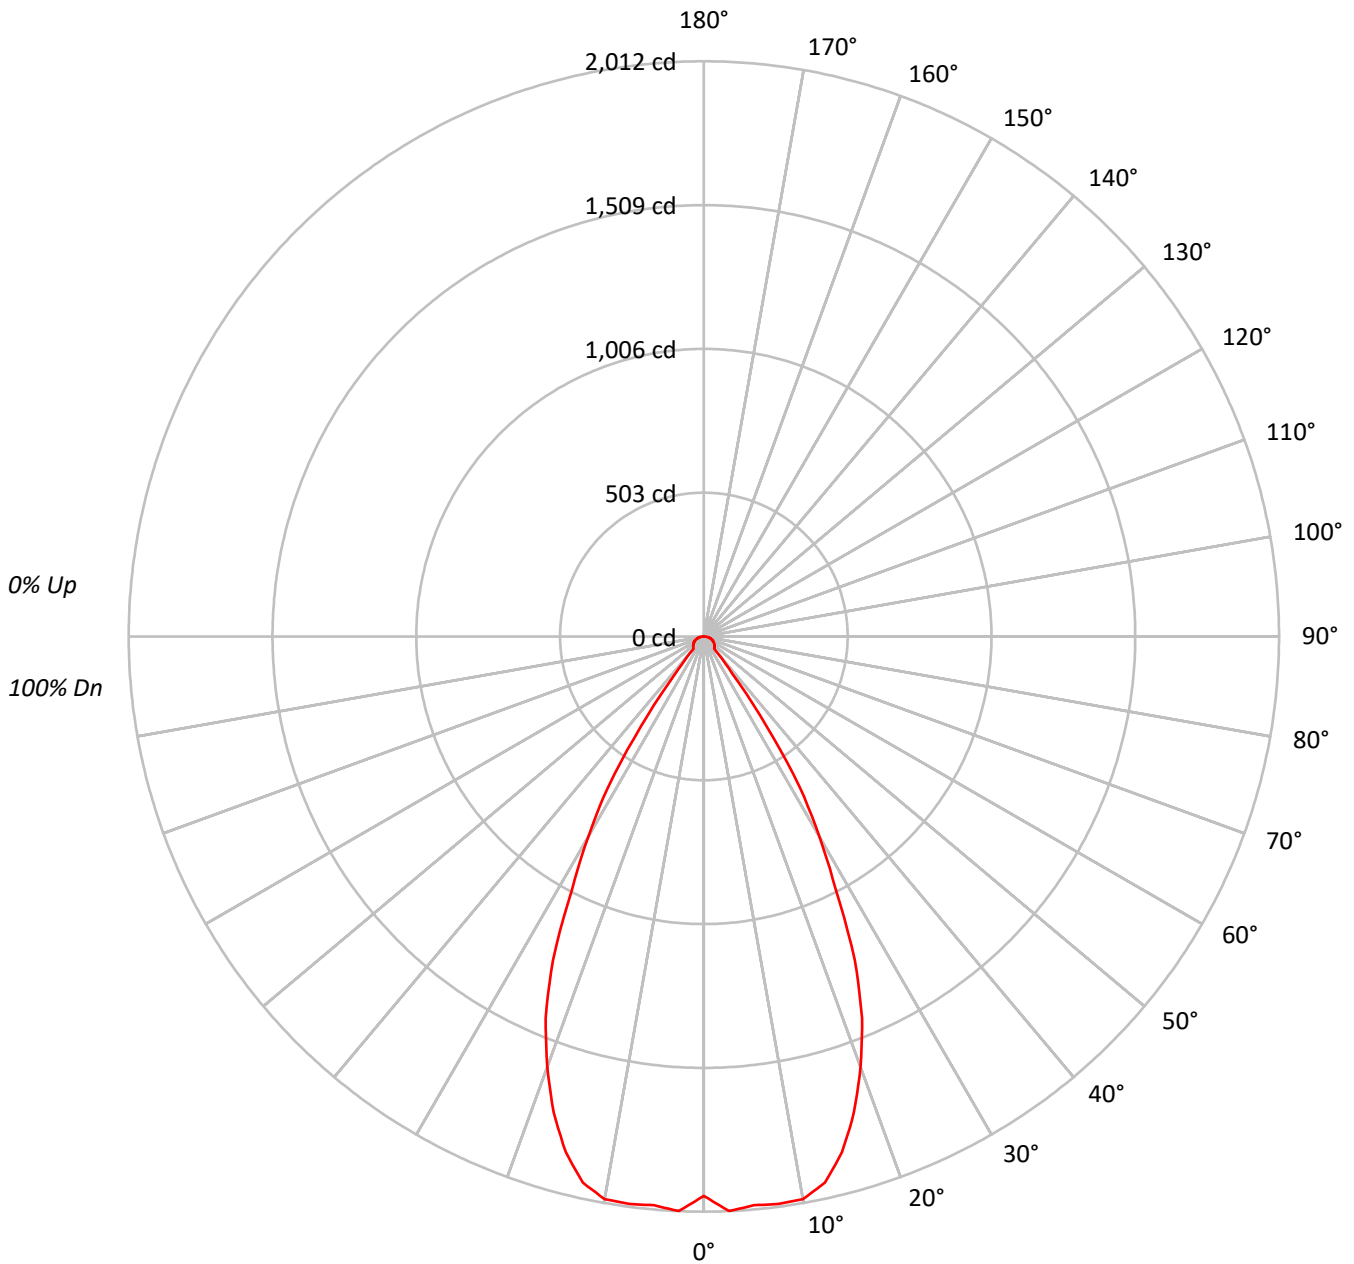



TEST NUMBER: P789250

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93																			
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86																			
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80																			
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70																			
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66																			
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62																			
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59																			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55																			
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	213769
5°	219027
10°	221671
15°	211174
20°	186188
25°	150598
30°	101864
35°	51046
40°	8287
45°	8112
50°	8261
55°	8401
60°	8632
65°	8816
70°	9041
75°	9118
80°	8809
85°	7396

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 9118 cd/sqm



TEST NUMBER: P789250

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	190.9	11.6
10°-20°	516.4	31.3
20°-30°	555.6	33.7
30°-40°	241.5	14.7
40°-50°	40.6	2.5
50°-60°	39.5	2.4
60°-70°	33.7	2.0
70°-80°	22.6	1.4
80°-90°	6.7	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1262.9	76.7
0°-40°	1504.4	91.3
0°-60°	1584.4	96.2
0°-90°	1647.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1647.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1956	
5°	1997	191
15°	1867	516
25°	1249	556
35°	383	242
45°	52	41
55°	44	39
65°	34	34
75°	22	23
85°	6	7
90°	0	



TEST NUMBER: P789250

CATALOG NUMBER: LER6D10D010-EC6DR600210IC9030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1956.5
2.5°	2011.5
5°	1997.0
7.5°	2001.6
10°	1998.0
12.5°	1956.8
15°	1866.9
17.5°	1746.2
20°	1601.3
22.5°	1446.3
25°	1249.2
27.5°	999.2
30°	807.4
32.5°	622.3
35°	382.7
37.5°	163.7
40°	58.1
42.5°	53.5
45°	52.5
47.5°	50.7
50°	48.6
52.5°	46.3
55°	44.1
57.5°	41.8
60°	39.5
62.5°	36.9
65°	34.1
67.5°	31.3
70°	28.3
72.5°	25.0
75°	21.6
77.5°	17.8
80°	14.0
82.5°	9.9
85°	5.9
87.5°	2.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)