

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789286

Luminaire Tested: LER6D10D010-EC6DR650210IC9024-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789286
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D10D010-EC6DR650210IC9024-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1387.1 lumens
Efficiency: N/A
Efficacy: 118.6 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P789286
CATALOG NUMBER: LER6D10D010-EC6DR650210IC9024-6LBS1MW

Luminous Intensity Polar Plot

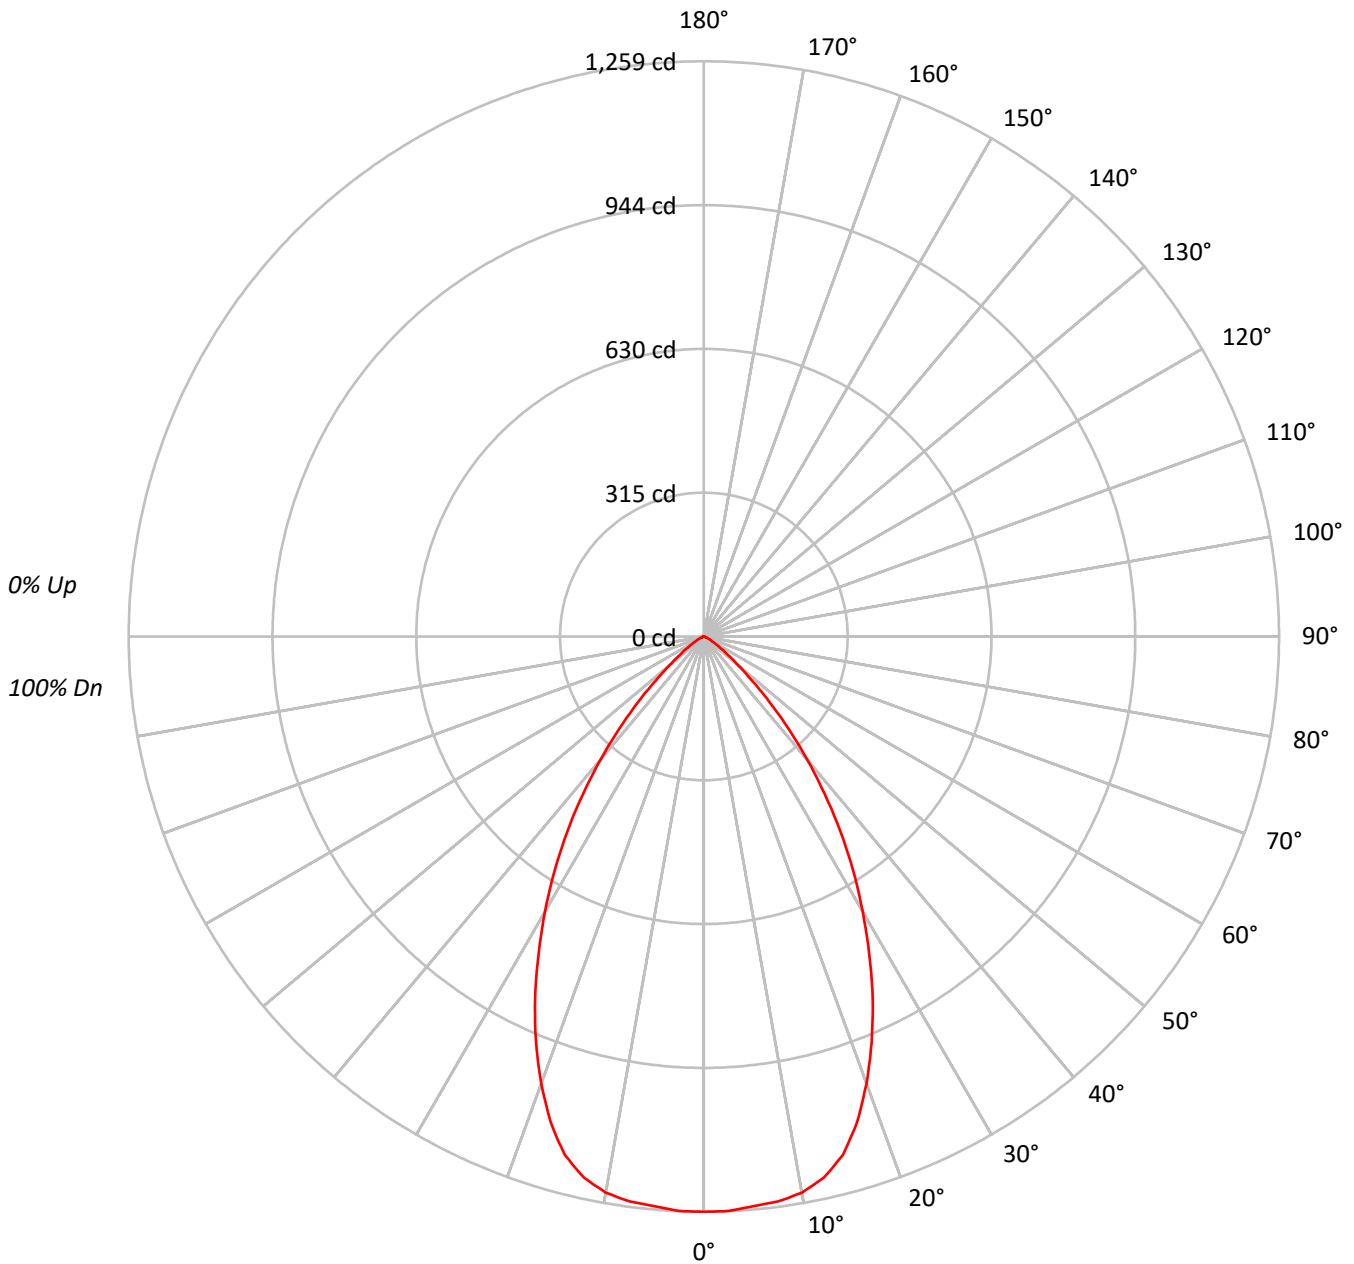



TEST NUMBER: P789286

CATALOG NUMBER: LER6D10D010-EC6DR650210IC9024-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93																
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85																
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78																
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72																
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66																
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61																
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56																
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52																
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49																
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	73554
5°	73372
10°	73307
15°	71045
20°	64682
25°	56367
30°	46877
35°	37146
40°	26806
45°	16940
50°	8832
55°	4694
60°	2465
65°	1354
70°	564
75°	632
80°	437
85°	402

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16940 cd/sqm



TEST NUMBER: P789286

CATALOG NUMBER: LER6D10D010-EC6DR650210IC9024-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.1	8.6
10°-20°	326.1	23.5
20°-30°	398.7	28.7
30°-40°	323.5	23.3
40°-50°	161.2	11.6
50°-60°	45.0	3.2
60°-70°	10.2	0.7
70°-80°	2.7	0.2
80°-90°	0.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	843.9	60.8
0°-40°	1167.4	84.2
0°-60°	1373.6	99.0
0°-90°	1387.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1387.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1259	
5°	1252	119
15°	1175	326
25°	875	399
35°	521	323
45°	205	161
55°	46	45
65°	10	10
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P789286

CATALOG NUMBER: LER6D10D010-EC6DR650210IC9024-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	1259.4
2.5°	1258.5
5°	1251.5
7.5°	1247.4
10°	1236.1
12.5°	1213.2
15°	1175.0
17.5°	1115.4
20°	1040.7
22.5°	960.0
25°	874.7
27.5°	783.4
30°	695.1
32.5°	608.0
35°	521.0
37.5°	434.2
40°	351.6
42.5°	274.3
45°	205.1
47.5°	142.9
50°	97.2
52.5°	67.0
55°	46.1
57.5°	31.1
60°	21.1
62.5°	14.6
65°	9.8
67.5°	5.0
70°	3.3
72.5°	3.1
75°	2.8
77.5°	1.9
80°	1.3
82.5°	0.9
85°	0.6
87.5°	0.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)