

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789478

Luminaire Tested: LER6D15D010-EC6DR2015309027-6LBDP1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789478  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR2015309027-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1433.2 lumens  
Efficiency: N/A  
Efficacy: 90.7 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P789478  
CATALOG NUMBER: LER6D15D010-EC6DR2015309027-6LBDP1H

### Luminous Intensity Polar Plot

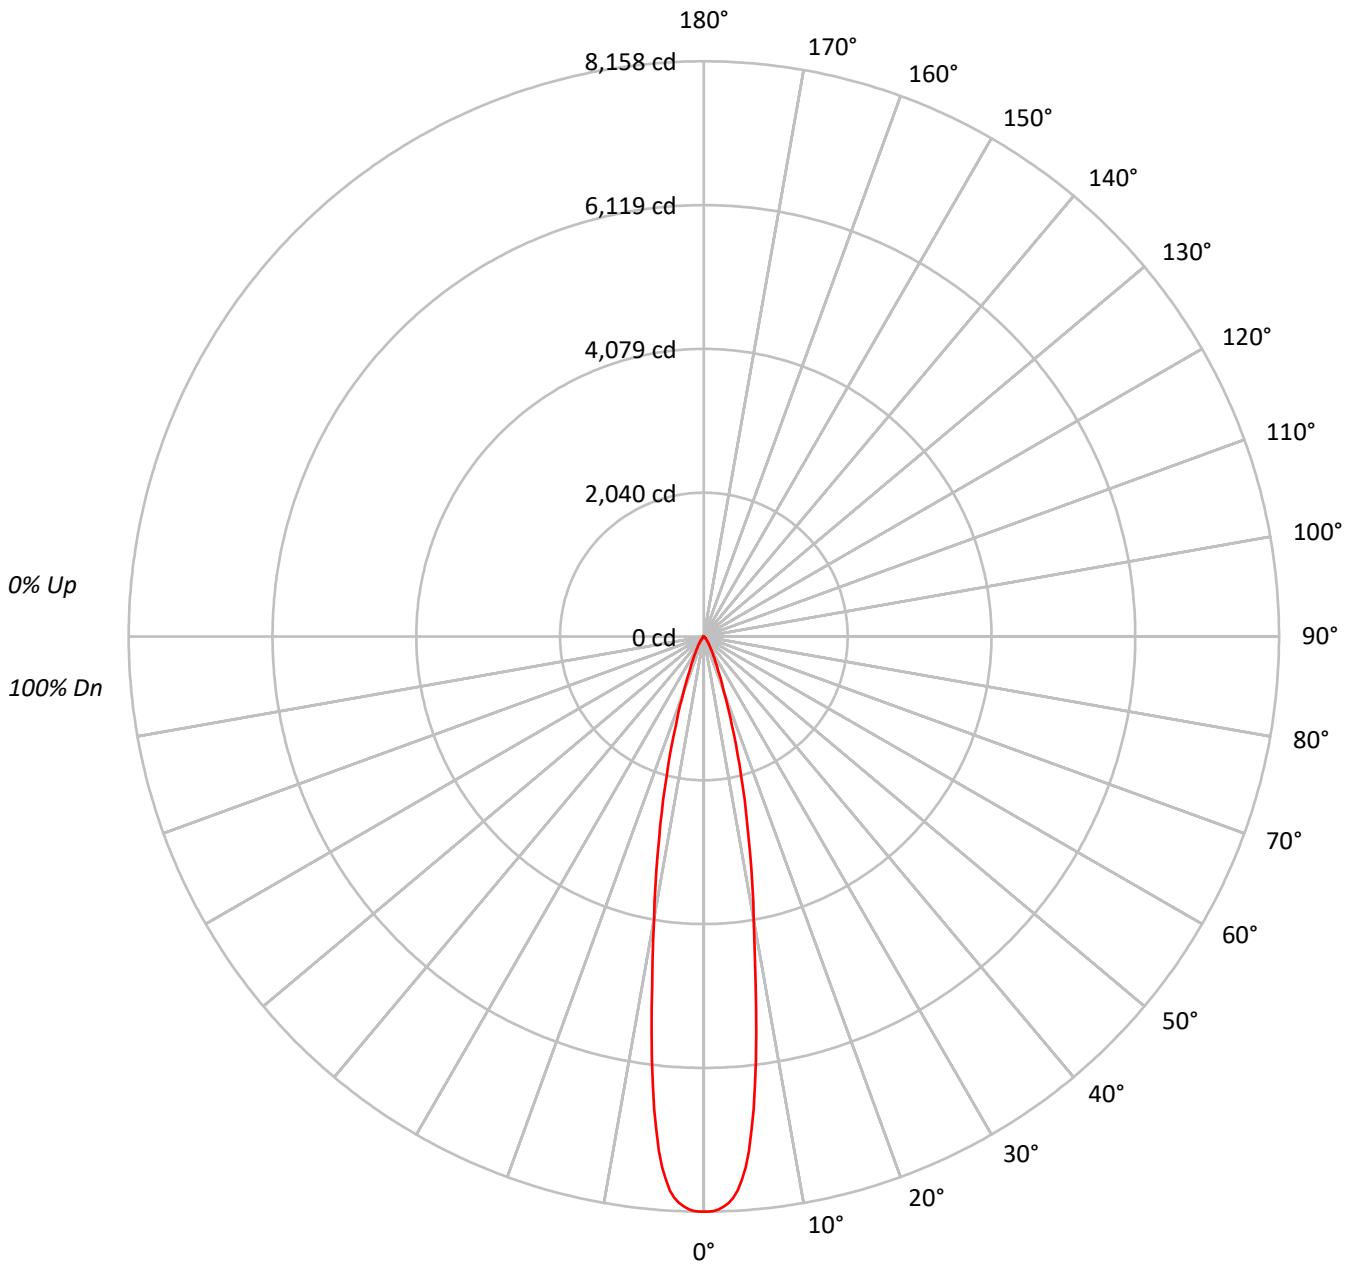



TEST NUMBER: P789478

CATALOG NUMBER: LER6D15D010-EC6DR2015309027-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97	94															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	91	88	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76	75															

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	891316
5°	804138
10°	451329
15°	229420
20°	97134
25°	44835
30°	23731
35°	12791
40°	6832
45°	4048
50°	2346
55°	1238
60°	787
65°	569
70°	224
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4048 cd/sqm



TEST NUMBER: P789478

CATALOG NUMBER: LER6D15D010-EC6DR2015309027-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	580.8	40.5
10°-20°	571.9	39.9
20°-30°	186.8	13.0
30°-40°	63.6	4.4
40°-50°	21.4	1.5
50°-60°	6.4	0.4
60°-70°	2.2	0.2
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1339.6	93.5
0°-40°	1403.2	97.9
0°-60°	1431.0	99.8
0°-90°	1433.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1433.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	8158	
5°	7332	581
15°	2028	572
25°	372	187
35°	96	64
45°	26	21
55°	6	6
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789478

CATALOG NUMBER: LER6D15D010-EC6DR2015309027-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	8157.7
0.5°	8157.7
1°	8147.6
1.5°	8127.2
2°	8090.2
2.5°	8040.8
3°	7971.0
3.5°	7873.7
4°	7729.1
4.5°	7553.4
5°	7331.8
5.5°	7040.5
6°	6741.9
6.5°	6399.8
7°	6064.9
7.5°	5672.6
8°	5322.5
8.5°	4970.2
9°	4644.8
9.5°	4346.2
10°	4068.0
12.5°	2920.9
15°	2028.2
17.5°	1325.0
20°	835.4
22.5°	541.2
25°	371.9
27.5°	261.5
30°	188.1
32.5°	135.1
35°	95.9
37.5°	66.8
40°	47.9
42.5°	34.9
45°	26.2
47.5°	20.3
50°	13.8
52.5°	8.7
55°	6.5
57.5°	5.1
60°	3.6
62.5°	2.9
65°	2.2



TEST NUMBER: P789478

CATALOG NUMBER: LER6D15D010-EC6DR2015309027-6LBDP1H

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





67.5°		1.5
70°		0.7

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)