

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789495

Luminaire Tested: LER6D15D010-EC6DR2015309035-6LBDP1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789495  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR2015309035-6LBDDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1640.4 lumens  
Efficiency: N/A  
Efficacy: 103.8 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P789495  
CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBDP1LI

### Luminous Intensity Polar Plot

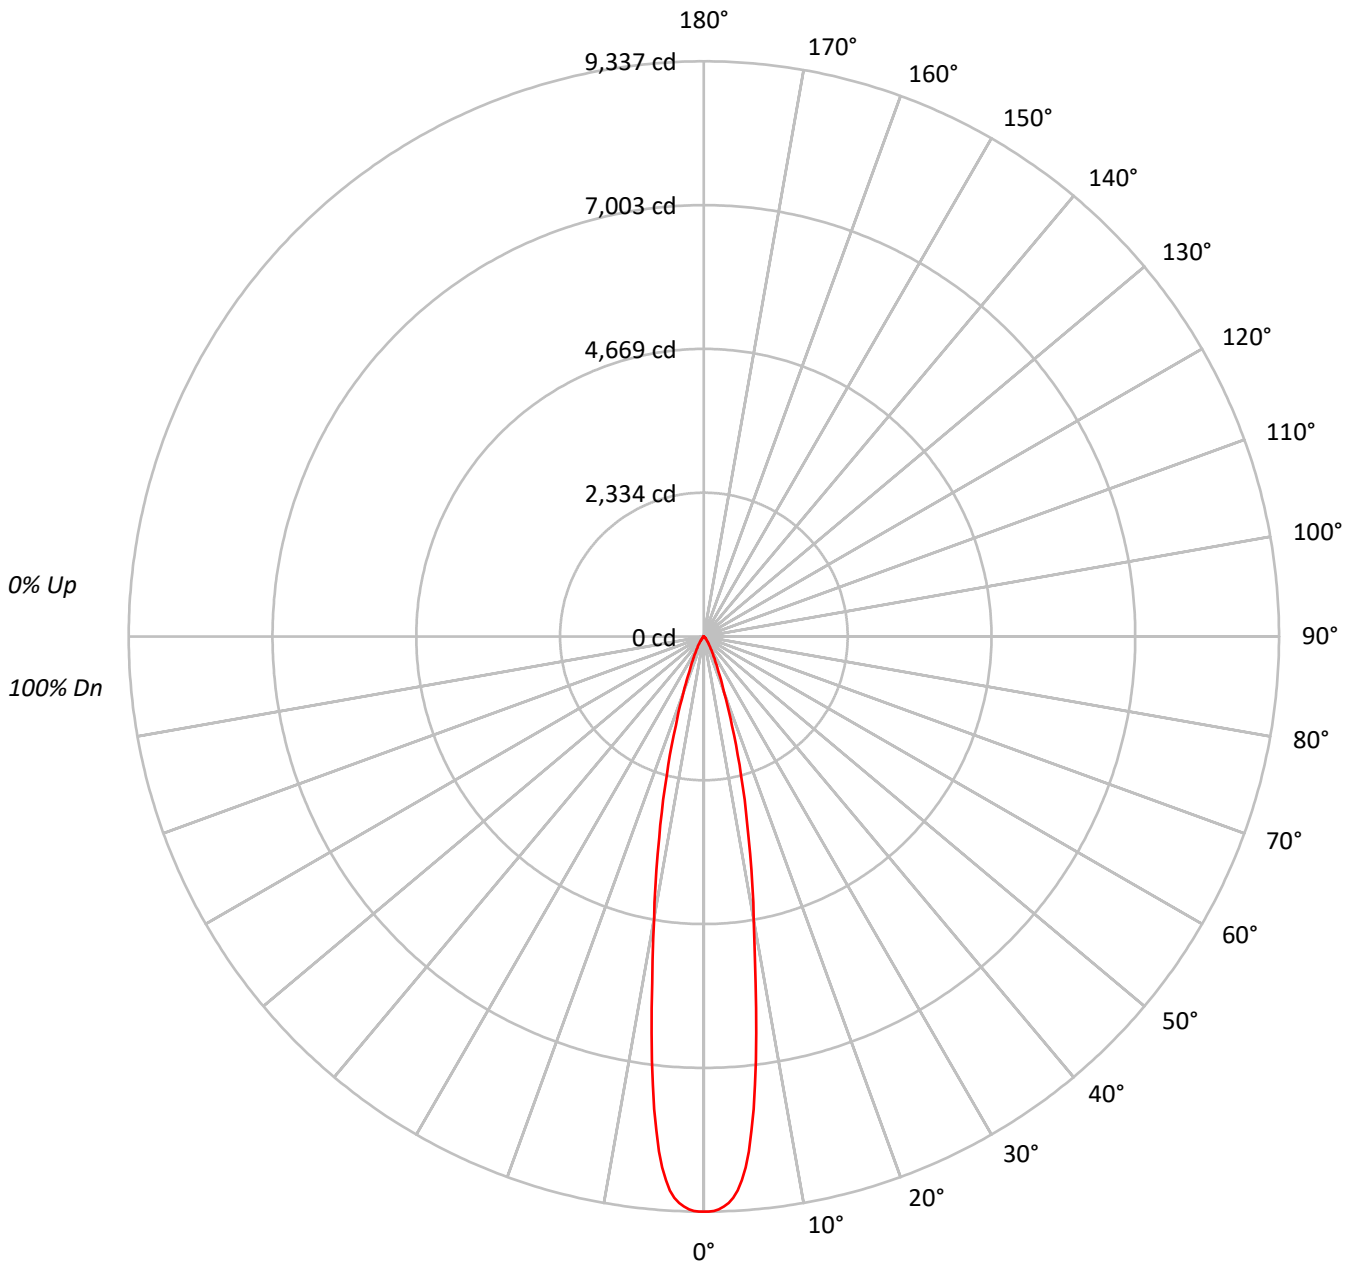



TEST NUMBER: P789495  
 CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	95	93	92															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	91	89															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	88	86															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	86	84															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	84	82															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	82	80															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	80	78															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	78	76															

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1020157
5°	920375
10°	516566
15°	262574
20°	111168
25°	51321
30°	27163
35°	14632
40°	7830
45°	4620
50°	2686
55°	1429
60°	918
65°	646
70°	256
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4620 cd/sqm



TEST NUMBER: P789495

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBDP1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	664.8	40.5
10°-20°	654.6	39.9
20°-30°	213.8	13.0
30°-40°	72.8	4.4
40°-50°	24.5	1.5
50°-60°	7.4	0.4
60°-70°	2.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1533.2	93.5
0°-40°	1606.0	97.9
0°-60°	1637.9	99.8
0°-90°	1640.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1640.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9337	
5°	8392	665
15°	2321	655
25°	426	214
35°	110	73
45°	30	24
55°	8	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789495

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9336.9
0.5°	9336.9
1°	9325.3
1.5°	9302.0
2°	9259.6
2.5°	9203.1
3°	9123.3
3.5°	9011.8
4°	8846.4
4.5°	8645.2
5°	8391.6
5.5°	8058.2
6°	7716.5
6.5°	7324.9
7°	6941.6
7.5°	6492.6
8°	6091.9
8.5°	5688.6
9°	5316.1
9.5°	4974.4
10°	4656.0
12.5°	3343.2
15°	2321.3
17.5°	1516.5
20°	956.1
22.5°	619.4
25°	425.7
27.5°	299.3
30°	215.3
32.5°	154.6
35°	109.7
37.5°	76.5
40°	54.9
42.5°	39.9
45°	29.9
47.5°	23.3
50°	15.8
52.5°	10.0
55°	7.5
57.5°	5.8
60°	4.2
62.5°	3.3
65°	2.5



TEST NUMBER: P789495  
CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBDP1LI

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.7
70°		0.8

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)