

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789497

Luminaire Tested: LER6D15D010-EC6DR2015309035-6LBS1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789497  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR2015309035-6LBS1B  
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1538.9 lumens  
Efficiency: N/A  
Efficacy: 97.4 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P789497

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBS1B

### Luminous Intensity Polar Plot

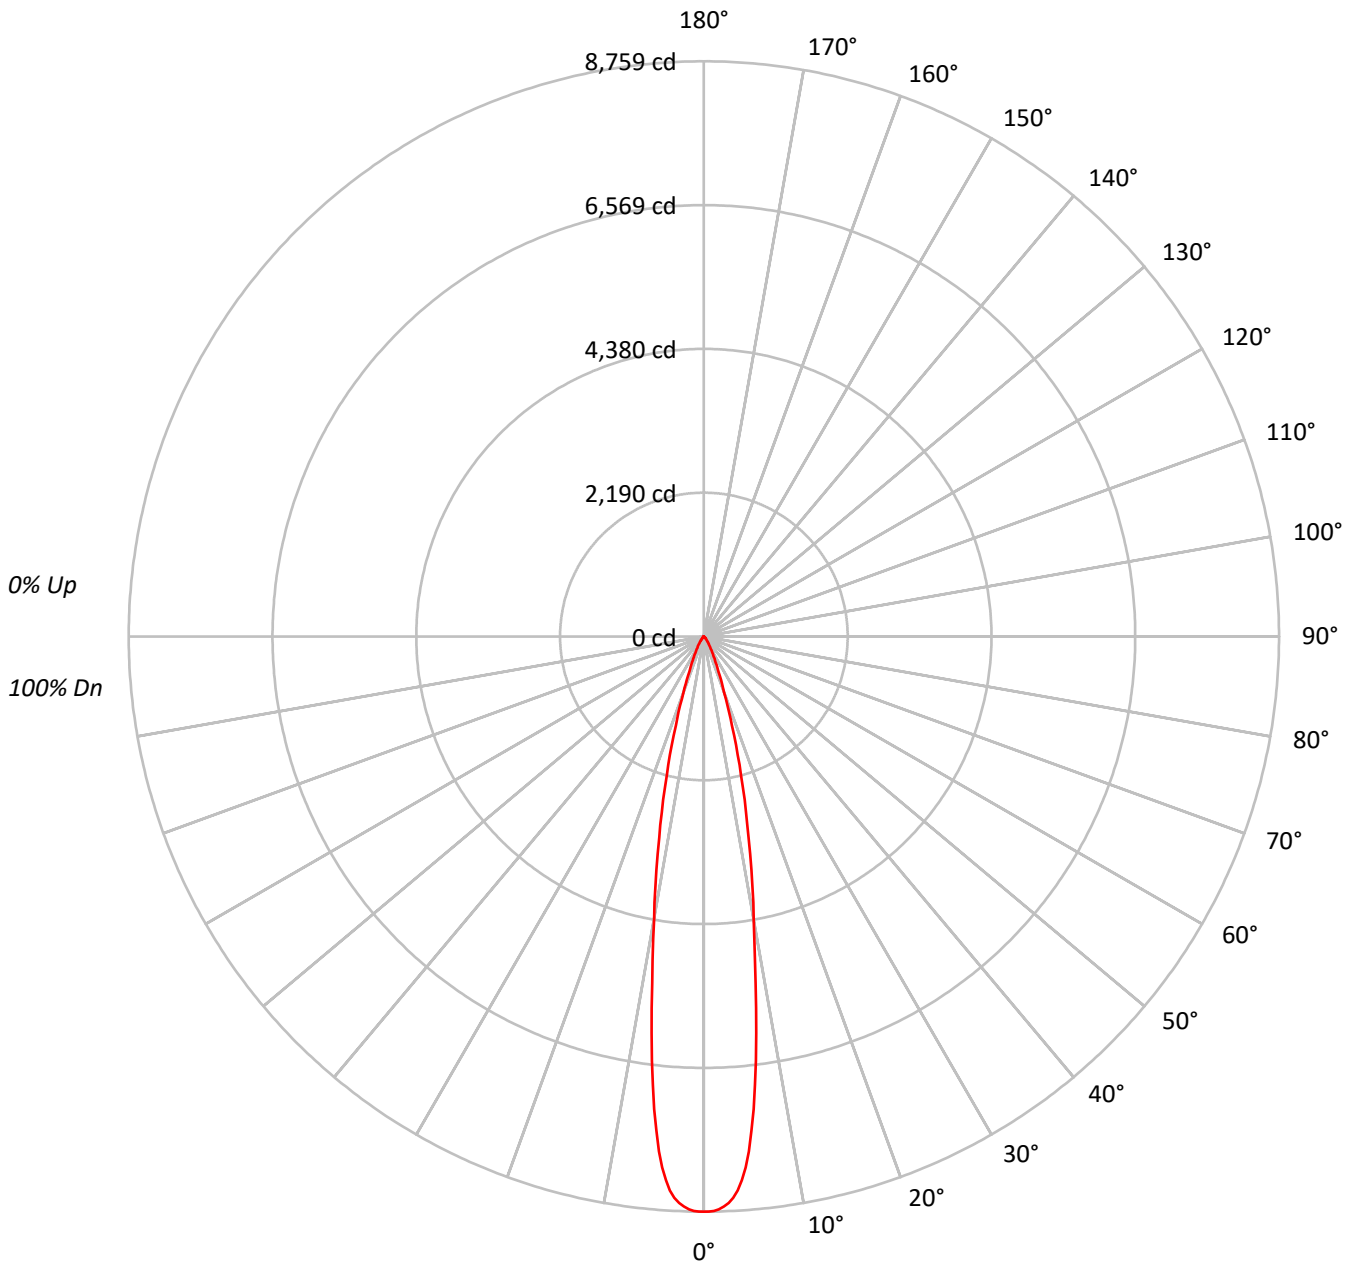



TEST NUMBER: P789497

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBS1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	97	97
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	94	94
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	91	91
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	88	88
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	85	85
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	83	83
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	81	81
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	79	79
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	77	77
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	75	75

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	957026
5°	863419
10°	484602
15°	246331
20°	104297
25°	48138
30°	25485
35°	13738
40°	7345
45°	4342
50°	2516
55°	1333
60°	852
65°	595
70°	256
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4342 cd/sqm



TEST NUMBER: P789497

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBS1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	623.6	40.5
10°-20°	614.1	39.9
20°-30°	200.6	13.0
30°-40°	68.3	4.4
40°-50°	23.0	1.5
50°-60°	6.9	0.5
60°-70°	2.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1438.3	93.5
0°-40°	1506.7	97.9
0°-60°	1536.5	99.8
0°-90°	1538.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1538.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	8759	
5°	7872	624
15°	2178	614
25°	399	201
35°	103	68
45°	28	23
55°	7	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789497

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBS1B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	8759.1
0.5°	8759.1
1°	8748.2
1.5°	8726.4
2°	8686.6
2.5°	8633.6
3°	8558.7
3.5°	8454.2
4°	8298.9
4.5°	8110.2
5°	7872.3
5.5°	7559.5
6°	7239.0
6.5°	6871.6
7°	6512.0
7.5°	6090.8
8°	5714.9
8.5°	5336.6
9°	4987.2
9.5°	4666.6
10°	4367.9
12.5°	3136.3
15°	2177.7
17.5°	1422.7
20°	897.0
22.5°	581.1
25°	399.3
27.5°	280.8
30°	202.0
32.5°	145.1
35°	103.0
37.5°	71.8
40°	51.5
42.5°	37.4
45°	28.1
47.5°	21.8
50°	14.8
52.5°	9.4
55°	7.0
57.5°	5.5
60°	3.9
62.5°	3.1
65°	2.3



TEST NUMBER: P789497

CATALOG NUMBER: LER6D15D010-EC6DR2015309035-6LBS1B

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





67.5°		1.6
70°		0.8

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)