

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789507

Luminaire Tested: LER6D15D010-EC6DR2015309040-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789507  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR2015309040-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1605.5 lumens  
Efficiency: N/A  
Efficacy: 101.6 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P789507

CATALOG NUMBER: LER6D15D010-EC6DR2015309040-6LBS1MW

### Luminous Intensity Polar Plot

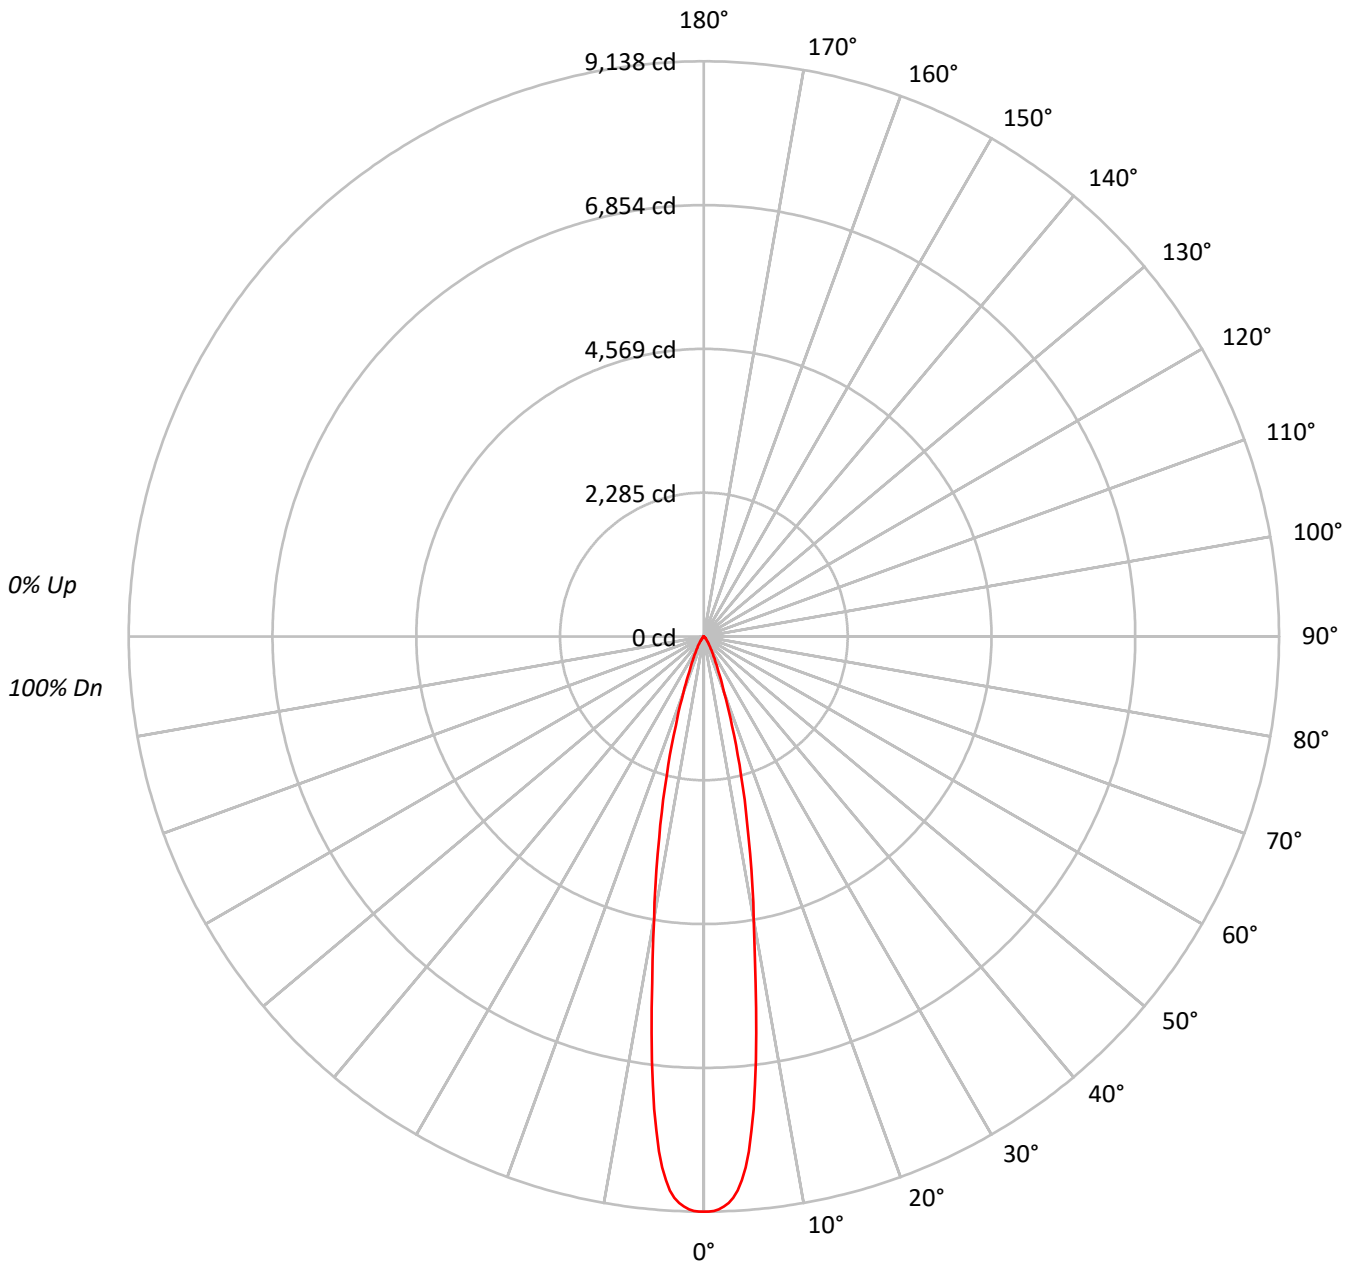



TEST NUMBER: P789507

CATALOG NUMBER: LER6D15D010-EC6DR2015309040-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	98	96	95	94	93	92	91	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	98	96	95	94	93	92	91	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	98	96	95	94	93	92	91	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	98	96	95	94	93	92	91	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	98	96	95	94	93	92	91	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	98	96	95	94	93	92	91	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	98	96	95	94	93	92	91	75												

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	998447
5°	900786
10°	505571
15°	256986
20°	108808
25°	50224
30°	26595
35°	14325
40°	7659
45°	4527
50°	2635
55°	1391
60°	896
65°	620
70°	256
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4527 cd/sqm



TEST NUMBER: P789507

CATALOG NUMBER: LER6D15D010-EC6DR2015309040-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	650.6	40.5
10°-20°	640.7	39.9
20°-30°	209.3	13.0
30°-40°	71.3	4.4
40°-50°	24.0	1.5
50°-60°	7.2	0.4
60°-70°	2.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1500.6	93.5
0°-40°	1571.8	97.9
0°-60°	1603.0	99.8
0°-90°	1605.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1605.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9138	
5°	8213	651
15°	2272	641
25°	417	209
35°	107	71
45°	29	24
55°	7	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789507

CATALOG NUMBER: LER6D15D010-EC6DR2015309040-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9138.2
0.5°	9138.2
1°	9126.8
1.5°	9104.0
2°	9062.5
2.5°	9007.2
3°	8929.1
3.5°	8820.0
4°	8658.1
4.5°	8461.2
5°	8213.0
5.5°	7886.7
6°	7552.2
6.5°	7169.0
7°	6793.8
7.5°	6354.4
8°	5962.2
8.5°	5567.5
9°	5203.0
9.5°	4868.5
10°	4556.9
12.5°	3272.0
15°	2271.9
17.5°	1484.2
20°	935.8
22.5°	606.2
25°	416.6
27.5°	292.9
30°	210.8
32.5°	151.4
35°	107.4
37.5°	74.9
40°	53.7
42.5°	39.1
45°	29.3
47.5°	22.8
50°	15.5
52.5°	9.8
55°	7.3
57.5°	5.7
60°	4.1
62.5°	3.3
65°	2.4



TEST NUMBER: P789507

CATALOG NUMBER: LER6D15D010-EC6DR2015309040-6LBS1MW

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.6
70°		0.8

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)