

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789513

Luminaire Tested: LER6D15D010-EC6DR2015309050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789513
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D15D010-EC6DR2015309050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1670.1 lumens
Efficiency: N/A
Efficacy: 105.7 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789513

CATALOG NUMBER: LER6D15D010-EC6DR2015309050-6LBS1H

Luminous Intensity Polar Plot

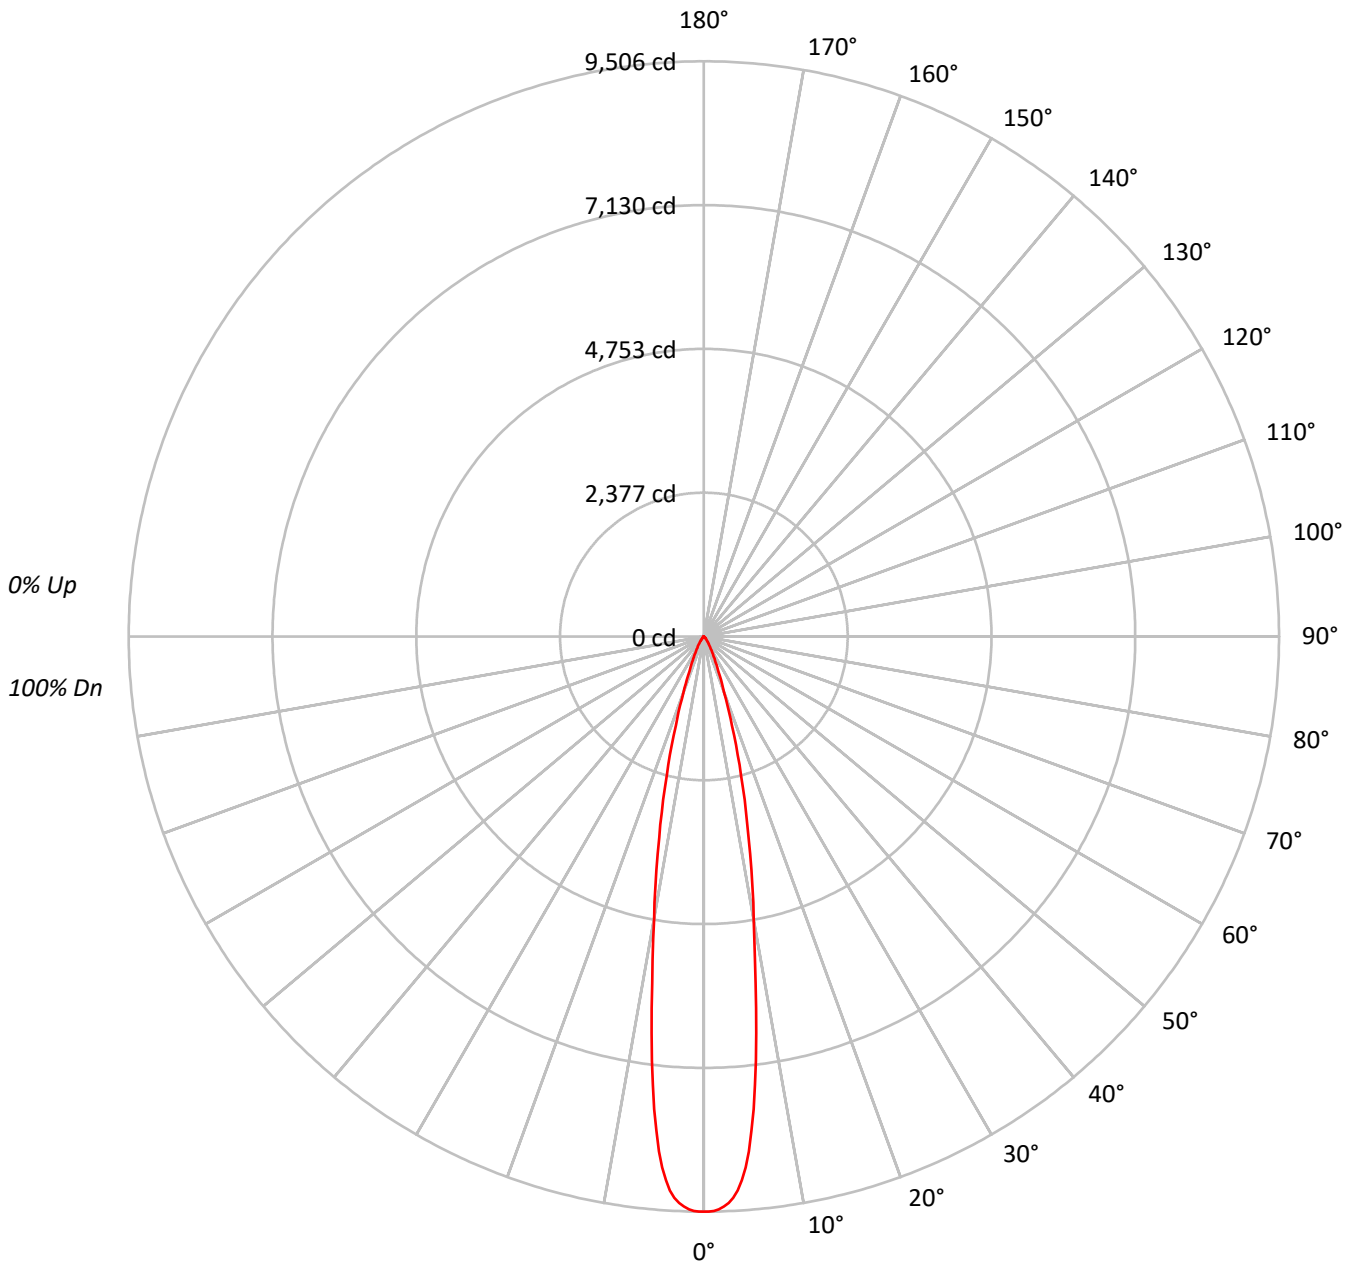



TEST NUMBER: P789513
 CATALOG NUMBER: LER6D15D010-EC6DR2015309050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	97	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	94	94																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	91	91																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	88	88																
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	85	85																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	83	83																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	81	81																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	79	79																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	77	77																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	75	75																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1038600
5°	937013
10°	525908
15°	267325
20°	113180
25°	52249
30°	27655
35°	14899
40°	7973
45°	4713
50°	2737
55°	1448
60°	918
65°	646
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4713 cd/sqm



TEST NUMBER: P789513

CATALOG NUMBER: LER6D15D010-EC6DR2015309050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	676.8	40.5
10°-20°	666.4	39.9
20°-30°	217.7	13.0
30°-40°	74.1	4.4
40°-50°	24.9	1.5
50°-60°	7.5	0.4
60°-70°	2.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1560.9	93.5
0°-40°	1635.0	97.9
0°-60°	1667.5	99.8
0°-90°	1670.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1670.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9506	
5°	8543	677
15°	2363	666
25°	433	218
35°	112	74
45°	30	25
55°	8	8
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789513

CATALOG NUMBER: LER6D15D010-EC6DR2015309050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	9505.7
0.5°	9505.7
1°	9493.9
1.5°	9470.2
2°	9427.0
2.5°	9369.4
3°	9288.2
3.5°	9174.7
4°	9006.3
4.5°	8801.5
5°	8543.3
5.5°	8203.9
6°	7856.0
6.5°	7457.3
7°	7067.1
7.5°	6610.0
8°	6202.0
8.5°	5791.5
9°	5412.2
9.5°	5064.4
10°	4740.2
12.5°	3403.6
15°	2363.3
17.5°	1543.9
20°	973.4
22.5°	630.6
25°	433.4
27.5°	304.7
30°	219.2
32.5°	157.4
35°	111.7
37.5°	77.9
40°	55.9
42.5°	40.6
45°	30.5
47.5°	23.7
50°	16.1
52.5°	10.2
55°	7.6
57.5°	5.9
60°	4.2
62.5°	3.4
65°	2.5



TEST NUMBER: P789513
CATALOG NUMBER: LER6D15D010-EC6DR2015309050-6LBS1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.7
70°		0.8

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)