

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789654

Luminaire Tested: LER6D15D010-EC6DR350215IC9050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789654
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D15D010-EC6DR350215IC9050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2627.4 lumens
Efficiency: N/A
Efficacy: 166.3 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P789654
CATALOG NUMBER: LER6D15D010-EC6DR350215IC9050-6LBS1H

Luminous Intensity Polar Plot

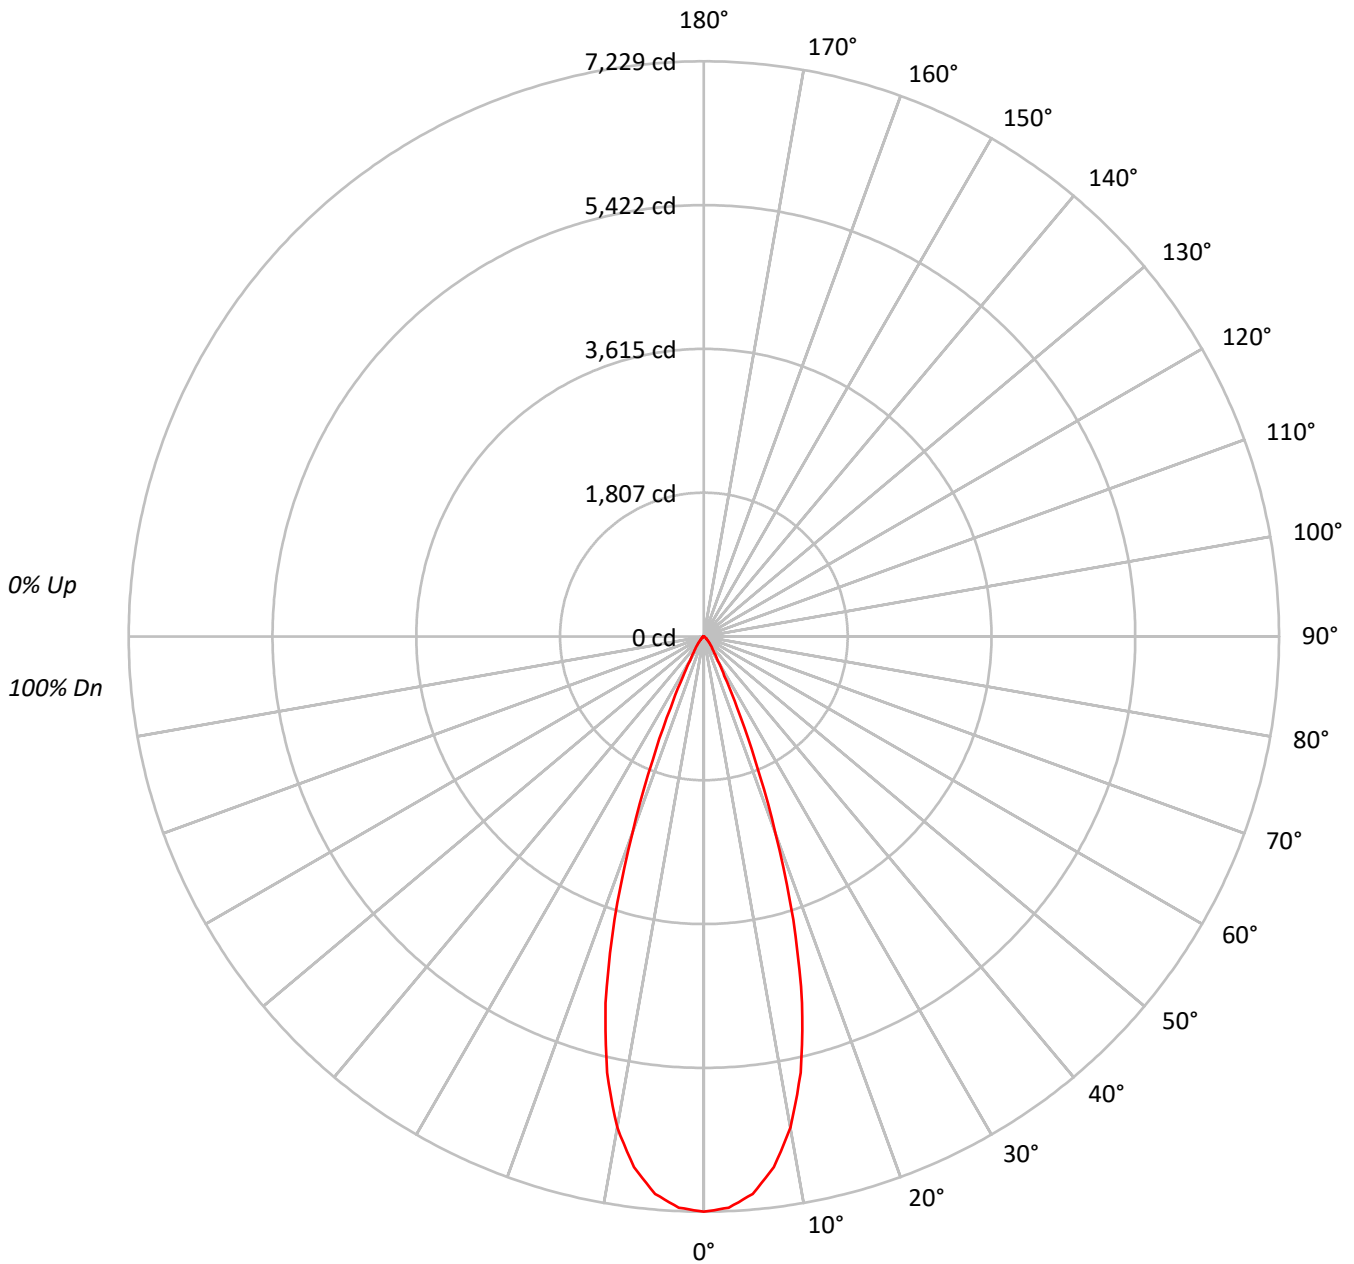



TEST NUMBER: P789654

CATALOG NUMBER: LER6D15D010-EC6DR350215IC9050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20		
RC	80				70				50				30				10		0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	0
RCR																			
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	789868
5°	771311
10°	695156
15°	539548
20°	306030
25°	119061
30°	44422
35°	24342
40°	15917
45°	9688
50°	6170
55°	4362
60°	3190
65°	1732
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9688 cd/sqm



TEST NUMBER: P789654

CATALOG NUMBER: LER6D15D010-EC6DR350215IC9050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	646.8	24.6
10°-20°	1262.8	48.1
20°-30°	515.0	19.6
30°-40°	123.2	4.7
40°-50°	51.4	2.0
50°-60°	21.3	0.8
60°-70°	6.7	0.3
70°-80°	0.2	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2424.6	92.3
0°-40°	2547.8	97.0
0°-60°	2620.5	99.7
0°-90°	2627.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2627.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7229	
5°	7032	647
15°	4770	1263
25°	988	515
35°	182	123
45°	63	51
55°	23	21
65°	7	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789654

CATALOG NUMBER: LER6D15D010-EC6DR350215IC9050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	7229.2
2.5°	7185.9
5°	7032.5
7.5°	6726.6
10°	6265.7
12.5°	5616.8
15°	4769.9
17.5°	3734.3
20°	2632.0
22.5°	1678.3
25°	987.6
27.5°	558.2
30°	352.1
32.5°	247.2
35°	182.5
37.5°	141.1
40°	111.6
42.5°	85.9
45°	62.7
47.5°	46.9
50°	36.3
52.5°	28.8
55°	22.9
57.5°	18.5
60°	14.6
62.5°	10.6
65°	6.7
67.5°	2.4
70°	0.4
72.5°	0.4
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.4
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)