

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789761

Luminaire Tested: LER6D15D010-EC6DR500215IC9027-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789761
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D15D010-EC6DR500215IC9027-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2571.2 lumens
Efficiency: N/A
Efficacy: 162.7 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P789761
CATALOG NUMBER: LER6D15D010-EC6DR500215IC9027-6LBDP1LI

Luminous Intensity Polar Plot

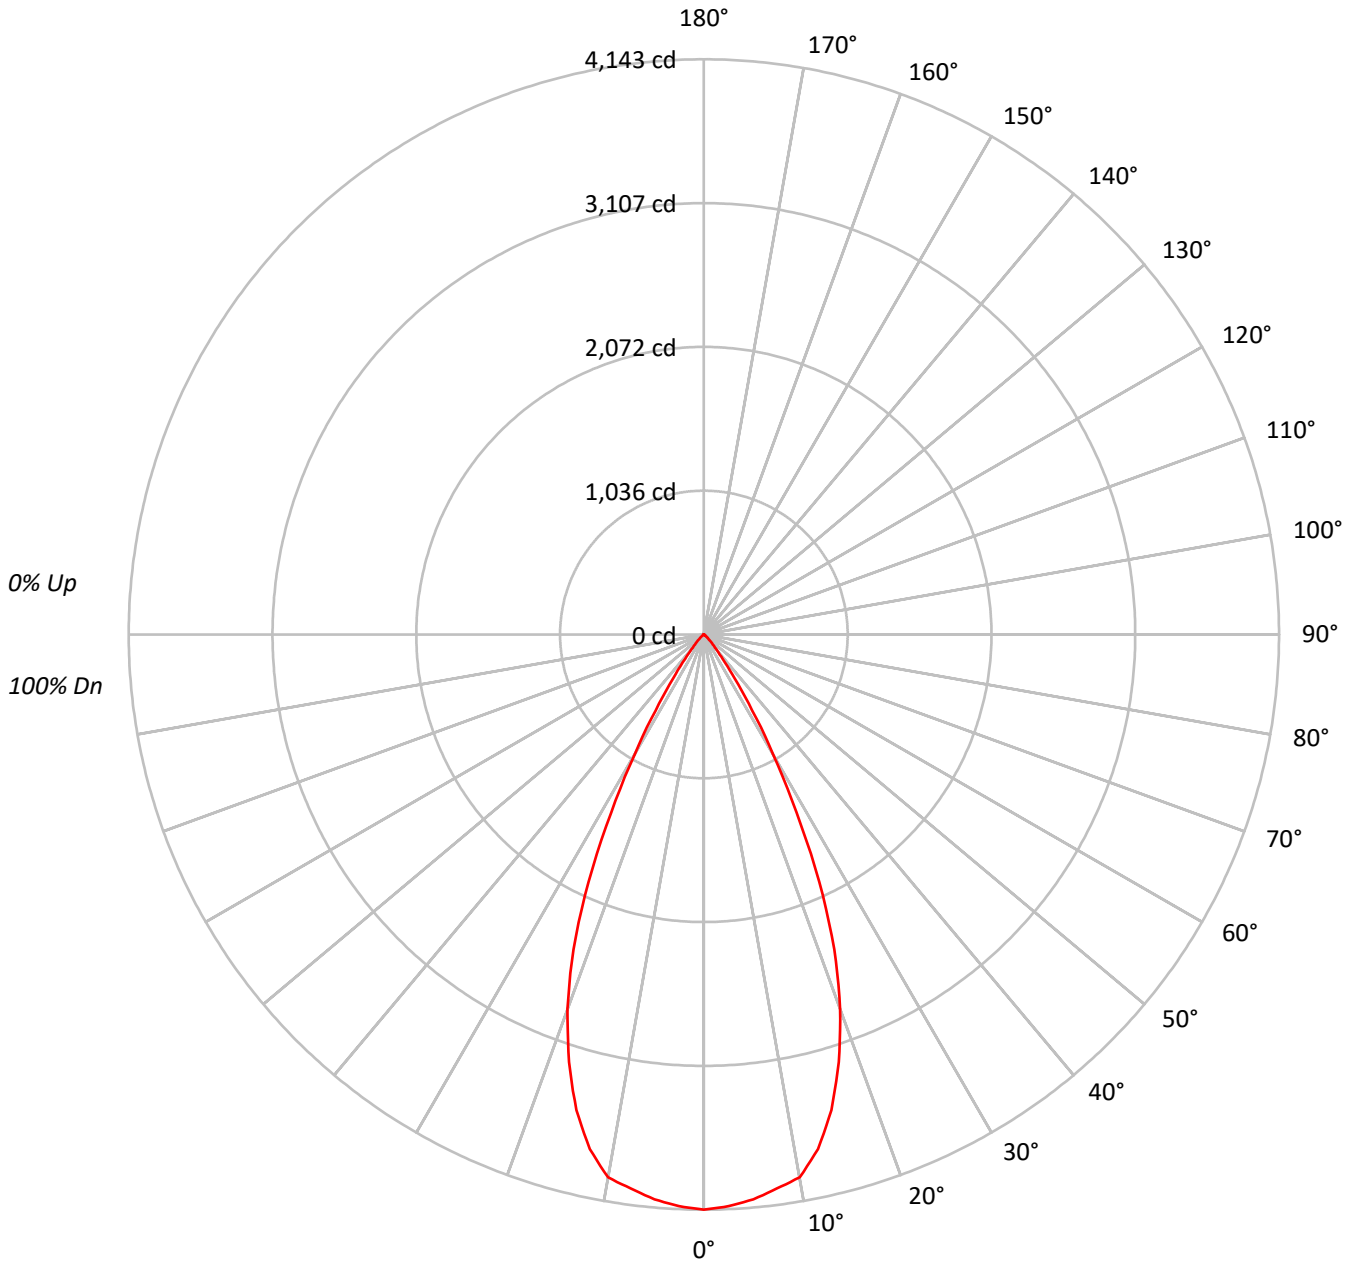



TEST NUMBER: P789761

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9027-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	452667
5°	447925
10°	440545
15°	401151
20°	333808
25°	236953
30°	125419
35°	51112
40°	18984
45°	8684
50°	3570
55°	1867
60°	918
65°	259
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8684 cd/sqm



TEST NUMBER: P789761

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9027-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	386.0	15.0
10°-20°	975.5	37.9
20°-30°	876.3	34.1
30°-40°	274.4	10.7
40°-50°	48.0	1.9
50°-60°	9.6	0.4
60°-70°	1.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2237.9	87.0
0°-40°	2512.2	97.7
0°-60°	2569.8	99.9
0°-90°	2571.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2571.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4143	
5°	4084	386
15°	3546	976
25°	1966	876
35°	383	274
45°	56	48
55°	10	10
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789761

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9027-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4143.0
2.5°	4122.4
5°	4084.0
7.5°	4025.3
10°	3970.8
12.5°	3796.1
15°	3546.4
17.5°	3229.2
20°	2870.9
22.5°	2456.2
25°	1965.5
27.5°	1445.0
30°	994.1
32.5°	647.2
35°	383.2
37.5°	220.1
40°	133.1
42.5°	86.6
45°	56.2
47.5°	34.2
50°	21.0
52.5°	14.3
55°	9.8
57.5°	6.6
60°	4.2
62.5°	2.4
65°	1.0
67.5°	0.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)