

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789777

Luminaire Tested: LER6D15D010-EC6DR500215IC9035-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789777
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D15D010-EC6DR500215IC9035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2802.8 lumens
Efficiency: N/A
Efficacy: 177.4 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789777

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9035-6LBDP1LI

Luminous Intensity Polar Plot

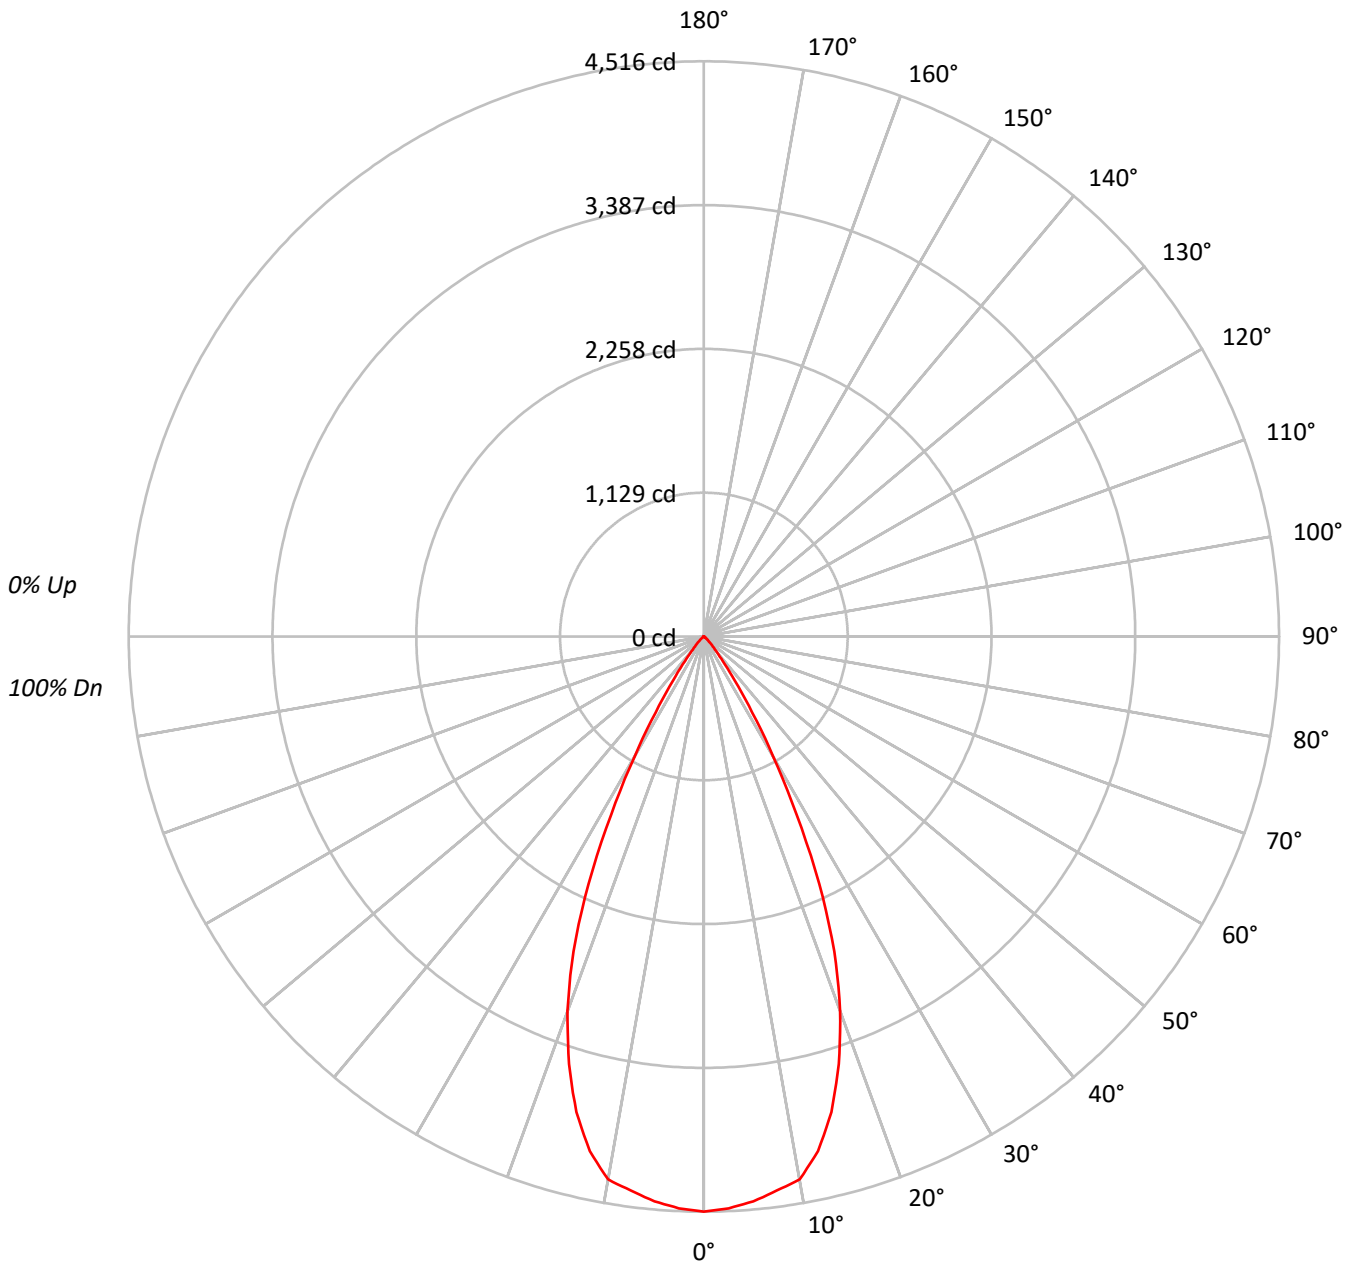



TEST NUMBER: P789777

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	493432
5°	488254
10°	480220
15°	437269
20°	363864
25°	258291
30°	136711
35°	55714
40°	20696
45°	9472
50°	3876
55°	2038
60°	1005
65°	284
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9472 cd/sqm



TEST NUMBER: P789777

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	420.8	15.0
10°-20°	1063.4	37.9
20°-30°	955.2	34.1
30°-40°	299.1	10.7
40°-50°	52.4	1.9
50°-60°	10.4	0.4
60°-70°	1.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2439.4	87.0
0°-40°	2738.5	97.7
0°-60°	2801.2	99.9
0°-90°	2802.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2802.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4516	
5°	4452	421
15°	3866	1063
25°	2142	955
35°	418	299
45°	61	52
55°	11	10
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789777

CATALOG NUMBER: LER6D15D010-EC6DR500215IC9035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4516.1
2.5°	4493.6
5°	4451.7
7.5°	4387.7
10°	4328.4
12.5°	4138.0
15°	3865.7
17.5°	3520.0
20°	3129.4
22.5°	2677.4
25°	2142.5
27.5°	1575.2
30°	1083.6
32.5°	705.5
35°	417.7
37.5°	239.9
40°	145.1
42.5°	94.4
45°	61.3
47.5°	37.3
50°	22.8
52.5°	15.6
55°	10.7
57.5°	7.2
60°	4.6
62.5°	2.7
65°	1.1
67.5°	0.4
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)