

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789824

Luminaire Tested: LER6D15D010-EC6DR550215IC9035-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P789824
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D15D010-EC6DR550215IC9035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2762.9 lumens
Efficiency: N/A
Efficacy: 174.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P789824

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBDP1LI

Luminous Intensity Polar Plot

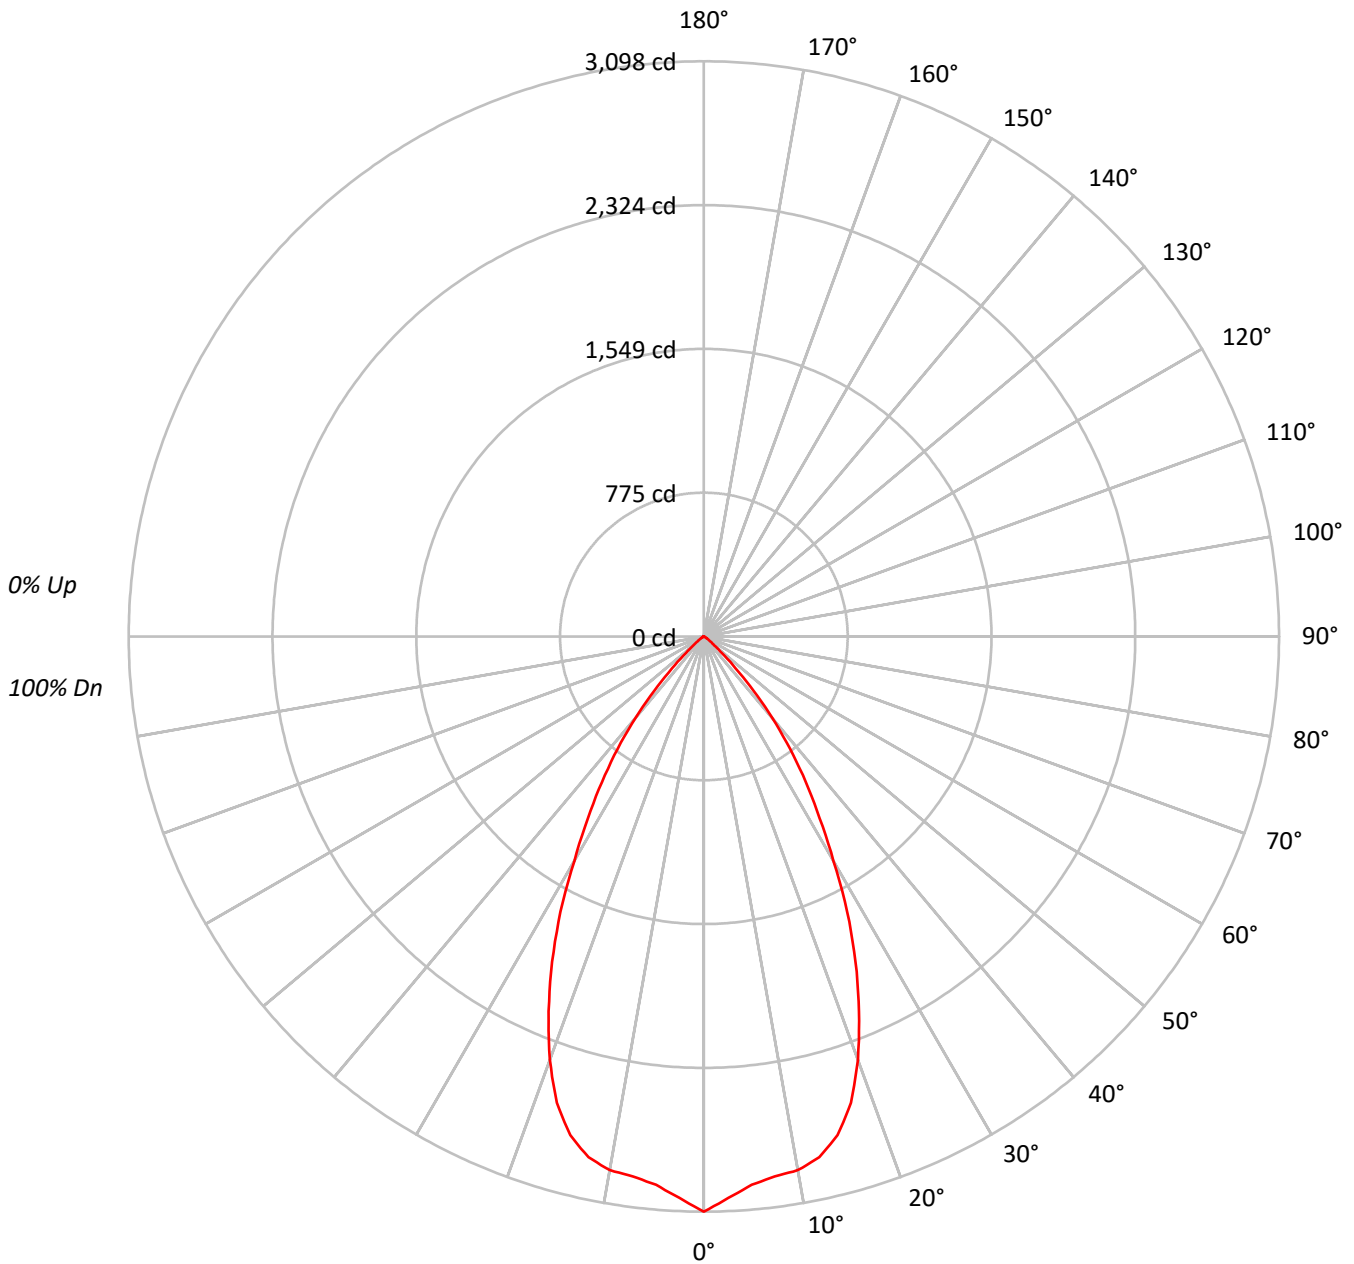



TEST NUMBER: P789824

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57																			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54																			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	338501
5°	325053
10°	323830
15°	314528
20°	282020
25°	233071
30°	176061
35°	127661
40°	81698
45°	37316
50°	12205
55°	5258
60°	2273
65°	310
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 37316 cd/sqm



TEST NUMBER: P789824

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	282.0	10.2
10°-20°	769.7	27.9
20°-30°	877.1	31.7
30°-40°	597.1	21.6
40°-50°	205.8	7.4
50°-60°	28.4	1.0
60°-70°	2.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1928.8	69.8
0°-40°	2525.9	91.4
0°-60°	2760.1	99.9
0°-90°	2762.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2762.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3098	
5°	2964	282
15°	2781	770
25°	1933	877
35°	957	597
45°	242	206
55°	28	28
65°	1	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789824

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3098.1
2.5°	3027.1
5°	2963.7
7.5°	2932.6
10°	2918.8
12.5°	2872.8
15°	2780.6
17.5°	2634.3
20°	2425.5
22.5°	2184.4
25°	1933.3
27.5°	1671.9
30°	1395.5
32.5°	1161.3
35°	957.1
37.5°	762.8
40°	572.8
42.5°	397.0
45°	241.5
47.5°	130.1
50°	71.8
52.5°	42.6
55°	27.6
57.5°	17.7
60°	10.4
62.5°	4.6
65°	1.2
67.5°	0.4
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)