

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789827

Luminaire Tested: LER6D15D010-EC6DR550215IC9035-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789827  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR550215IC9035-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 55° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2769.8 lumens  
Efficiency: N/A  
Efficacy: 175.3 lumens/watt  
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P789827

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBS1H

### Luminous Intensity Polar Plot

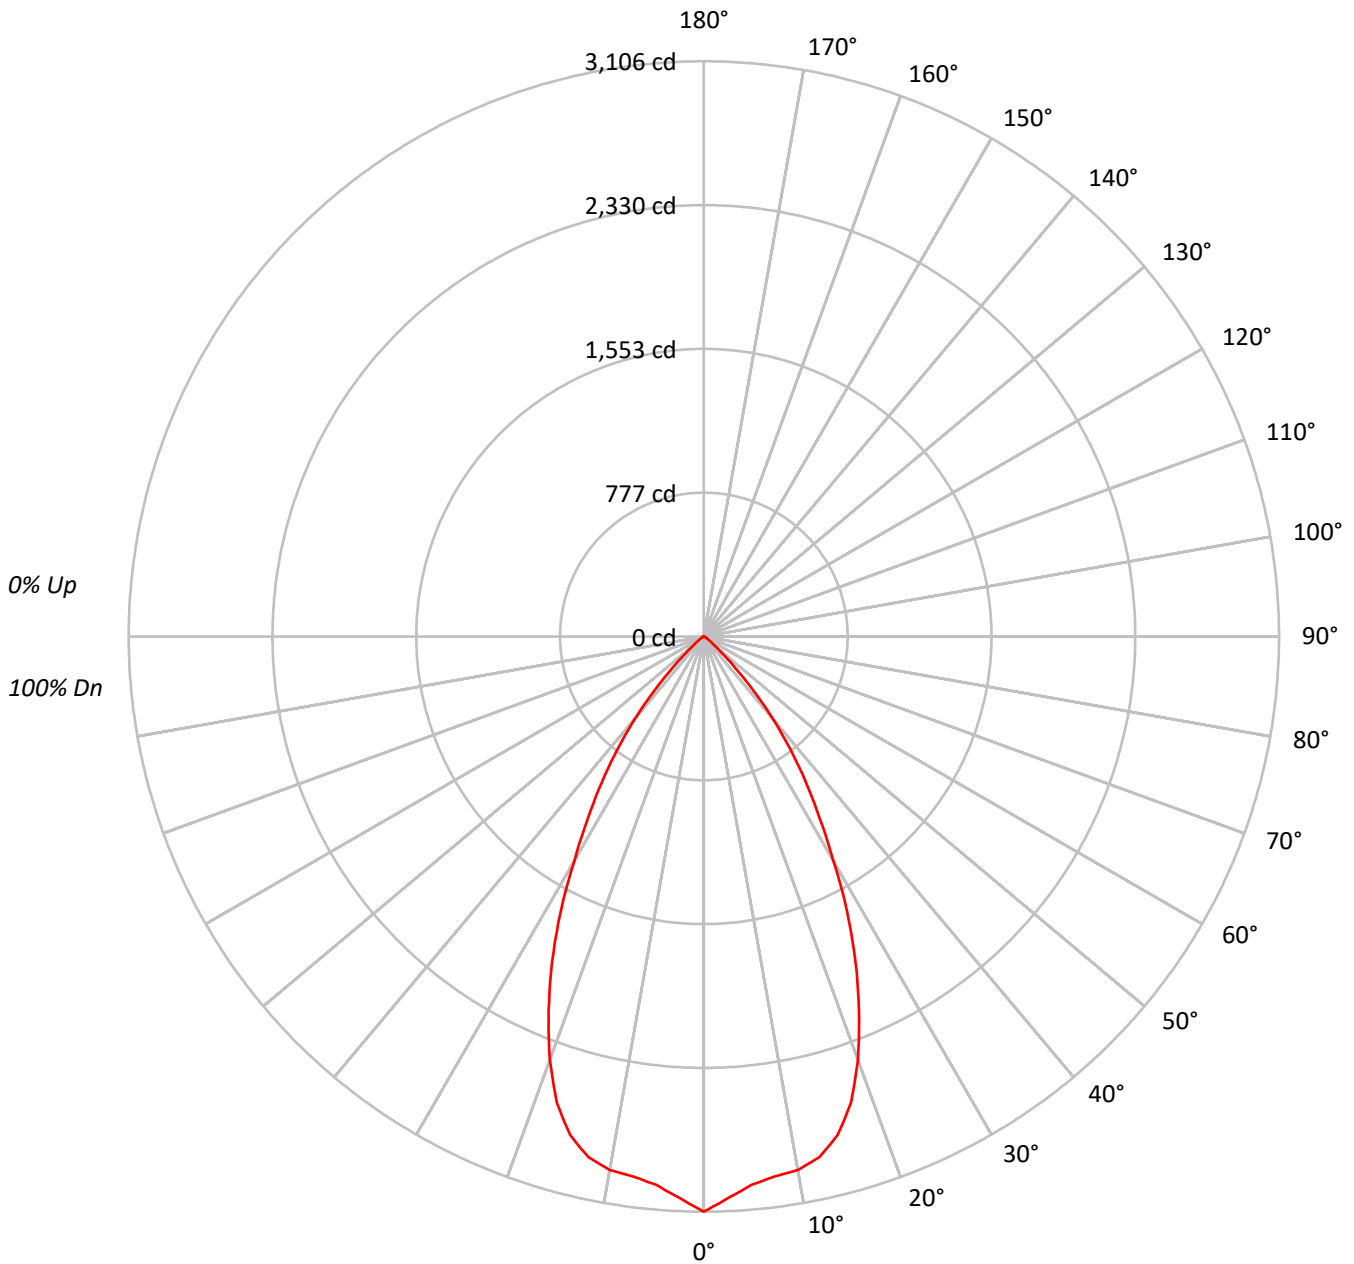



TEST NUMBER: P789827

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	339353
5°	325876
10°	324640
15°	315320
20°	282729
25°	233661
30°	176503
35°	127981
40°	81898
45°	37409
50°	12239
55°	5277
60°	2273
65°	310
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 37409 cd/sqm



TEST NUMBER: P789827

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	282.7	10.2
10°-20°	771.6	27.9
20°-30°	879.3	31.7
30°-40°	598.6	21.6
40°-50°	206.3	7.4
50°-60°	28.5	1.0
60°-70°	2.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1933.6	69.8
0°-40°	2532.2	91.4
0°-60°	2767.0	99.9
0°-90°	2769.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2769.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3106	
5°	2971	283
15°	2788	772
25°	1938	879
35°	960	599
45°	242	206
55°	28	29
65°	1	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P789827

CATALOG NUMBER: LER6D15D010-EC6DR550215IC9035-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	3105.9
2.5°	3034.7
5°	2971.2
7.5°	2940.0
10°	2926.1
12.5°	2880.0
15°	2787.6
17.5°	2640.9
20°	2431.6
22.5°	2189.9
25°	1938.2
27.5°	1676.1
30°	1399.0
32.5°	1164.2
35°	959.5
37.5°	764.7
40°	574.2
42.5°	398.0
45°	242.1
47.5°	130.5
50°	72.0
52.5°	42.7
55°	27.7
57.5°	17.7
60°	10.4
62.5°	4.6
65°	1.2
67.5°	0.4
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)