

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P789886

Luminaire Tested: LER6D15D010-EC6DR600215IC9050-6LBDP1MW

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P789886  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D15D010-EC6DR600215IC9050-6LBDP1MW  
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2373.3 lumens  
Efficiency: N/A  
Efficacy: 150.2 lumens/watt  
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P789886

CATALOG NUMBER: LER6D15D010-EC6DR600215IC9050-6LBDP1MW

### Luminous Intensity Polar Plot

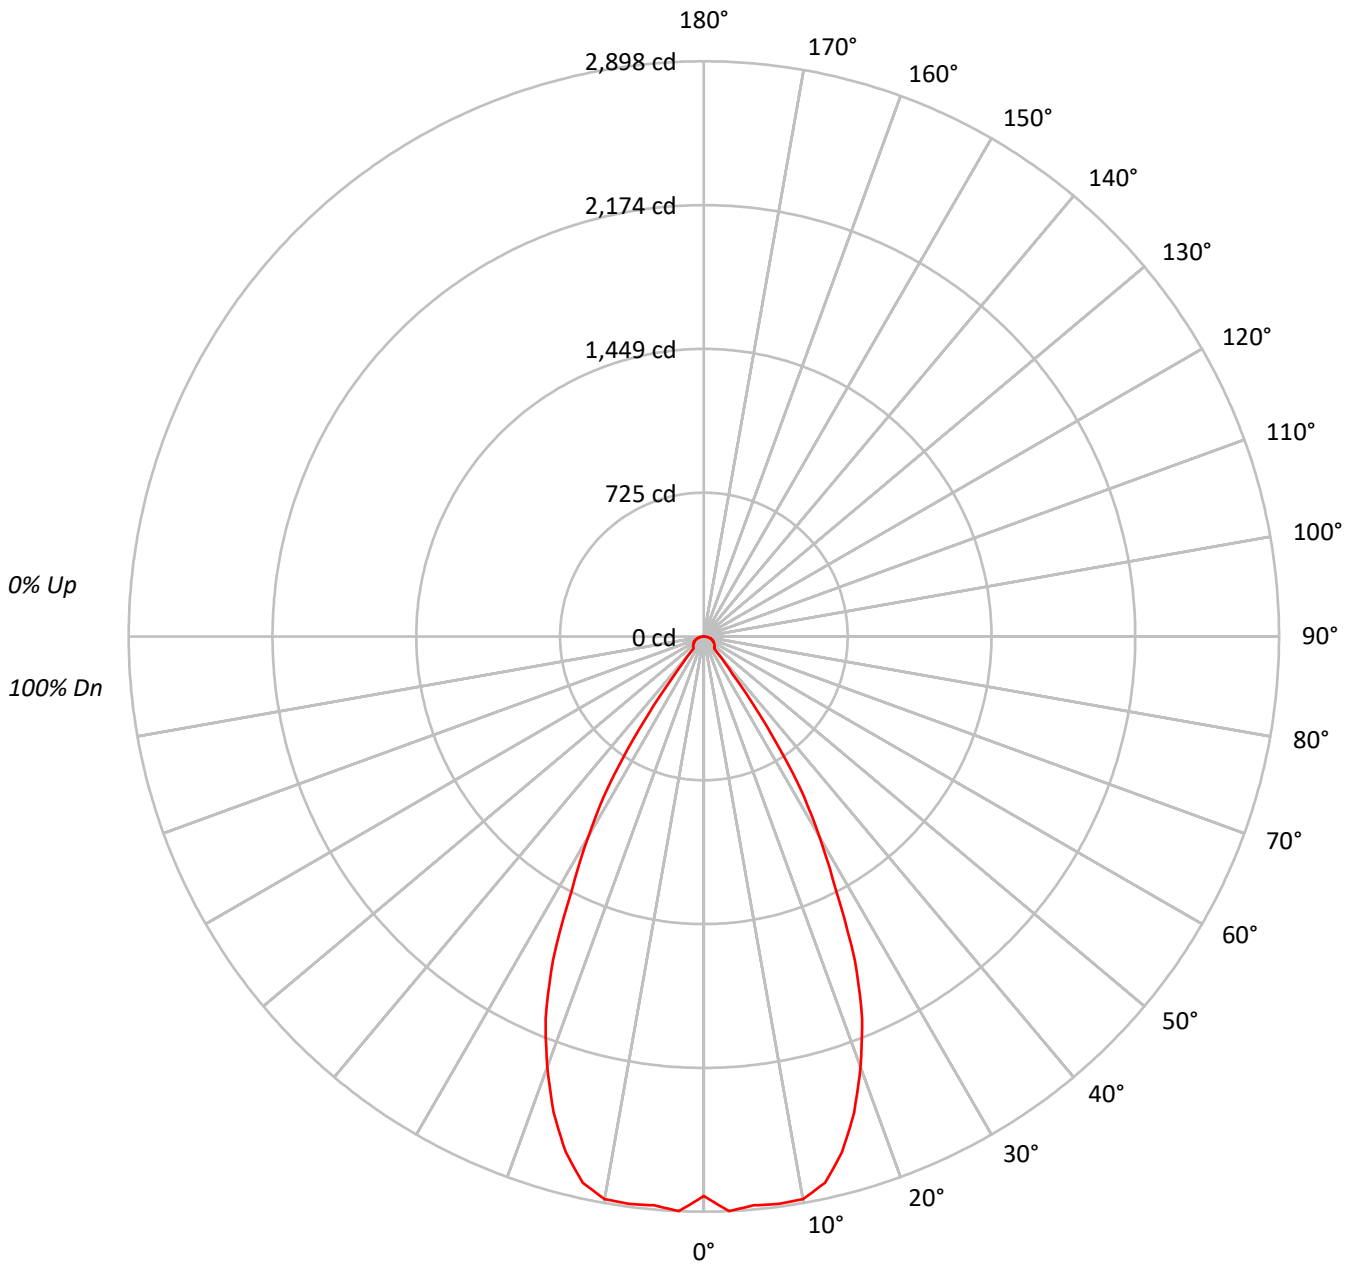



TEST NUMBER: P789886

CATALOG NUMBER: LER6D15D010-EC6DR600215IC9050-6LBDP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93																
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86																
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80																
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75																
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70																
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66																
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62																
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59																
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55																
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	307951
5°	315522
10°	319337
15°	304212
20°	268218
25°	216940
30°	146741
35°	73534
40°	11924
45°	11682
50°	11916
55°	12096
60°	12434
65°	12720
70°	13002
75°	13171
80°	12710
85°	10530

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 75°  
 Luminance: 13171 cd/sqm



TEST NUMBER: P789886

CATALOG NUMBER: LER6D15D010-EC6DR600215IC9050-6LBDP1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	275.0	11.6
10°-20°	743.9	31.3
20°-30°	800.4	33.7
30°-40°	347.9	14.7
40°-50°	58.4	2.5
50°-60°	56.9	2.4
60°-70°	48.6	2.0
70°-80°	32.5	1.4
80°-90°	9.7	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1819.2	76.7
0°-40°	2167.1	91.3
0°-60°	2282.4	96.2
0°-90°	2373.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2373.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2818	
5°	2877	275
15°	2689	744
25°	1800	800
35°	551	348
45°	76	58
55°	64	57
65°	49	49
75°	31	33
85°	8	10
90°	0	



TEST NUMBER: P789886

CATALOG NUMBER: LER6D15D010-EC6DR600215IC9050-6LBDP1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2818.5
2.5°	2897.8
5°	2876.8
7.5°	2883.5
10°	2878.3
12.5°	2818.9
15°	2689.4
17.5°	2515.5
20°	2306.8
22.5°	2083.5
25°	1799.5
27.5°	1439.3
30°	1163.1
32.5°	896.5
35°	551.3
37.5°	235.9
40°	83.6
42.5°	77.0
45°	75.6
47.5°	73.0
50°	70.1
52.5°	66.8
55°	63.5
57.5°	60.2
60°	56.9
62.5°	53.2
65°	49.2
67.5°	45.1
70°	40.7
72.5°	35.9
75°	31.2
77.5°	25.7
80°	20.2
82.5°	14.3
85°	8.4
87.5°	2.9
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)