

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790088

Luminaire Tested: LER6D20D010-EC6DR2015309027-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790088
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D20D010-EC6DR2015309027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1968.1 lumens
Efficiency: N/A
Efficacy: 85.2 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P790088

CATALOG NUMBER: LER6D20D010-EC6DR2015309027-6LBDP1H

Luminous Intensity Polar Plot

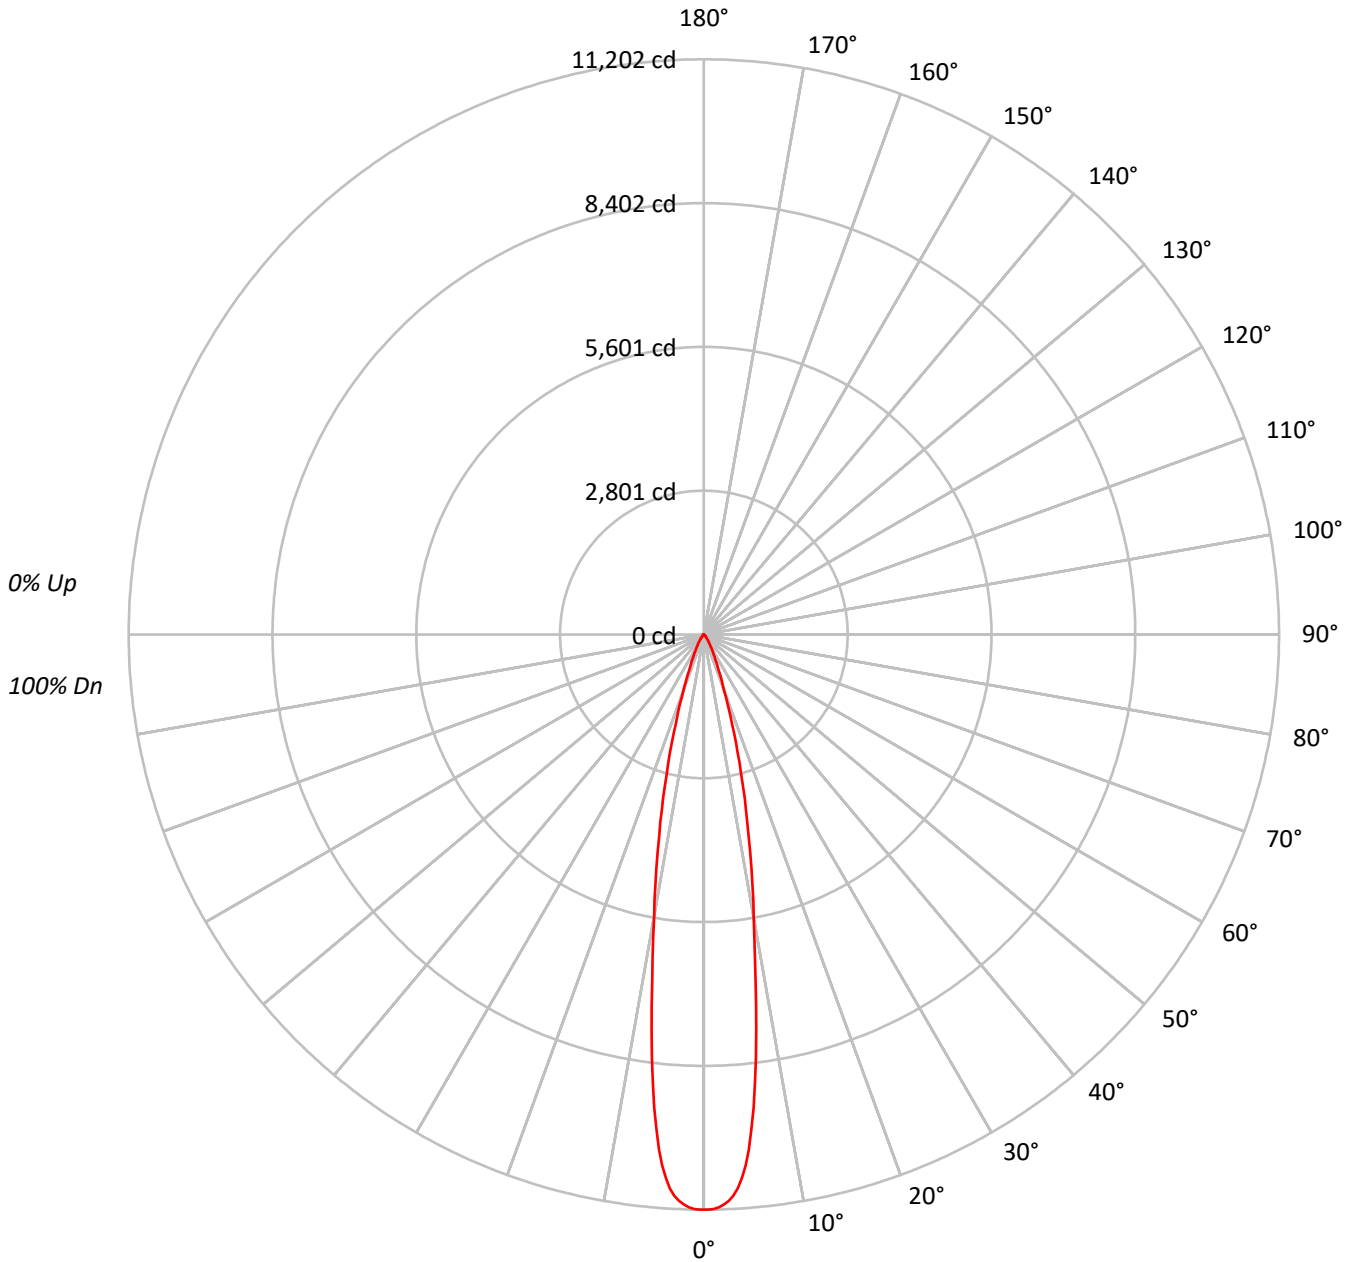



TEST NUMBER: P790088

CATALOG NUMBER: LER6D20D010-EC6DR2015309027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	96	95															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	91	89															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	88	86															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	86	84															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	84	82															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	82	80															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	80	78															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	78	76															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1223917
5°	1104206
10°	619746
15°	315025
20°	133377
25°	61568
30°	32601
35°	17567
40°	9385
45°	5547
50°	3230
55°	1714
60°	1093
65°	776
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5547 cd/sqm



TEST NUMBER: P790088

CATALOG NUMBER: LER6D20D010-EC6DR2015309027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	797.6	40.5
10°-20°	785.3	39.9
20°-30°	256.6	13.0
30°-40°	87.4	4.4
40°-50°	29.4	1.5
50°-60°	8.9	0.5
60°-70°	3.0	0.2
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1839.4	93.5
0°-40°	1926.8	97.9
0°-60°	1965.0	99.8
0°-90°	1968.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1968.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11202	
5°	10068	798
15°	2785	785
25°	511	257
35°	132	87
45°	36	29
55°	9	9
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P790088

CATALOG NUMBER: LER6D20D010-EC6DR2015309027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	11201.8
0.5°	11201.8
1°	11187.9
1.5°	11159.9
2°	11109.1
2.5°	11041.2
3°	10945.5
3.5°	10811.8
4°	10613.3
4.5°	10371.9
5°	10067.7
5.5°	9667.7
6°	9257.7
6.5°	8787.9
7°	8328.1
7.5°	7789.4
8°	7308.6
8.5°	6824.8
9°	6378.0
9.5°	5968.0
10°	5586.0
12.5°	4010.9
15°	2785.0
17.5°	1819.4
20°	1147.1
22.5°	743.1
25°	510.7
27.5°	359.1
30°	258.4
32.5°	185.5
35°	131.7
37.5°	91.8
40°	65.8
42.5°	47.9
45°	35.9
47.5°	27.9
50°	19.0
52.5°	12.0
55°	9.0
57.5°	7.0
60°	5.0
62.5°	4.0
65°	3.0



TEST NUMBER: P790088

CATALOG NUMBER: LER6D20D010-EC6DR2015309027-6LBDP1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		2.0
70°		1.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)