

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790111

Luminaire Tested: LER6D20D010-EC6DR2015309040-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790111
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D20D010-EC6DR2015309040-6LBDDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1889.8 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P790111
CATALOG NUMBER: LER6D20D010-EC6DR2015309040-6LBDP1B

Luminous Intensity Polar Plot

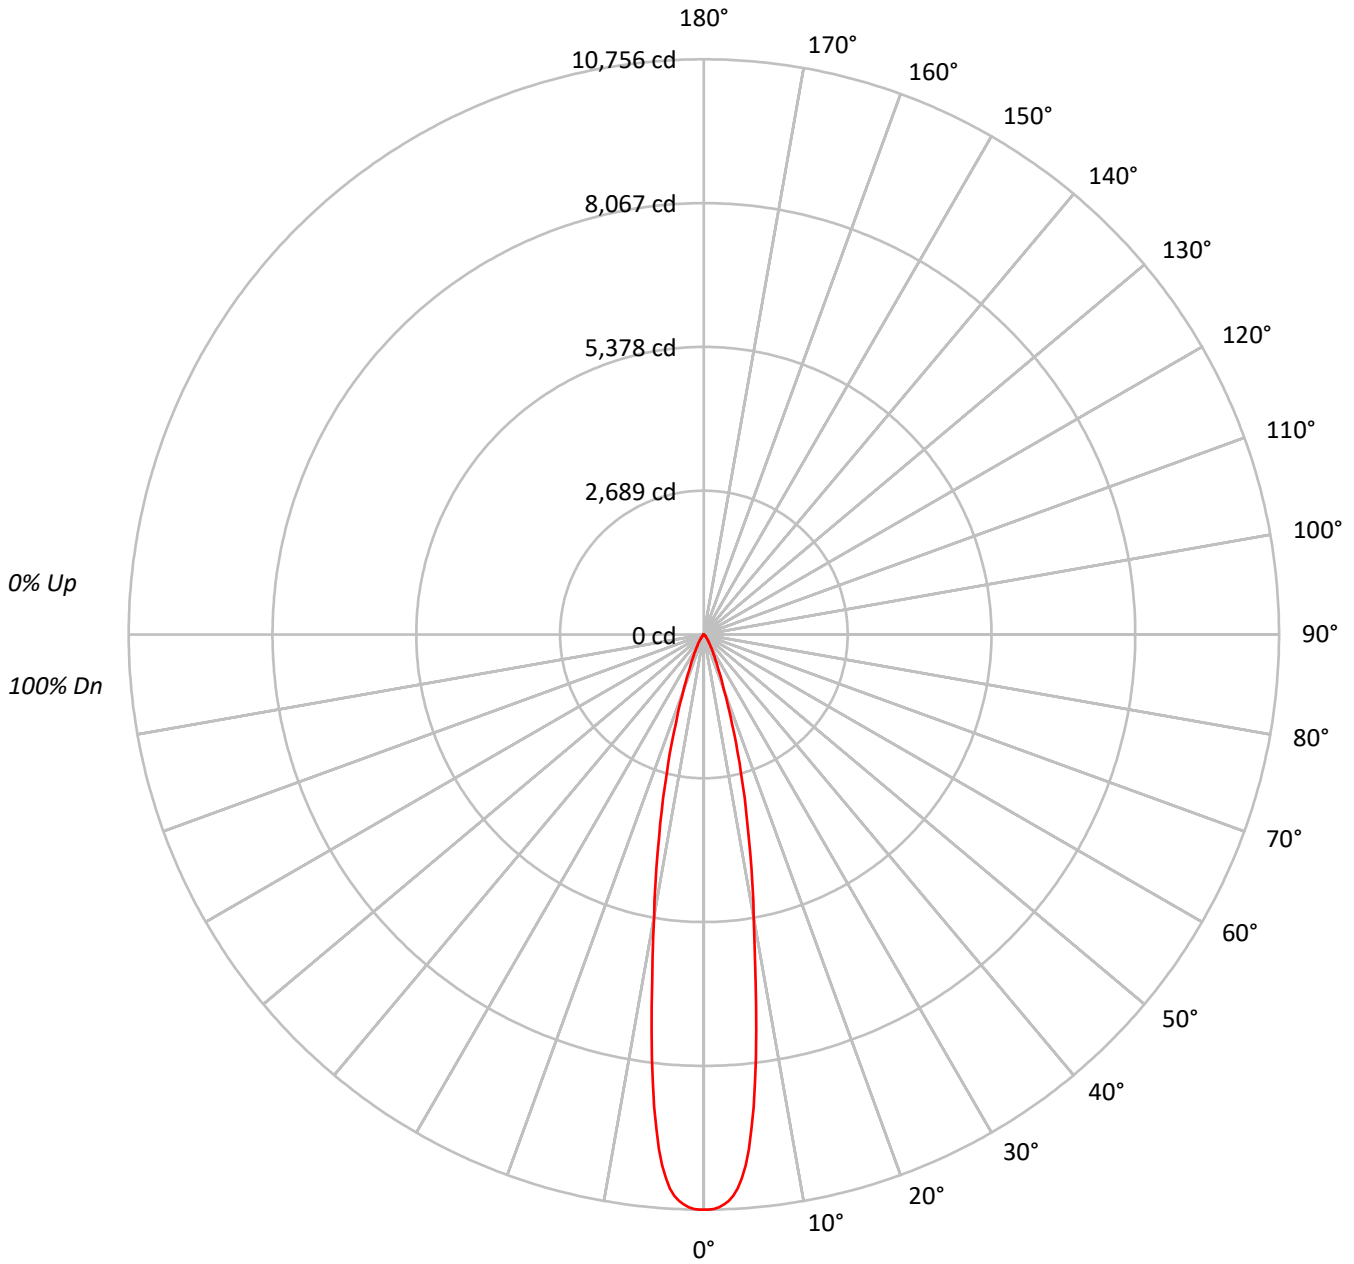



TEST NUMBER: P790111

CATALOG NUMBER: LER6D20D010-EC6DR2015309040-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	94																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	95	91																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	89																
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	86																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	84																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	82																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	80																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	78																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	76																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1175252
5°	1060302
10°	595105
15°	302504
20°	128075
25°	59121
30°	31301
35°	16860
40°	9014
45°	5331
50°	3094
55°	1638
60°	1049
65°	750
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5331 cd/sqm



TEST NUMBER: P790111

CATALOG NUMBER: LER6D20D010-EC6DR2015309040-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	765.8	40.5
10°-20°	754.1	39.9
20°-30°	246.4	13.0
30°-40°	83.9	4.4
40°-50°	28.2	1.5
50°-60°	8.5	0.4
60°-70°	2.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1766.3	93.5
0°-40°	1850.2	97.9
0°-60°	1886.9	99.8
0°-90°	1889.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1889.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10756	
5°	9667	766
15°	2674	754
25°	490	246
35°	126	84
45°	34	28
55°	9	8
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P790111

CATALOG NUMBER: LER6D20D010-EC6DR2015309040-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	10756.4
0.5°	10756.4
1°	10743.0
1.5°	10716.2
2°	10667.4
2.5°	10602.2
3°	10510.3
3.5°	10381.9
4°	10191.3
4.5°	9959.5
5°	9667.4
5.5°	9283.3
6°	8889.6
6.5°	8438.5
7°	7996.9
7.5°	7479.7
8°	7018.0
8.5°	6553.5
9°	6124.4
9.5°	5730.7
10°	5363.9
12.5°	3851.4
15°	2674.3
17.5°	1747.1
20°	1101.5
22.5°	713.6
25°	490.4
27.5°	344.8
30°	248.1
32.5°	178.2
35°	126.4
37.5°	88.1
40°	63.2
42.5°	46.0
45°	34.5
47.5°	26.8
50°	18.2
52.5°	11.5
55°	8.6
57.5°	6.7
60°	4.8
62.5°	3.8
65°	2.9



TEST NUMBER: P790111
CATALOG NUMBER: LER6D20D010-EC6DR2015309040-6LBDP1B

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.9
70°		1.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)