

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790120

Luminaire Tested: LER6D20D010-EC6DR2015309050-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790120
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D20D010-EC6DR2015309050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2178.6 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P790120
CATALOG NUMBER: LER6D20D010-EC6DR2015309050-6LBDP1H

Luminous Intensity Polar Plot

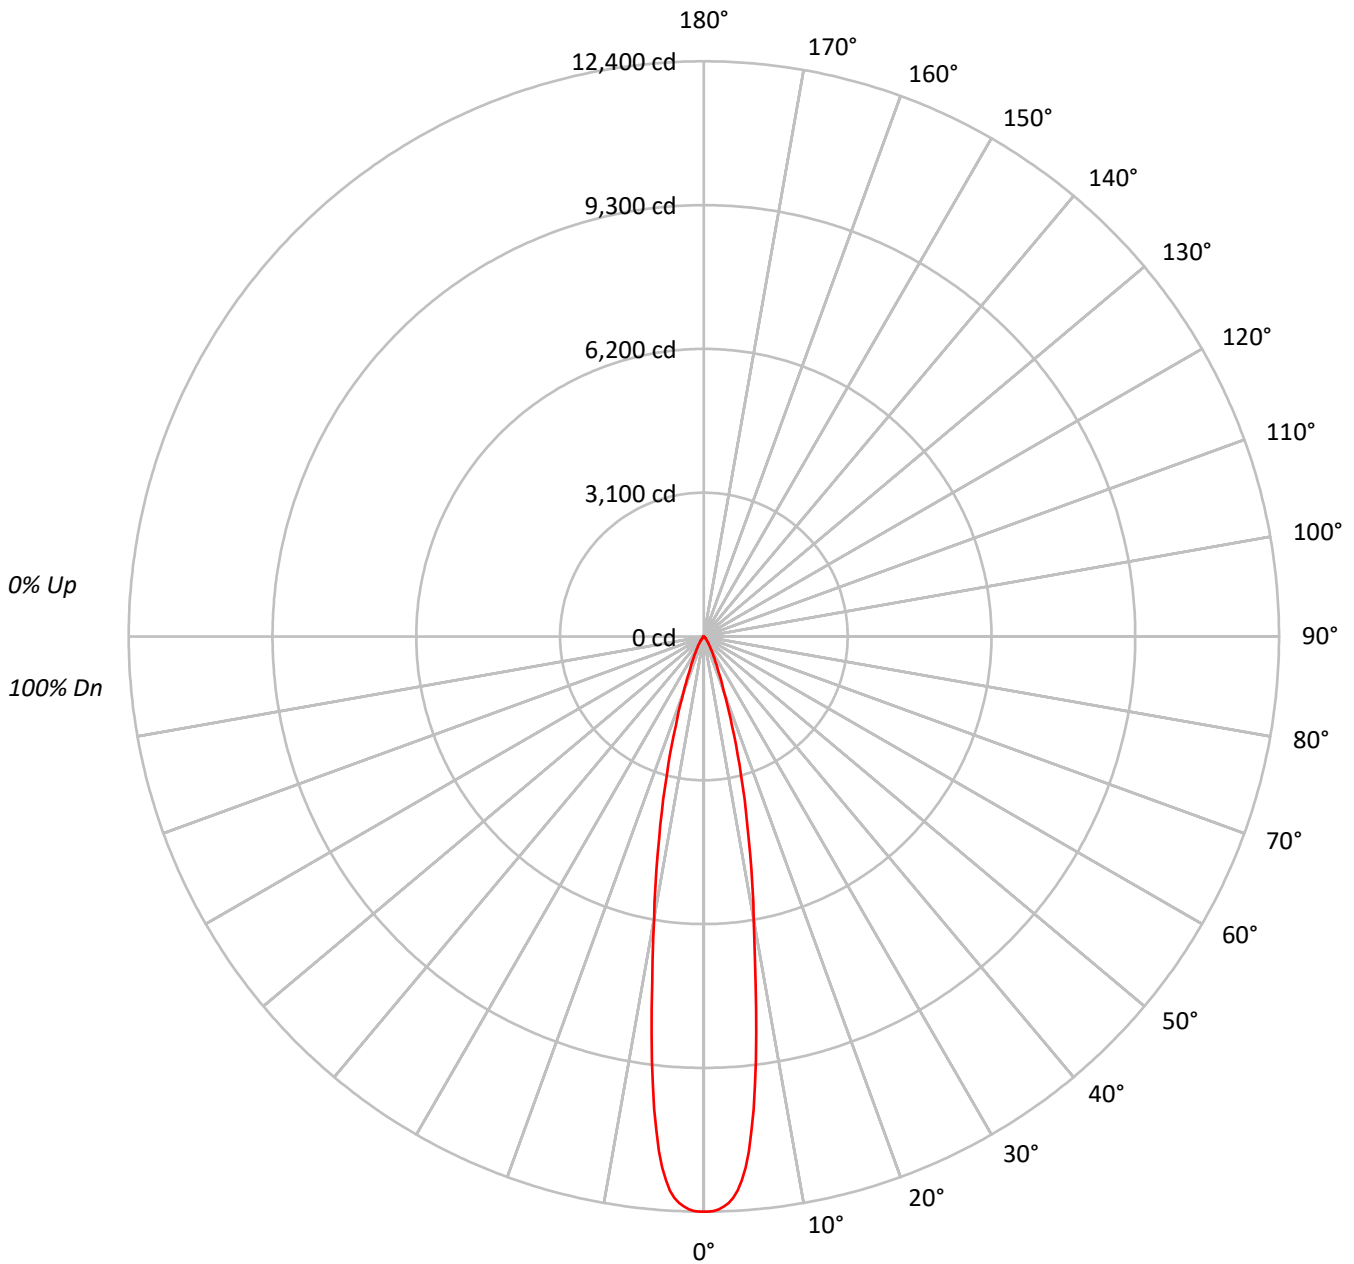



TEST NUMBER: P790120
 CATALOG NUMBER: LER6D20D010-EC6DR2015309050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	97																
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	94																
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	91																
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	89																
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	86																
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	84																
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	82																
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	80																
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	78																
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	76																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1354855
5°	1222330
10°	686036
15°	348722
20°	147643
25°	68162
30°	36083
35°	19447
40°	10398
45°	6150
50°	3570
55°	1886
60°	1202
65°	853
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6150 cd/sqm



TEST NUMBER: P790120

CATALOG NUMBER: LER6D20D010-EC6DR2015309050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	882.9	40.5
10°-20°	869.3	39.9
20°-30°	284.0	13.0
30°-40°	96.7	4.4
40°-50°	32.5	1.5
50°-60°	9.8	0.4
60°-70°	3.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2036.2	93.5
0°-40°	2132.9	97.9
0°-60°	2175.2	99.8
0°-90°	2178.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2178.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12400	
5°	11145	883
15°	3083	869
25°	565	284
35°	146	97
45°	40	33
55°	10	10
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P790120

CATALOG NUMBER: LER6D20D010-EC6DR2015309050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	12400.2
0.5°	12400.2
1°	12384.7
1.5°	12353.8
2°	12297.5
2.5°	12222.4
3°	12116.4
3.5°	11968.4
4°	11748.7
4.5°	11481.5
5°	11144.7
5.5°	10701.9
6°	10248.1
6.5°	9728.0
7°	9219.0
7.5°	8622.7
8°	8090.5
8.5°	7554.9
9°	7060.3
9.5°	6606.4
10°	6183.5
12.5°	4440.0
15°	3082.9
17.5°	2014.1
20°	1269.8
22.5°	822.6
25°	565.4
27.5°	397.5
30°	286.0
32.5°	205.4
35°	145.8
37.5°	101.6
40°	72.9
42.5°	53.0
45°	39.8
47.5°	30.9
50°	21.0
52.5°	13.3
55°	9.9
57.5°	7.7
60°	5.5
62.5°	4.4
65°	3.3



TEST NUMBER: P790120

CATALOG NUMBER: LER6D20D010-EC6DR2015309050-6LBDP1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		2.2
70°		1.1

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)