

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790536

Luminaire Tested: LER6D20D010-EC6DR6520359035-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P790536
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D20D010-EC6DR6520359035-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3096.2 lumens
Efficiency: N/A
Efficacy: 134.0 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P790536

CATALOG NUMBER: LER6D20D010-EC6DR6520359035-6LBDP1H

Luminous Intensity Polar Plot

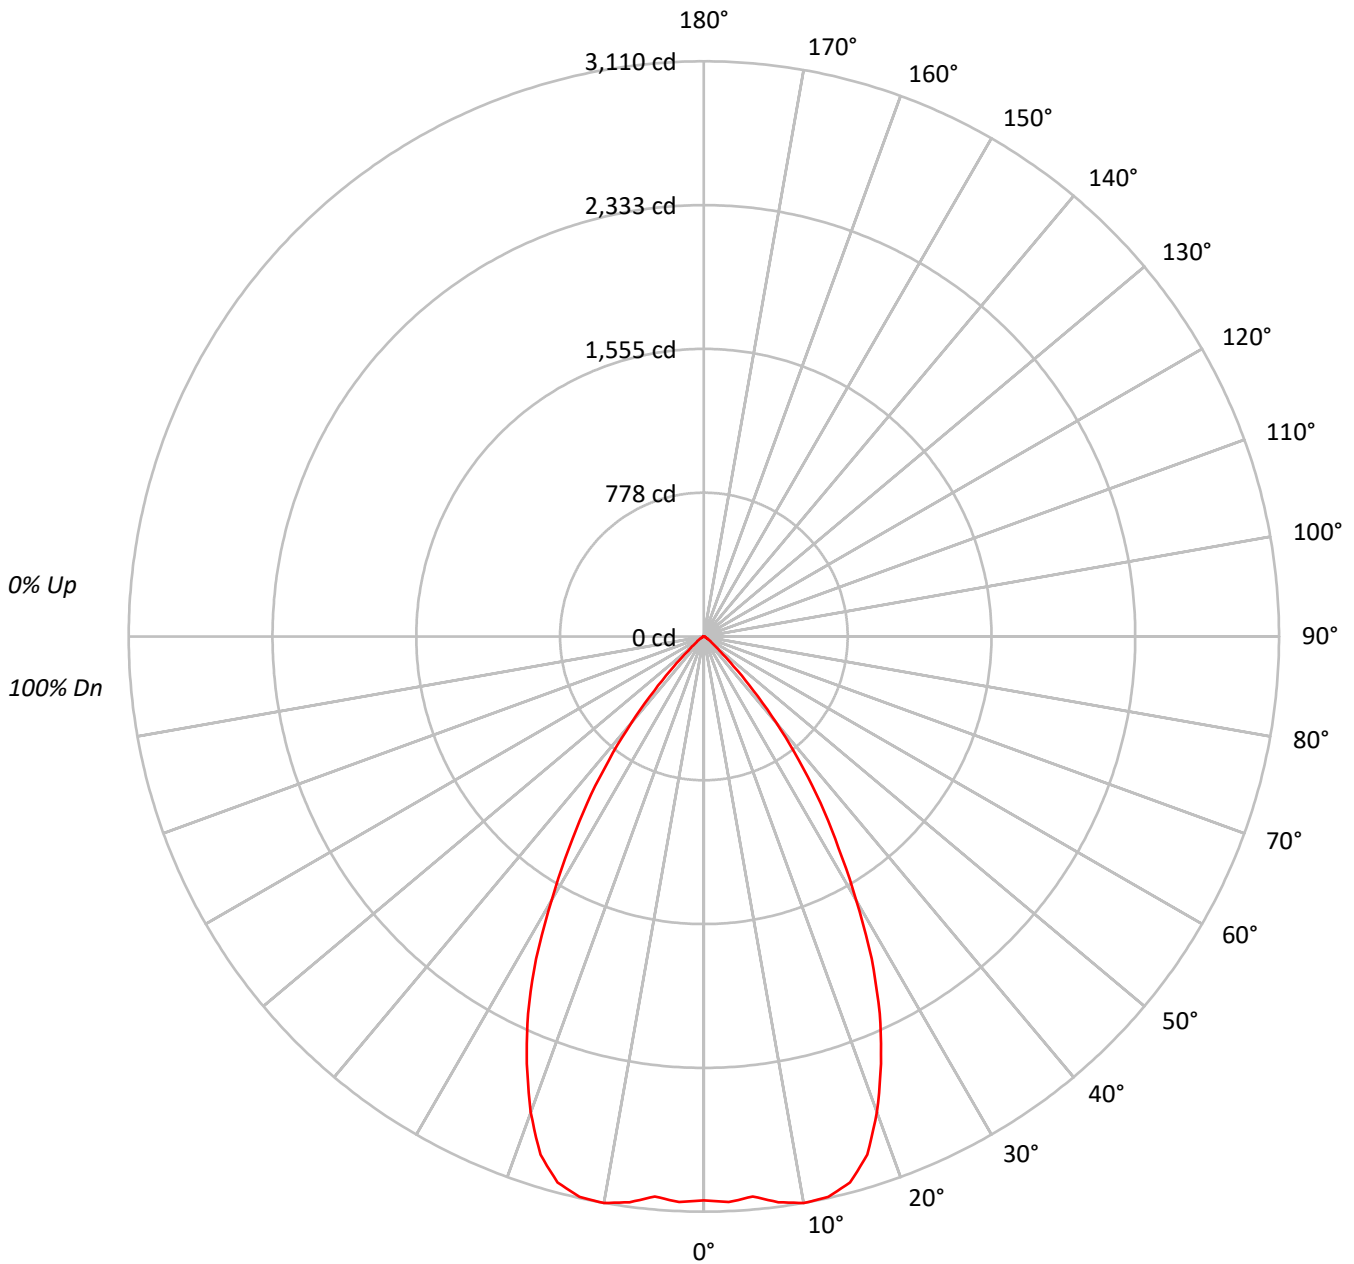



TEST NUMBER: P790536

CATALOG NUMBER: LER6D20D010-EC6DR6520359035-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	333070
5°	333345
10°	345076
15°	345657
20°	318227
25°	271142
30°	207577
35°	146641
40°	86562
45°	35137
50°	12731
55°	7105
60°	4065
65°	2249
70°	2364
75°	1815
80°	1888
85°	1630

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 35137 cd/sqm



TEST NUMBER: P790536

CATALOG NUMBER: LER6D20D010-EC6DR6520359035-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.5	9.5
10°-20°	846.7	27.3
20°-30°	1015.9	32.8
30°-40°	682.7	22.0
40°-50°	204.4	6.6
50°-60°	36.1	1.2
60°-70°	10.3	0.3
70°-80°	5.0	0.2
80°-90°	1.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2156.1	69.6
0°-40°	2838.8	91.7
0°-60°	3079.3	99.5
0°-90°	3096.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3096.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3048	
5°	3039	294
15°	3056	847
25°	2249	1016
35°	1099	683
45°	227	204
55°	37	36
65°	9	10
75°	4	5
85°	1	2
90°	0	



TEST NUMBER: P790536

CATALOG NUMBER: LER6D20D010-EC6DR6520359035-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	3048.4
2.5°	3061.4
5°	3039.3
7.5°	3085.2
10°	3110.3
12.5°	3104.3
15°	3055.8
17.5°	2937.1
20°	2736.9
22.5°	2501.3
25°	2249.1
27.5°	1964.5
30°	1645.3
32.5°	1355.9
35°	1099.4
37.5°	846.0
40°	606.9
42.5°	396.4
45°	227.4
47.5°	120.4
50°	74.9
52.5°	52.0
55°	37.3
57.5°	26.9
60°	18.6
62.5°	12.1
65°	8.7
67.5°	7.8
70°	7.4
72.5°	5.6
75°	4.3
77.5°	3.9
80°	3.0
82.5°	2.2
85°	1.3
87.5°	0.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)