

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790626

Luminaire Tested: LER6D25D010-EC6DR1515309030-6LBDP1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790626
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D25D010-EC6DR1515309030-6LBDDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2773.7 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P790626

CATALOG NUMBER: LER6D25D010-EC6DR1515309030-6LBDP1MW

Luminous Intensity Polar Plot

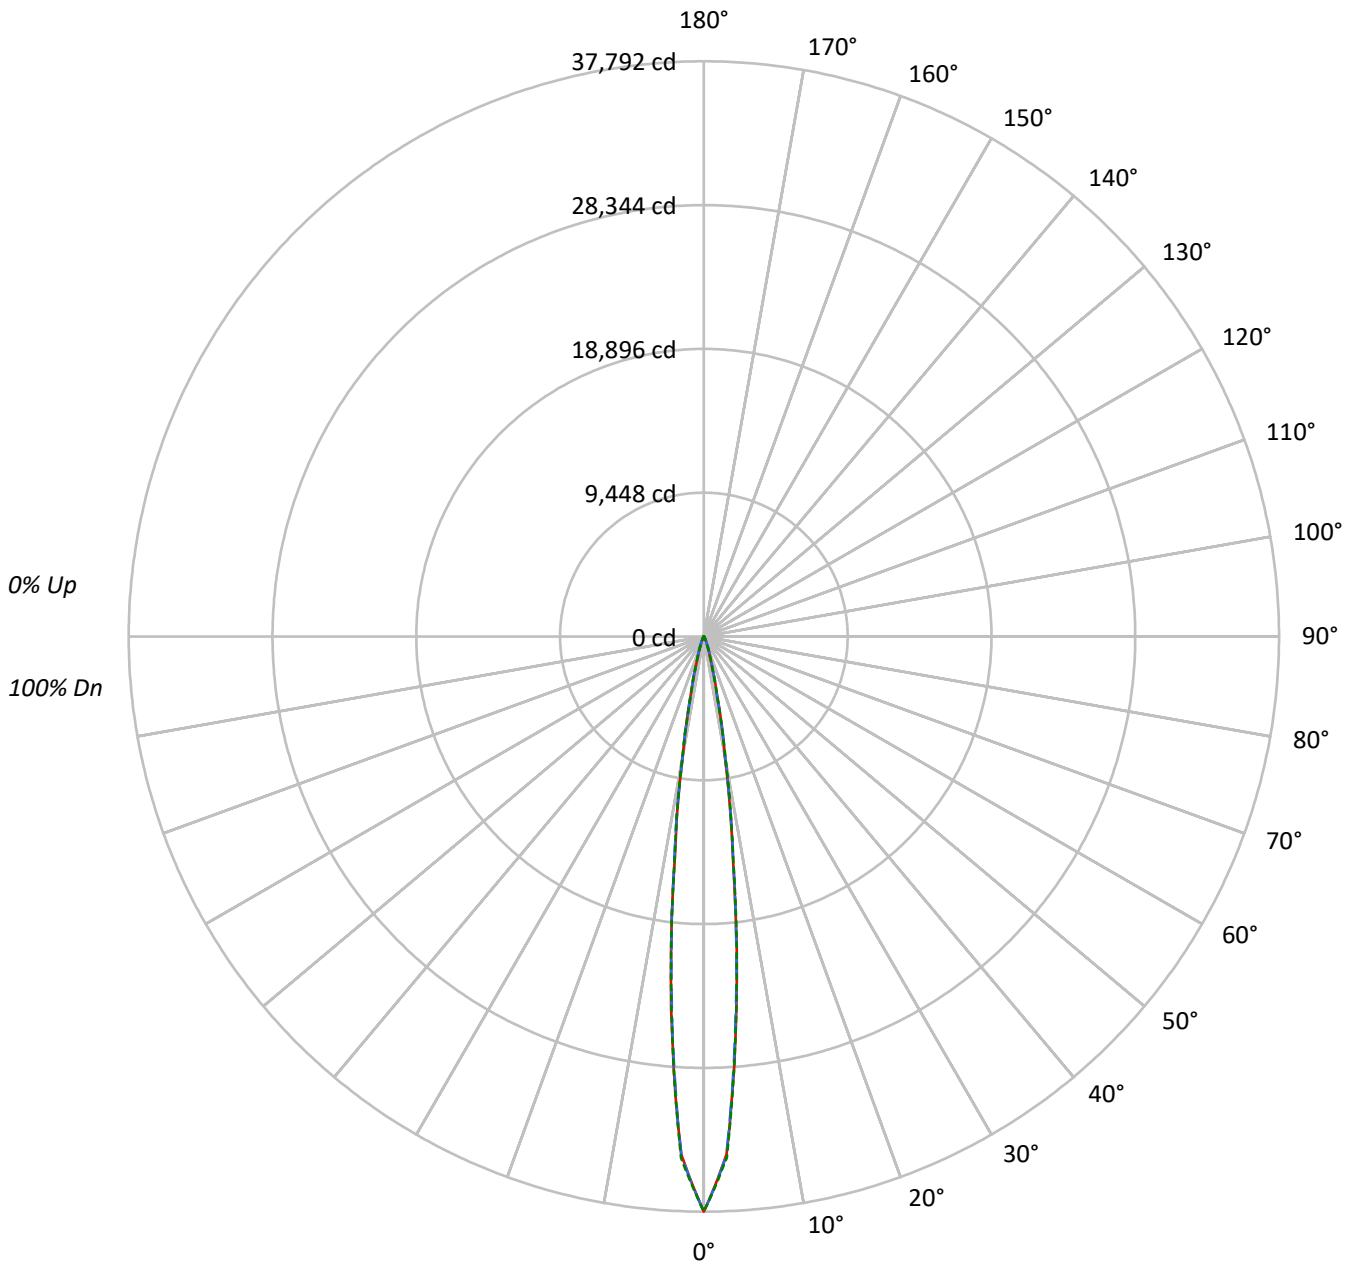



TEST NUMBER: P790626

CATALOG NUMBER: LER6D25D010-EC6DR1515309030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4252298	4252298	4252298
5°	2498851	2466493	2486006
10°	745789	751014	762510
15°	185509	189122	183285
20°	55500	64272	56679
25°	19569	24928	19818
30°	7189	9465	7308
35°	3602	4067	3486
40°	2272	2500	2272
45°	1680	1792	1680
50°	1335	1335	1335
55°	1114	1114	1114
60°	899	899	899
65°	685	685	685
70°	585	585	585
75°	363	363	484
80°	252	252	252
85°	133	133	133

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°
 Vertical Angle: 45°
 Luminance: 1792 cd/sqm



TEST NUMBER: P790626

CATALOG NUMBER: LER6D25D010-EC6DR1515309030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1798.9	64.9
10°-20°	740.0	26.7
20°-30°	147.0	5.3
30°-40°	36.7	1.3
40°-50°	19.3	0.7
50°-60°	14.3	0.5
60°-70°	10.1	0.4
70°-80°	5.7	0.2
80°-90°	1.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2685.9	96.8
0°-40°	2722.6	98.2
0°-60°	2756.2	99.4
0°-90°	2773.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2773.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	37792	37792	37792	37792	37792	
5°	24588	24335	24270	24438	24462	1796
15°	2136	2176	2177	2139	2110	732
25°	251	285	320	283	254	132
35°	50	53	56	53	48	34
45°	24	24	26	24	24	19
55°	16	16	16	16	16	14
65°	10	10	10	10	10	10
75°	5	5	5	5	6	6
85°	2	2	2	2	2	2
90°	0	0	0	0	0	



TEST NUMBER: P790626

CATALOG NUMBER: LER6D25D010-EC6DR1515309030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	37791.5	37791.5	37791.5	37791.5	37791.5
2.5°	34089.4	34118.2	34129.4	34163.0	34287.8
5°	24588.0	24335.2	24269.6	24437.6	24461.6
7.5°	14565.0	14616.2	14803.3	14844.9	14694.6
10°	7992.8	8058.4	8048.8	8106.4	8172.0
12.5°	4087.6	4036.4	4020.4	4086.0	3994.8
15°	2135.8	2175.8	2177.4	2139.0	2110.2
17.5°	1148.7	1195.1	1271.9	1209.5	1113.5
20°	678.3	719.9	785.5	734.3	692.7
22.5°	419.2	452.8	499.2	459.2	425.6
25°	251.2	284.8	320.0	283.2	254.4
27.5°	148.8	177.6	200.0	176.0	147.2
30°	96.0	112.0	126.4	110.4	97.6
32.5°	67.2	73.6	80.0	73.6	67.2
35°	49.6	52.8	56.0	52.8	48.0
37.5°	38.4	41.6	43.2	40.0	36.8
40°	32.0	33.6	35.2	33.6	32.0
42.5°	27.2	28.8	28.8	28.8	27.2
45°	24.0	24.0	25.6	24.0	24.0
47.5°	20.8	20.8	22.4	20.8	20.8
50°	19.2	19.2	19.2	19.2	19.2
52.5°	17.6	17.6	17.6	17.6	17.6
55°	16.0	16.0	16.0	16.0	16.0
57.5°	14.4	14.4	14.4	14.4	14.4
60°	12.8	12.8	12.8	12.8	12.8
62.5°	11.2	11.2	11.2	11.2	11.2
65°	9.6	9.6	9.6	9.6	9.6
67.5°	9.6	9.6	9.6	9.6	9.6
70°	8.0	8.0	8.0	8.0	8.0
72.5°	6.4	6.4	6.4	6.4	6.4
75°	4.8	4.8	4.8	4.8	6.4
77.5°	4.8	4.8	4.8	4.8	4.8
80°	3.2	3.2	3.2	3.2	3.2
82.5°	3.2	3.2	3.2	3.2	3.2
85°	1.6	1.6	1.6	1.6	1.6
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)