

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790648

Luminaire Tested: LER6D25D010-EC6DR1515309050-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790648
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D25D010-EC6DR1515309050-6LB DP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3070.1 lumens
Efficiency: N/A
Efficacy: 122.3 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P790648

CATALOG NUMBER: LER6D25D010-EC6DR1515309050-6LBDP1H

Luminous Intensity Polar Plot

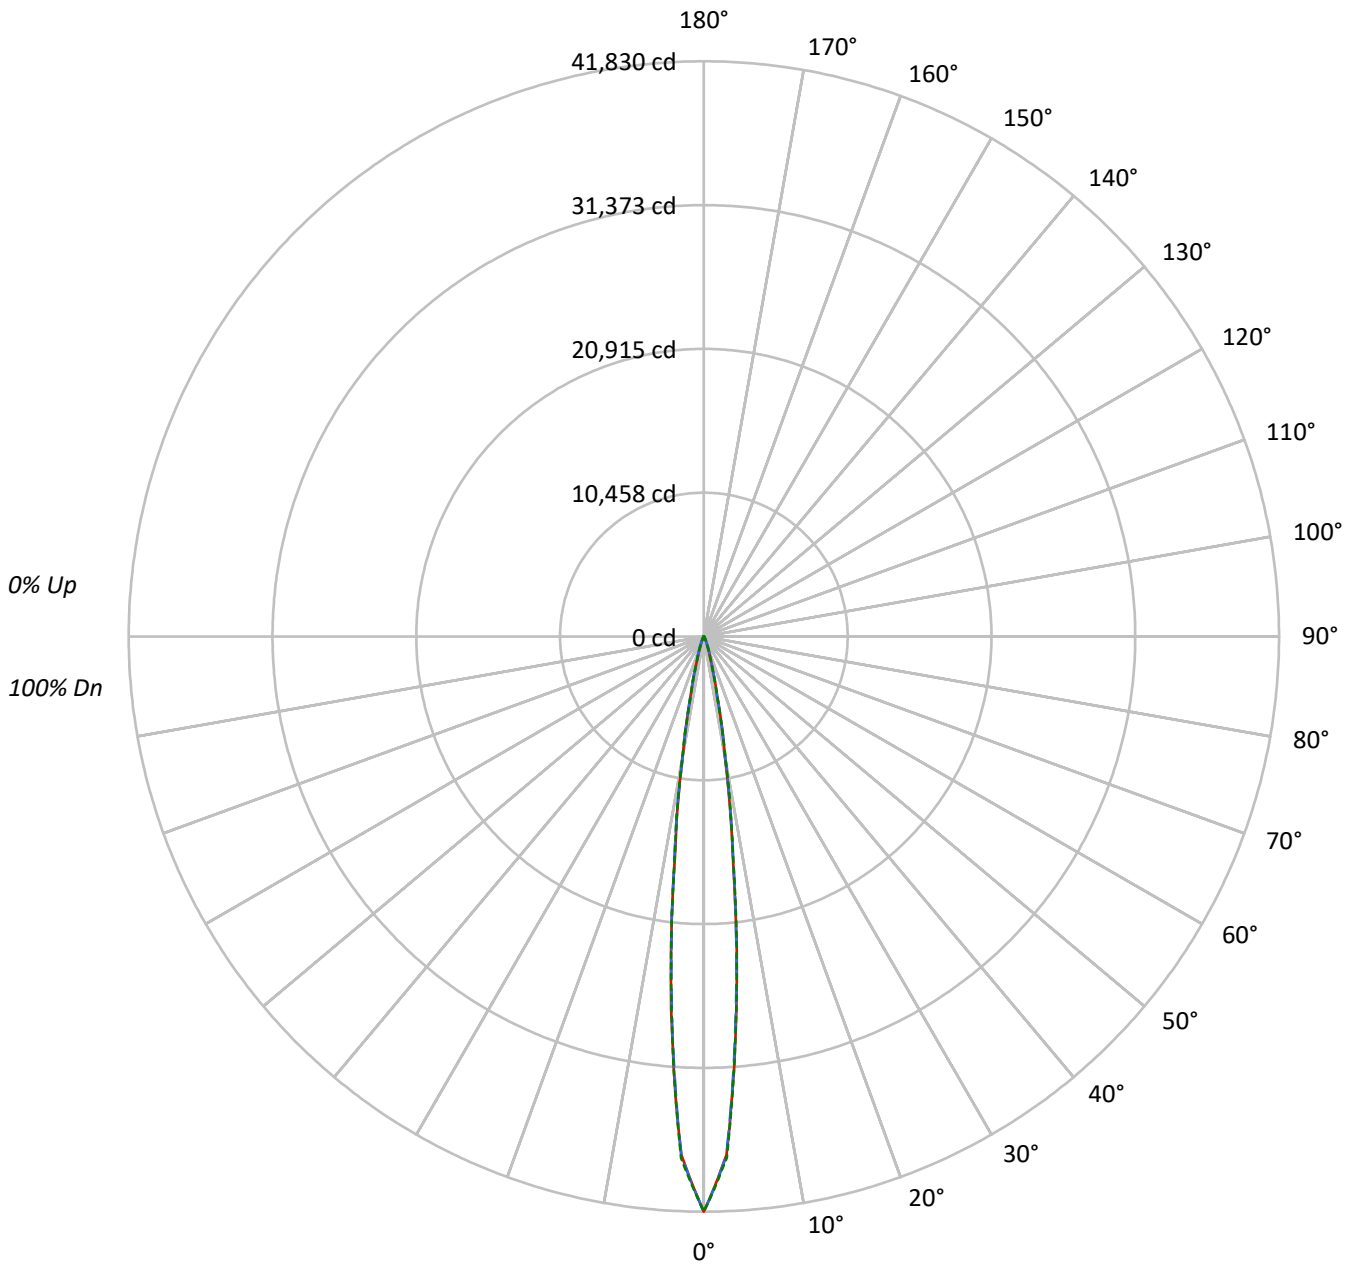



TEST NUMBER: P790648

CATALOG NUMBER: LER6D25D010-EC6DR1515309050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4706721	4706721	4706721
5°	2765892	2730078	2751674
10°	825492	831268	843995
15°	205330	209334	202872
20°	61433	71145	62742
25°	21656	27592	21937
30°	7952	10476	8087
35°	3987	4502	3856
40°	2514	2770	2514
45°	1862	1981	1862
50°	1474	1474	1474
55°	1232	1232	1232
60°	997	997	997
65°	757	757	757
70°	651	651	651
75°	401	401	537
80°	276	276	276
85°	149	149	149

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°
 Vertical Angle: 45°
 Luminance: 1981 cd/sqm



TEST NUMBER: P790648

CATALOG NUMBER: LER6D25D010-EC6DR1515309050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1991.2	64.9
10°-20°	819.0	26.7
20°-30°	162.7	5.3
30°-40°	40.6	1.3
40°-50°	21.3	0.7
50°-60°	15.8	0.5
60°-70°	11.2	0.4
70°-80°	6.4	0.2
80°-90°	1.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2972.9	96.8
0°-40°	3013.5	98.2
0°-60°	3050.7	99.4
0°-90°	3070.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3070.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	41830	41830	41830	41830	41830	
5°	27216	26936	26863	27049	27076	1987
15°	2364	2408	2410	2368	2336	811
25°	278	315	354	313	282	146
35°	55	58	62	58	53	37
45°	27	27	28	27	27	21
55°	18	18	18	18	18	16
65°	11	11	11	11	11	11
75°	5	5	5	5	7	6
85°	2	2	2	2	2	2
90°	0	0	0	0	0	



TEST NUMBER: P790648

CATALOG NUMBER: LER6D25D010-EC6DR1515309050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	41830.1	41830.1	41830.1	41830.1	41830.1
2.5°	37732.4	37764.3	37776.7	37813.9	37952.0
5°	27215.6	26935.8	26863.2	27049.1	27075.7
7.5°	16121.5	16178.1	16385.3	16431.4	16264.9
10°	8847.0	8919.6	8908.9	8972.7	9045.3
12.5°	4524.4	4467.8	4450.0	4522.7	4421.7
15°	2364.0	2408.3	2410.1	2367.6	2335.7
17.5°	1271.4	1322.8	1407.8	1338.7	1232.5
20°	750.8	796.9	869.5	812.8	766.8
22.5°	464.0	501.1	552.5	508.2	471.0
25°	278.0	315.2	354.2	313.4	281.6
27.5°	164.7	196.6	221.4	194.8	162.9
30°	106.2	124.0	139.9	122.2	108.0
32.5°	74.4	81.5	88.5	81.5	74.4
35°	54.9	58.4	62.0	58.4	53.1
37.5°	42.5	46.0	47.8	44.3	40.7
40°	35.4	37.2	39.0	37.2	35.4
42.5°	30.1	31.9	31.9	31.9	30.1
45°	26.6	26.6	28.3	26.6	26.6
47.5°	23.0	23.0	24.8	23.0	23.0
50°	21.2	21.2	21.2	21.2	21.2
52.5°	19.5	19.5	19.5	19.5	19.5
55°	17.7	17.7	17.7	17.7	17.7
57.5°	15.9	15.9	15.9	15.9	15.9
60°	14.2	14.2	14.2	14.2	14.2
62.5°	12.4	12.4	12.4	12.4	12.4
65°	10.6	10.6	10.6	10.6	10.6
67.5°	10.6	10.6	10.6	10.6	10.6
70°	8.9	8.9	8.9	8.9	8.9
72.5°	7.1	7.1	7.1	7.1	7.1
75°	5.3	5.3	5.3	5.3	7.1
77.5°	5.3	5.3	5.3	5.3	5.3
80°	3.5	3.5	3.5	3.5	3.5
82.5°	3.5	3.5	3.5	3.5	3.5
85°	1.8	1.8	1.8	1.8	1.8
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)