

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790897

Luminaire Tested: LER6D25D010-EC6DR4520359024-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P790897
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D25D010-EC6DR4520359024-6LBDDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4643.3 lumens
Efficiency: N/A
Efficacy: 185.0 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P790897

CATALOG NUMBER: LER6D25D010-EC6DR4520359024-6LBDP1LI

Luminous Intensity Polar Plot

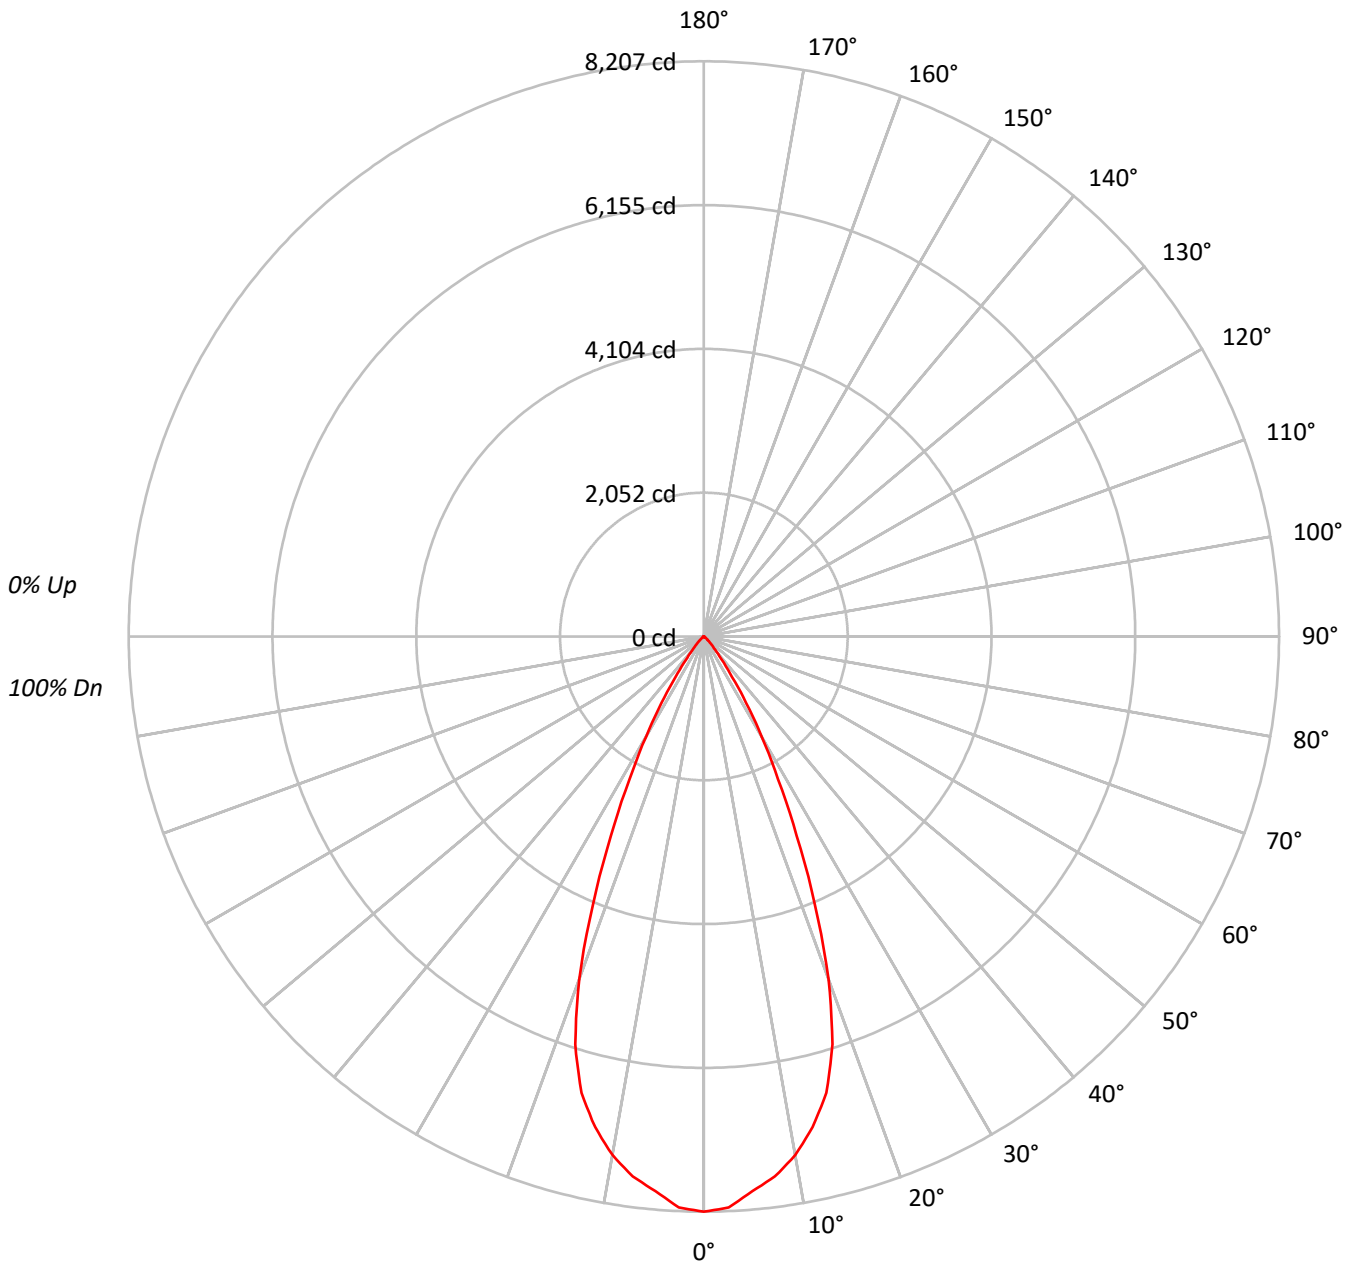



TEST NUMBER: P790897

CATALOG NUMBER: LER6D25D010-EC6DR4520359024-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	896714
5°	871184
10°	833495
15°	762814
20°	605177
25°	377822
30°	208245
35°	93501
40°	36827
45°	17352
50°	8227
55°	4305
60°	2120
65°	491
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 17352 cd/sqm



TEST NUMBER: P790897

CATALOG NUMBER: LER6D25D010-EC6DR4520359024-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	746.3	16.1
10°-20°	1836.8	39.6
20°-30°	1454.6	31.3
30°-40°	484.4	10.4
40°-50°	96.1	2.1
50°-60°	21.8	0.5
60°-70°	3.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4037.7	87.0
0°-40°	4522.1	97.4
0°-60°	4640.1	99.9
0°-90°	4643.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4643.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8207	
5°	7943	746
15°	6744	1837
25°	3134	1455
35°	701	484
45°	112	96
55°	23	22
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P790897

CATALOG NUMBER: LER6D25D010-EC6DR4520359024-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	8207.1
2.5°	8153.6
5°	7943.1
7.5°	7769.5
10°	7512.6
12.5°	7170.4
15°	6743.7
17.5°	6102.1
20°	5204.8
22.5°	4135.8
25°	3134.0
27.5°	2294.8
30°	1650.6
32.5°	1122.6
35°	701.0
37.5°	415.7
40°	258.2
42.5°	169.8
45°	112.3
47.5°	72.3
50°	48.4
52.5°	32.3
55°	22.6
57.5°	14.8
60°	9.7
62.5°	5.2
65°	1.9
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)