

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P790918

Luminaire Tested: LER6D25D010-EC6DR4520359030-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P790918  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D25D010-EC6DR4520359030-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5066.3 lumens  
Efficiency: N/A  
Efficacy: 201.8 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P790918

CATALOG NUMBER: LER6D25D010-EC6DR4520359030-6LBS1MW

### Luminous Intensity Polar Plot

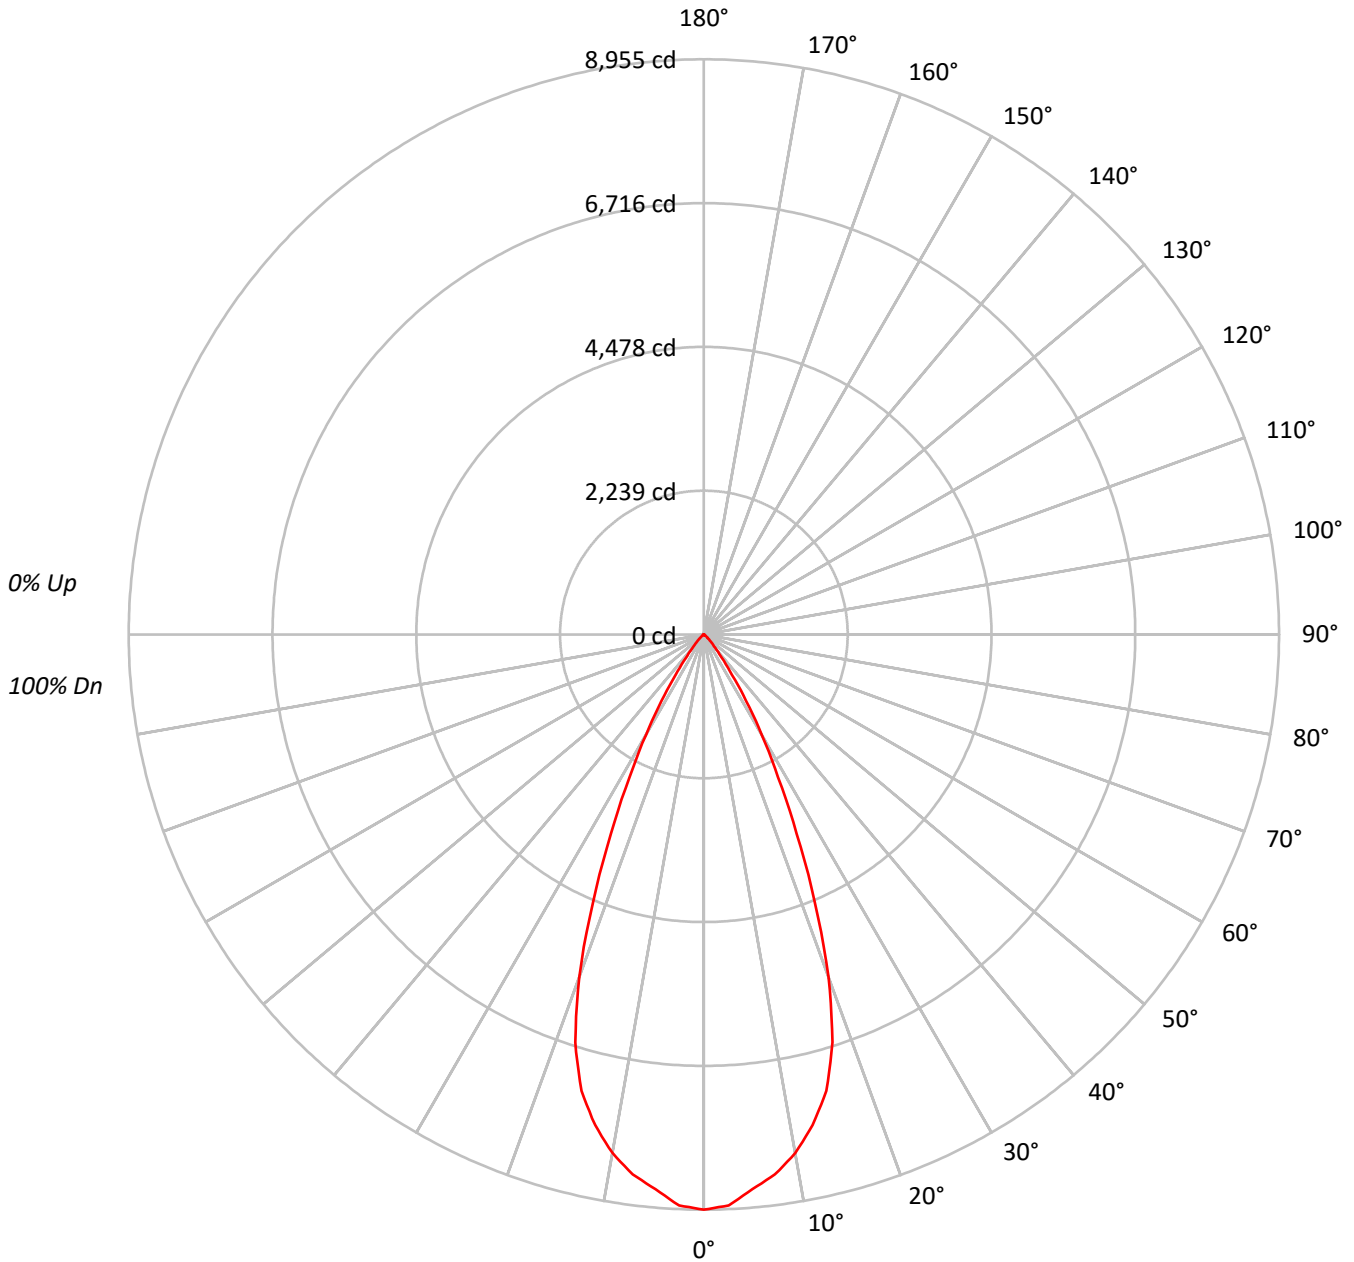



TEST NUMBER: P790918

CATALOG NUMBER: LER6D25D010-EC6DR4520359030-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	978408
5°	950547
10°	909416
15°	832312
20°	660314
25°	412241
30°	227220
35°	102024
40°	40179
45°	18944
50°	8975
55°	4705
60°	2316
65°	543
70°	224
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 18944 cd/sqm



TEST NUMBER: P790918

CATALOG NUMBER: LER6D25D010-EC6DR4520359030-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	814.3	16.1
10°-20°	2004.1	39.6
20°-30°	1587.1	31.3
30°-40°	528.5	10.4
40°-50°	104.9	2.1
50°-60°	23.8	0.5
60°-70°	3.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4405.5	87.0
0°-40°	4934.1	97.4
0°-60°	5062.8	99.9
0°-90°	5066.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5066.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	8955	
5°	8667	814
15°	7358	2004
25°	3420	1587
35°	765	529
45°	123	105
55°	25	24
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P790918

CATALOG NUMBER: LER6D25D010-EC6DR4520359030-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	8954.8
2.5°	8896.3
5°	8666.7
7.5°	8477.3
10°	8196.9
12.5°	7823.6
15°	7358.1
17.5°	6658.0
20°	5679.0
22.5°	4512.6
25°	3419.5
27.5°	2503.9
30°	1801.0
32.5°	1224.8
35°	764.9
37.5°	453.6
40°	281.7
42.5°	185.2
45°	122.6
47.5°	78.9
50°	52.8
52.5°	35.2
55°	24.7
57.5°	16.2
60°	10.6
62.5°	5.6
65°	2.1
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)