

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791155

Luminaire Tested: LER6D25D010-EC6DR7020359030-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791155
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D25D010-EC6DR7020359030-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4894.7 lumens
Efficiency: N/A
Efficacy: 195.0 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791155
CATALOG NUMBER: LER6D25D010-EC6DR7020359030-6LBS1B

Luminous Intensity Polar Plot

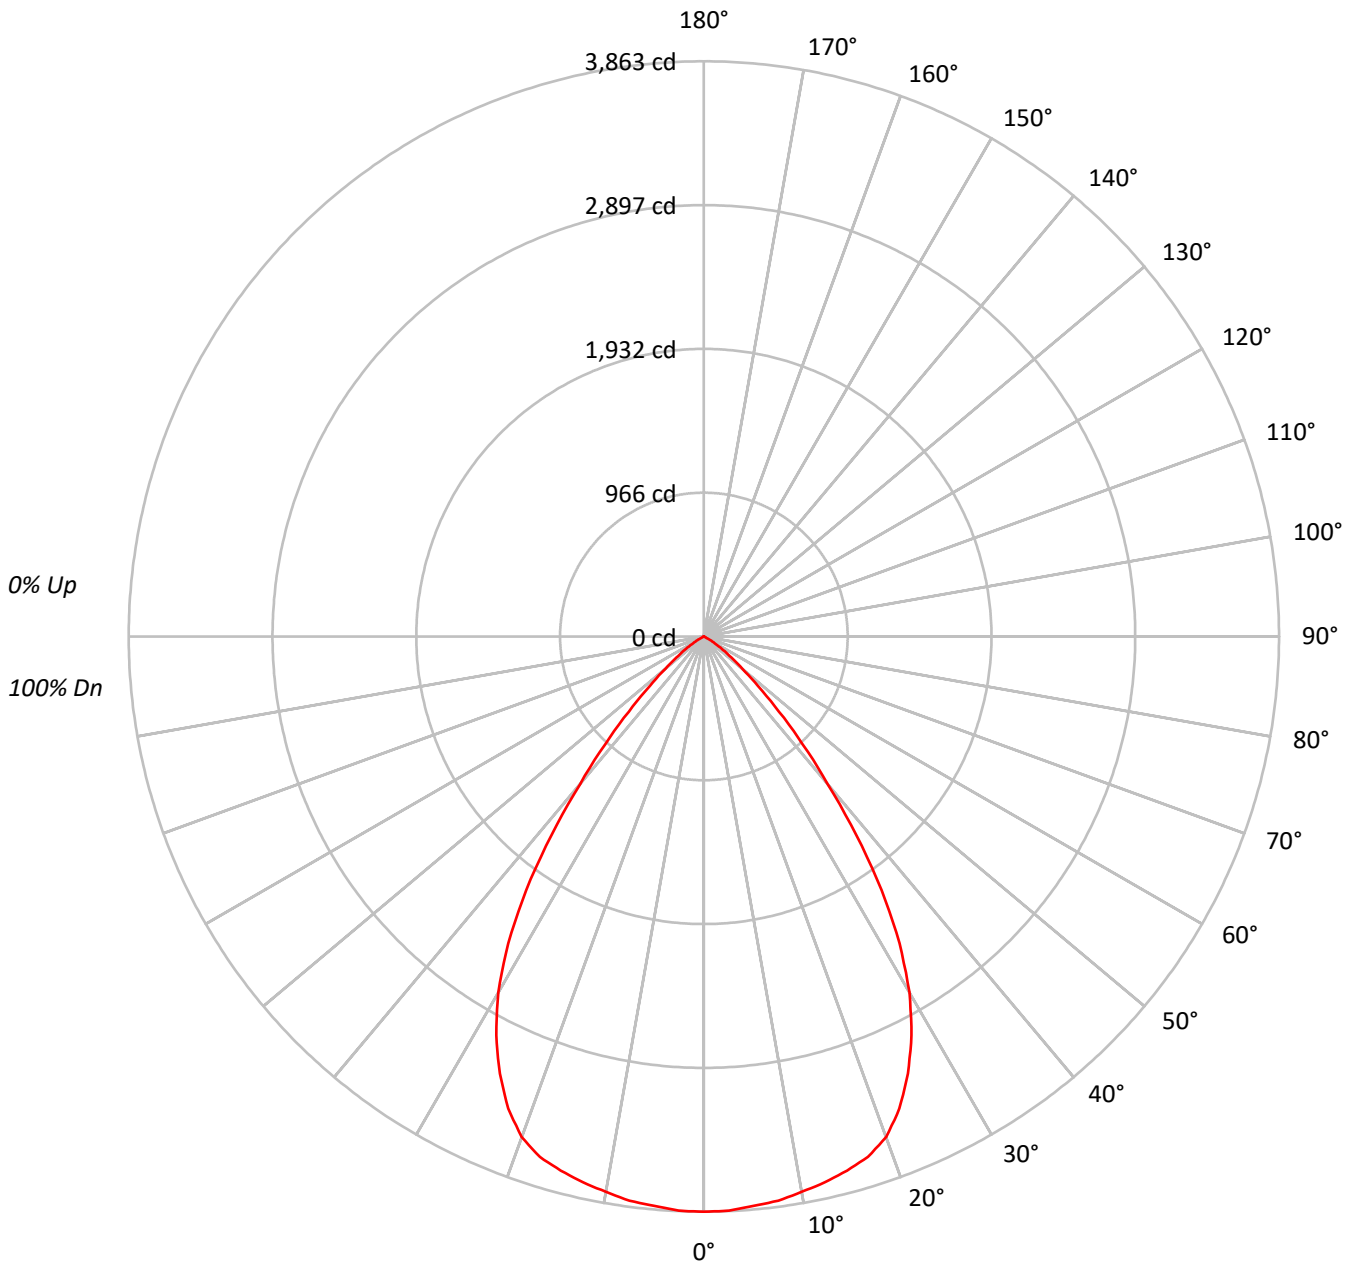



TEST NUMBER: P791155

CATALOG NUMBER: LER6D25D010-EC6DR7020359030-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78	78	78	78
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65	65	65	65
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60	60	60	60
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56	56	56	56
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48	48	48	48
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44	44	44	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	422107
5°	421054
10°	420142
15°	420030
20°	415920
25°	390710
30°	348312
35°	277716
40°	184406
45°	110249
50°	57147
55°	30040
60°	10620
65°	181
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 110249 cd/sqm



TEST NUMBER: P791155

CATALOG NUMBER: LER6D25D010-EC6DR7020359030-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.1	7.5
10°-20°	1047.1	21.4
20°-30°	1477.1	30.2
30°-40°	1275.1	26.1
40°-50°	571.0	11.7
50°-60°	149.5	3.1
60°-70°	9.7	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2889.3	59.0
0°-40°	4164.4	85.1
0°-60°	4885.0	99.8
0°-90°	4894.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4894.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3863	
5°	3839	365
15°	3713	1047
25°	3241	1477
35°	2082	1275
45°	714	571
55°	158	149
65°	1	10
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791155

CATALOG NUMBER: LER6D25D010-EC6DR7020359030-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	3863.3
2.5°	3859.2
5°	3839.0
7.5°	3822.3
10°	3786.9
12.5°	3755.0
15°	3713.3
17.5°	3665.3
20°	3577.1
22.5°	3431.9
25°	3240.9
27.5°	3019.2
30°	2760.8
32.5°	2444.7
35°	2082.1
37.5°	1681.9
40°	1292.9
42.5°	982.3
45°	713.5
47.5°	491.9
50°	336.2
52.5°	232.0
55°	157.7
57.5°	95.2
60°	48.6
62.5°	15.3
65°	0.7
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)