

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791248

Luminaire Tested: LER6D30D010-EC6DR2015309030-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791248
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D30D010-EC6DR2015309030-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3377.2 lumens
Efficiency: N/A
Efficacy: 116.5 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 29
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791248
CATALOG NUMBER: LER6D30D010-EC6DR2015309030-6LBDP1H

Luminous Intensity Polar Plot

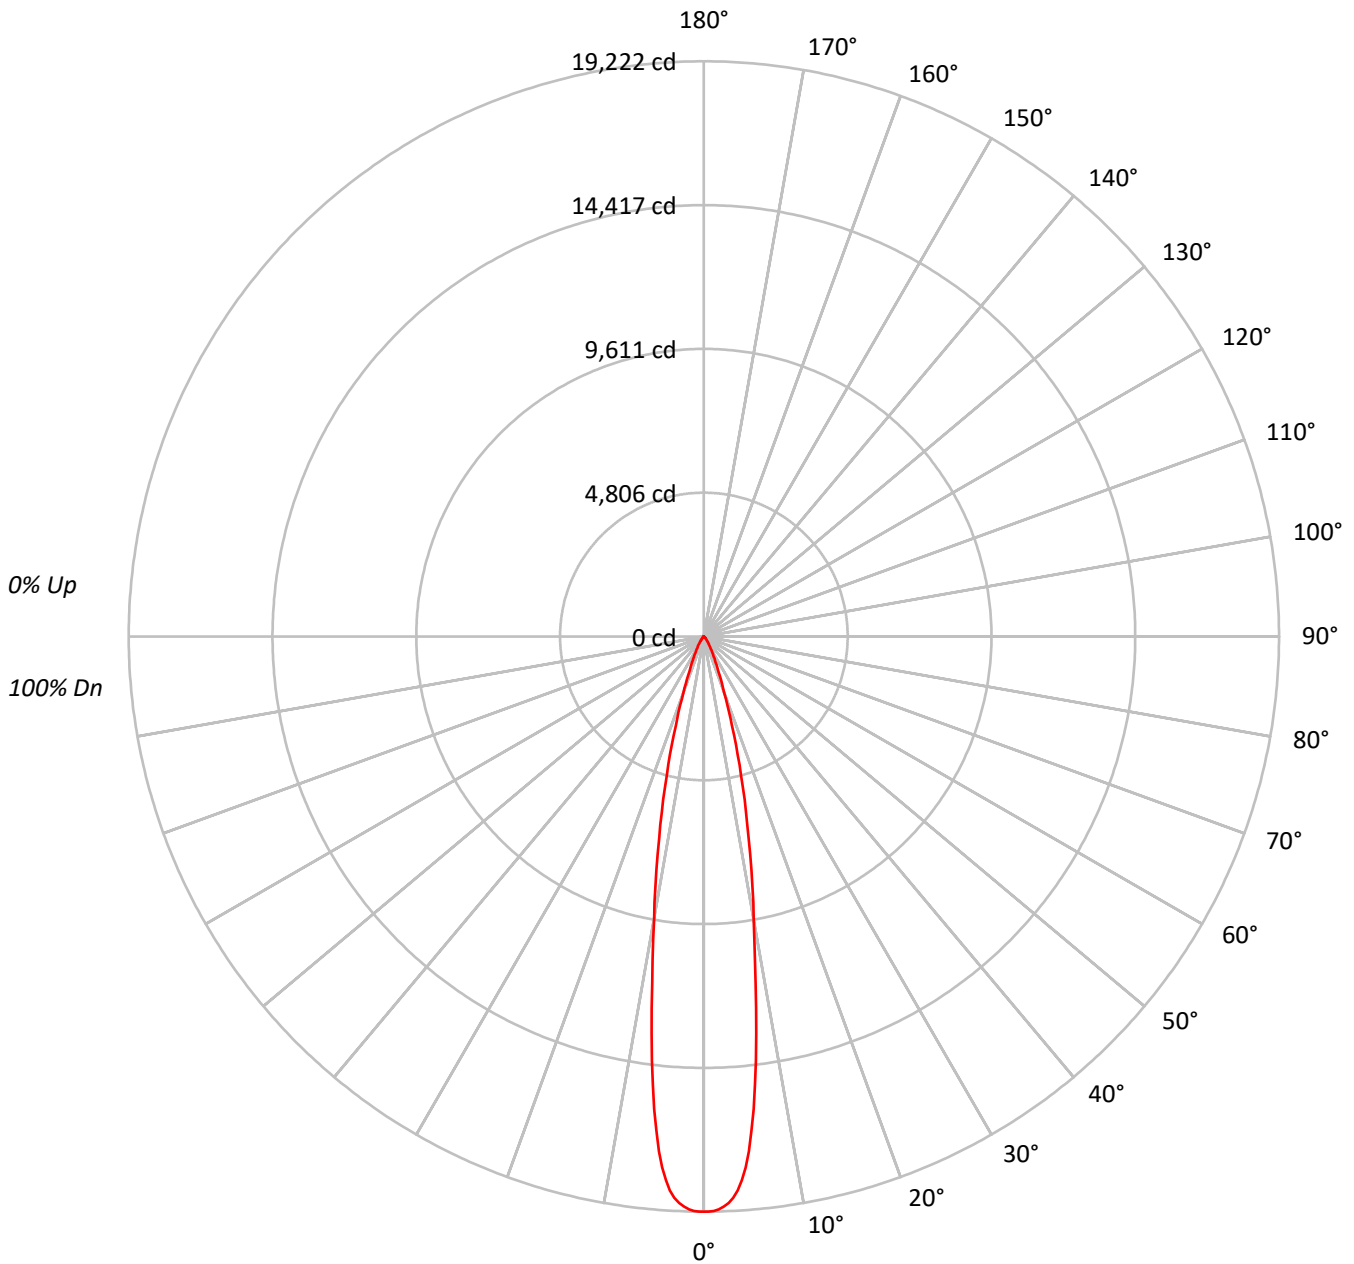



TEST NUMBER: P791248

CATALOG NUMBER: LER6D30D010-EC6DR2015309030-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	96	95															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	96	94	93															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	94	92	91															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	92	90	89															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	90	88	87															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	88	86	85															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	86	84	83															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	84	82	81															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2100243
5°	1894810
10°	1063476
15°	540577
20°	228872
25°	105655
30°	55928
35°	30131
40°	16117
45°	9518
50°	5524
55°	2934
60°	1879
65°	1319
70°	543
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9518 cd/sqm



TEST NUMBER: P791248

CATALOG NUMBER: LER6D30D010-EC6DR2015309030-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1368.6	40.5
10°-20°	1347.6	39.9
20°-30°	440.2	13.0
30°-40°	149.9	4.4
40°-50°	50.4	1.5
50°-60°	15.2	0.4
60°-70°	5.0	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3156.5	93.5
0°-40°	3306.4	97.9
0°-60°	3371.9	99.8
0°-90°	3377.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3377.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19222	
5°	17276	###
15°	4779	1348
25°	876	440
35°	226	150
45°	62	50
55°	15	15
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791248
CATALOG NUMBER: LER6D30D010-EC6DR2015309030-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	19222.3
0.5°	19222.3
1°	19198.3
1.5°	19150.4
2°	19063.1
2.5°	18946.7
3°	18782.4
3.5°	18553.0
4°	18212.4
4.5°	17798.2
5°	17276.1
5.5°	16589.7
6°	15886.2
6.5°	15080.0
7°	14290.9
7.5°	13366.6
8°	12541.6
8.5°	11711.4
9°	10944.6
9.5°	10241.1
10°	9585.5
12.5°	6882.7
15°	4779.0
17.5°	3122.1
20°	1968.4
22.5°	1275.2
25°	876.4
27.5°	616.2
30°	443.3
32.5°	318.4
35°	225.9
37.5°	157.5
40°	113.0
42.5°	82.2
45°	61.6
47.5°	47.9
50°	32.5
52.5°	20.5
55°	15.4
57.5°	12.0
60°	8.6
62.5°	6.8
65°	5.1



TEST NUMBER: P791248
CATALOG NUMBER: LER6D30D010-EC6DR2015309030-6LBDP1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°	3.4
70°	1.7

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)