

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791577

Luminaire Tested: LER6D30D010-EC6DR5520359027-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791577
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D30D010-EC6DR5520359027-6LBDDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5784.0 lumens
Efficiency: N/A
Efficacy: 199.4 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 29
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791577
CATALOG NUMBER: LER6D30D010-EC6DR5520359027-6LBDP1LI

Luminous Intensity Polar Plot

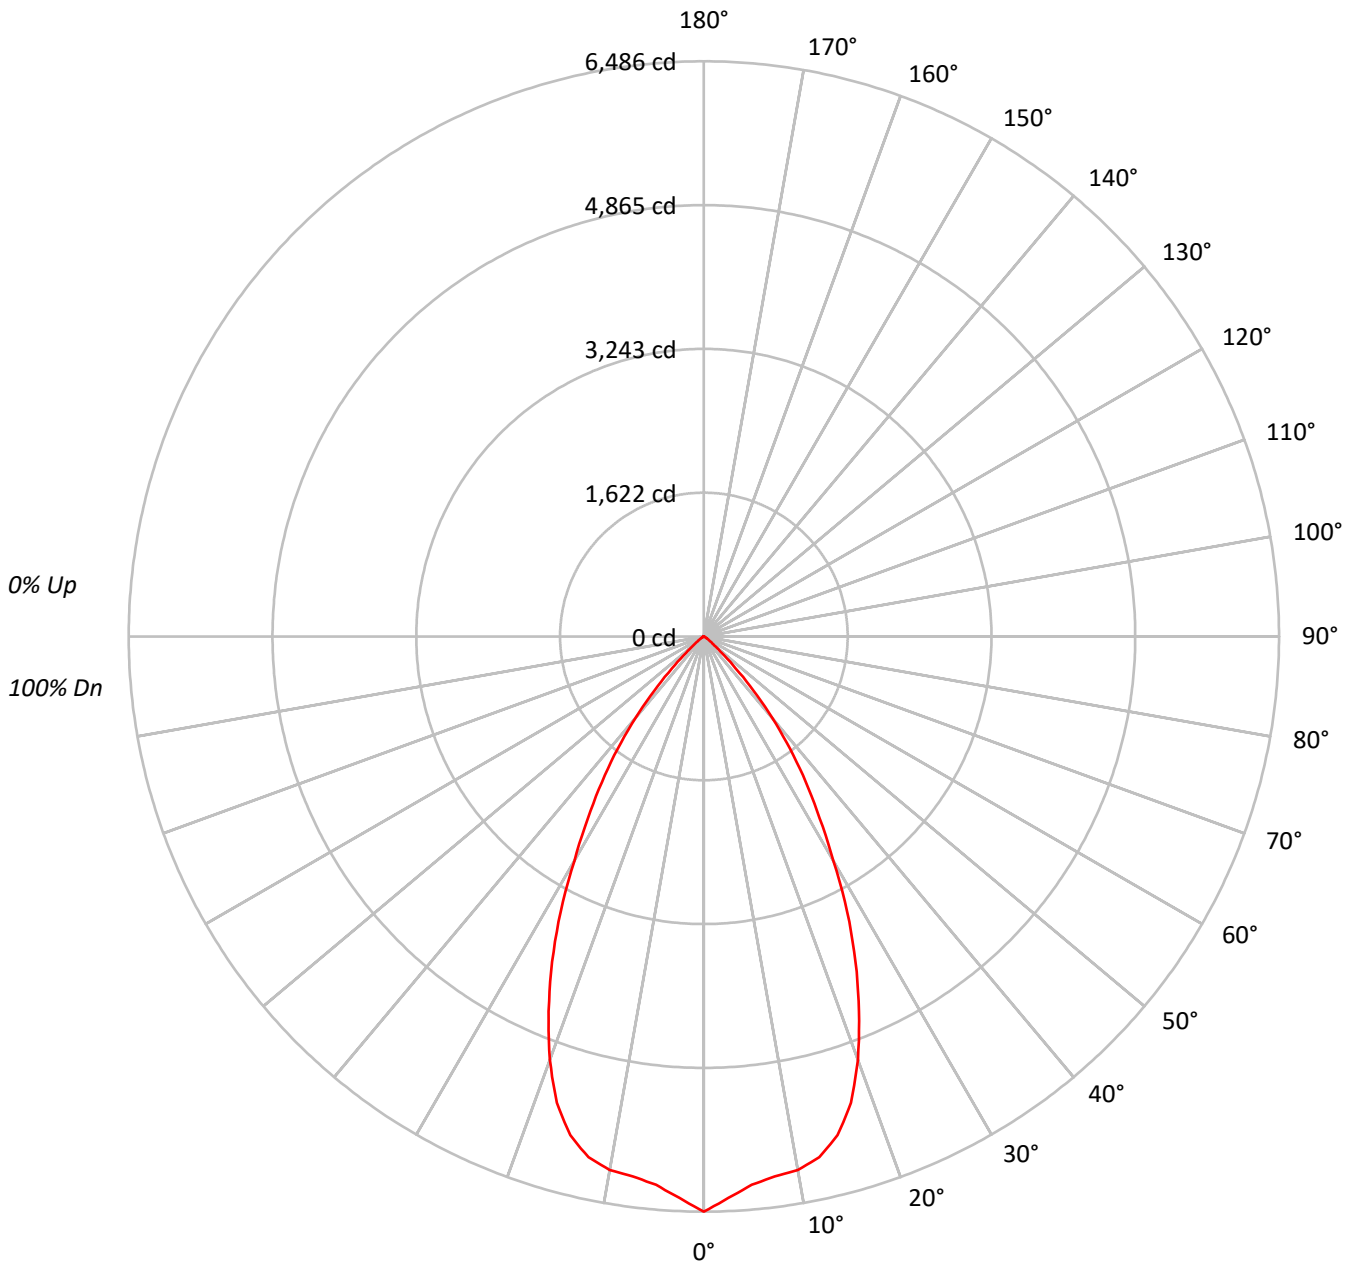



TEST NUMBER: P791577

CATALOG NUMBER: LER6D30D010-EC6DR5520359027-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	708654
5°	680509
10°	677948
15°	658477
20°	590410
25°	487950
30°	368587
35°	267246
40°	171027
45°	78109
50°	25548
55°	11029
60°	4742
65°	620
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 78109 cd/sqm



TEST NUMBER: P791577

CATALOG NUMBER: LER6D30D010-EC6DR5520359027-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	590.4	10.2
10°-20°	1611.3	27.9
20°-30°	1836.2	31.7
30°-40°	1250.0	21.6
40°-50°	430.7	7.4
50°-60°	59.6	1.0
60°-70°	5.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4038.0	69.8
0°-40°	5288.0	91.4
0°-60°	5778.3	99.9
0°-90°	5784.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5784.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6486	
5°	6205	590
15°	5821	1611
25°	4048	1836
35°	2004	1250
45°	506	431
55°	58	60
65°	2	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791577

CATALOG NUMBER: LER6D30D010-EC6DR5520359027-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	6485.9
2.5°	6337.2
5°	6204.6
7.5°	6139.5
10°	6110.6
12.5°	6014.1
15°	5821.3
17.5°	5515.0
20°	5077.8
22.5°	4573.1
25°	4047.5
27.5°	3500.1
30°	2921.5
32.5°	2431.2
35°	2003.6
37.5°	1597.0
40°	1199.1
42.5°	831.0
45°	505.5
47.5°	272.5
50°	150.3
52.5°	89.2
55°	57.9
57.5°	37.0
60°	21.7
62.5°	9.6
65°	2.4
67.5°	0.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)