

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791632

Luminaire Tested: LER6D30D010-EC6DR6020359030-6LBDP1H

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P791632  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D30D010-EC6DR6020359030-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5578.2 lumens  
Efficiency: N/A  
Efficacy: 192.4 lumens/watt  
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 29  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P791632  
CATALOG NUMBER: LER6D30D010-EC6DR6020359030-6LBDP1H

### Luminous Intensity Polar Plot

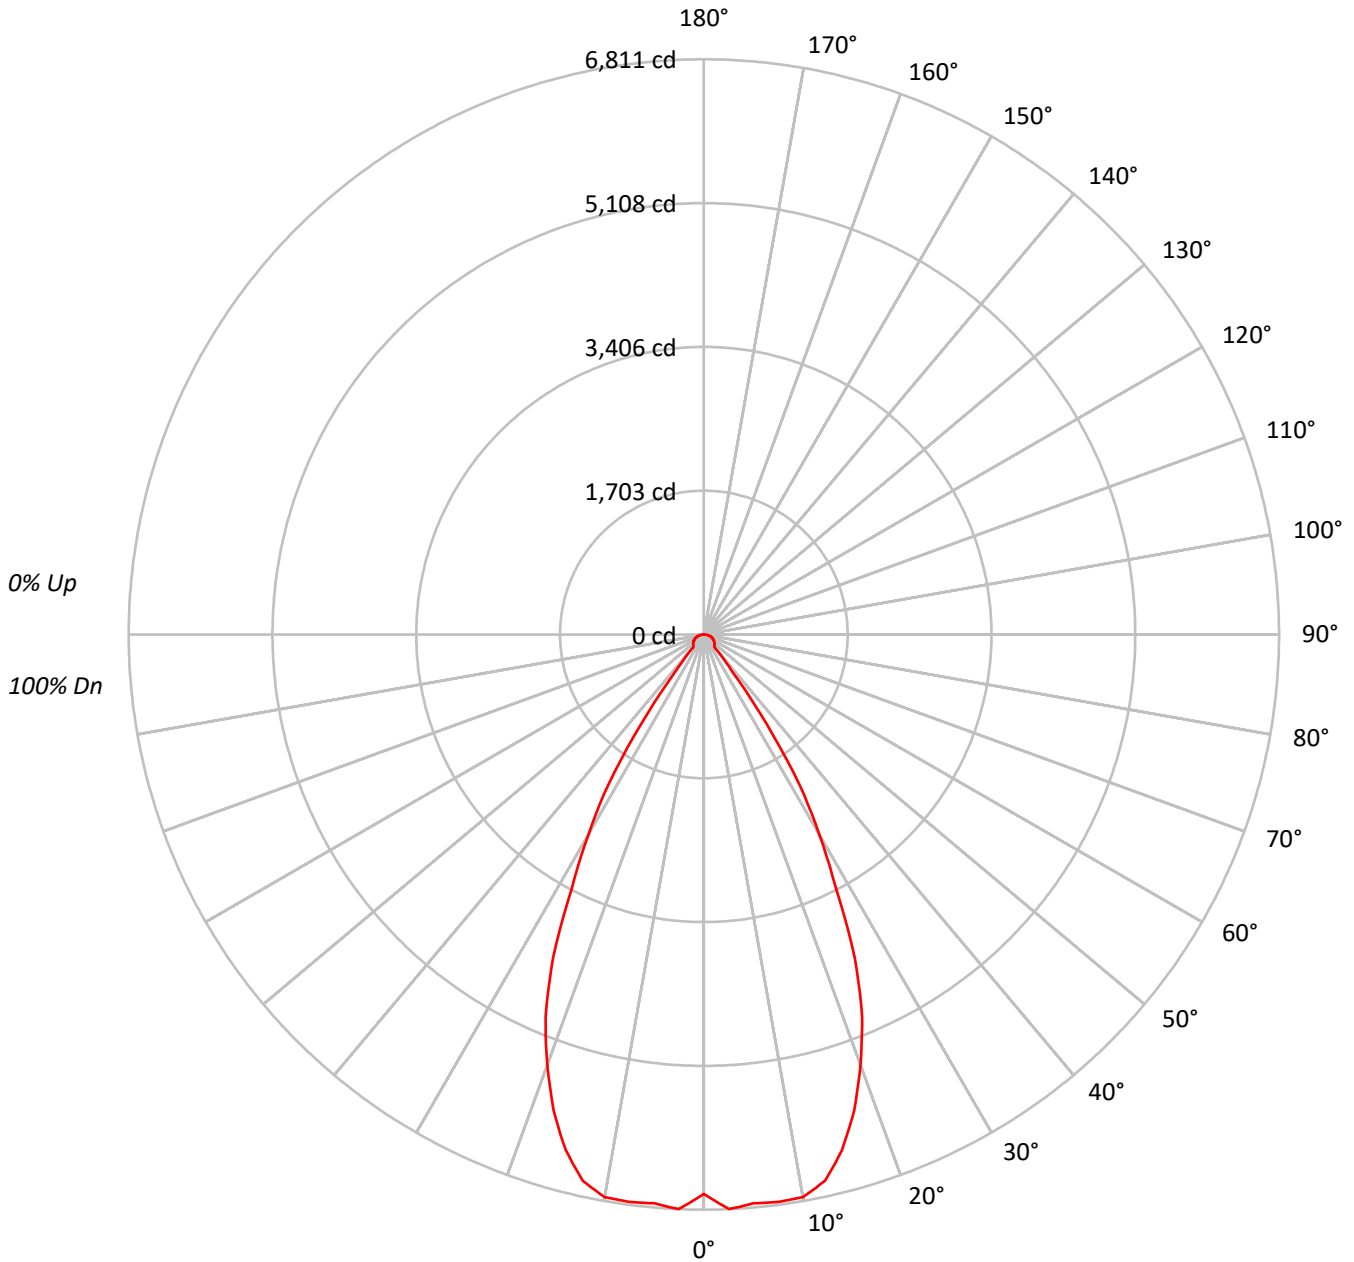



TEST NUMBER: P791632

CATALOG NUMBER: LER6D30D010-EC6DR6020359030-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93																
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86																
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80																
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75																
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70																
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66																
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62																
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59																
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55																
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	723842
5°	741643
10°	750596
15°	715046
20°	630455
25°	509927
30°	344918
35°	172837
40°	28041
45°	27442
50°	27996
55°	28421
60°	29194
65°	29861
70°	30572
75°	30944
80°	29824
85°	24822

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 75°  
 Luminance: 30944 cd/sqm



TEST NUMBER: P791632

CATALOG NUMBER: LER6D30D010-EC6DR6020359030-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	646.3	11.6
10°-20°	1748.5	31.3
20°-30°	1881.3	33.7
30°-40°	817.7	14.7
40°-50°	137.4	2.5
50°-60°	133.6	2.4
60°-70°	114.2	2.0
70°-80°	76.4	1.4
80°-90°	22.8	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4276.1	76.7
0°-40°	5093.8	91.3
0°-60°	5364.8	96.2
0°-90°	5578.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5578.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	6625	
5°	6762	646
15°	6321	1749
25°	4230	1881
35°	1296	818
45°	178	137
55°	149	134
65°	116	114
75°	73	76
85°	20	23
90°	0	



TEST NUMBER: P791632

CATALOG NUMBER: LER6D30D010-EC6DR6020359030-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	6624.9
2.5°	6811.1
5°	6762.0
7.5°	6777.5
10°	6765.4
12.5°	6625.7
15°	6321.4
17.5°	5912.7
20°	5422.2
22.5°	4897.1
25°	4229.8
27.5°	3383.1
30°	2733.9
32.5°	2107.1
35°	1295.8
37.5°	554.4
40°	196.6
42.5°	181.1
45°	177.6
47.5°	171.6
50°	164.7
52.5°	156.9
55°	149.2
57.5°	141.4
60°	133.6
62.5°	125.0
65°	115.5
67.5°	106.0
70°	95.7
72.5°	84.5
75°	73.3
77.5°	60.4
80°	47.4
82.5°	33.6
85°	19.8
87.5°	6.9
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)