

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791677

Luminaire Tested: LER6D30D010-EC6DR6520359027-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791677
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D30D010-EC6DR6520359027-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5217.3 lumens
Efficiency: N/A
Efficacy: 179.9 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 29
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791677
CATALOG NUMBER: LER6D30D010-EC6DR6520359027-6LBS1LI

Luminous Intensity Polar Plot

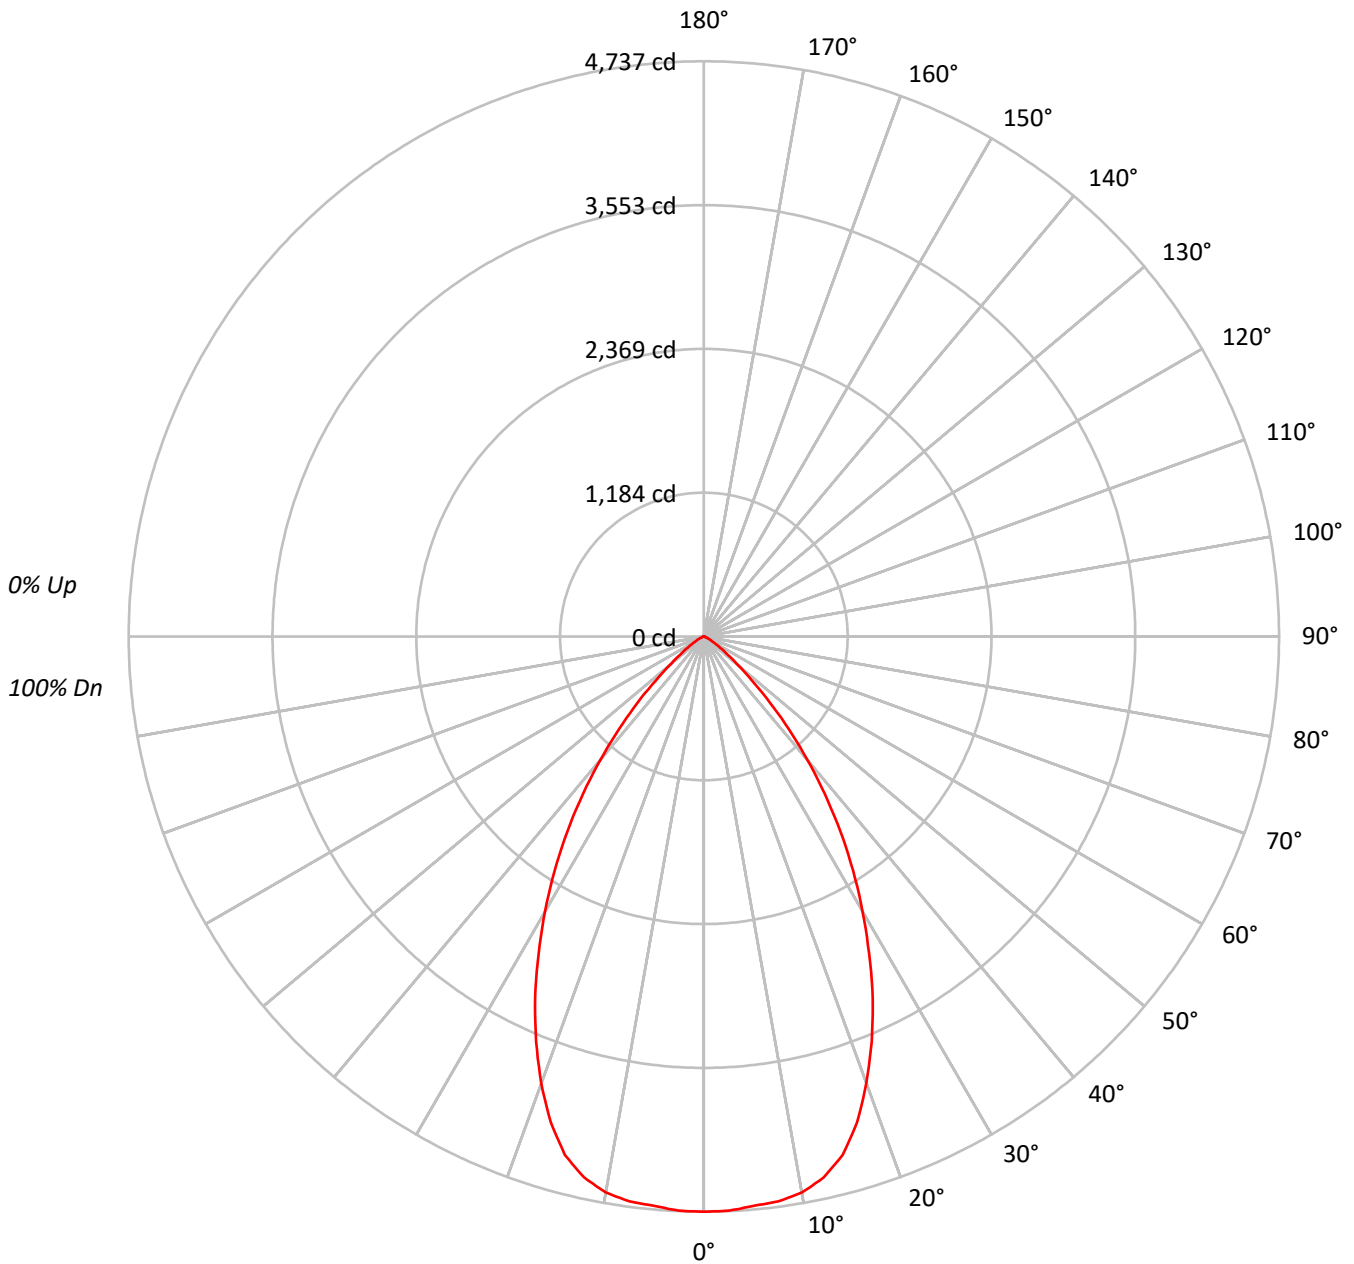



TEST NUMBER: P791677

CATALOG NUMBER: LER6D30D010-EC6DR6520359027-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93																
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85																
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78																
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72																
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66																
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61																
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56																
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52																
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49																
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	276671
5°	275969
10°	275738
15°	267233
20°	243282
25°	212006
30°	176333
35°	139715
40°	100844
45°	63706
50°	33209
55°	17646
60°	9275
65°	5099
70°	2135
75°	2347
80°	1648
85°	1407

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 63706 cd/sqm



TEST NUMBER: P791677

CATALOG NUMBER: LER6D30D010-EC6DR6520359027-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	448.0	8.6
10°-20°	1226.8	23.5
20°-30°	1499.5	28.7
30°-40°	1216.7	23.3
40°-50°	606.3	11.6
50°-60°	169.1	3.2
60°-70°	38.4	0.7
70°-80°	10.0	0.2
80°-90°	2.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3174.2	60.8
0°-40°	4390.9	84.2
0°-60°	5166.3	99.0
0°-90°	5217.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5217.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4737	
5°	4707	448
15°	4420	1227
25°	3290	1500
35°	1960	1217
45°	771	606
55°	173	169
65°	37	38
75°	10	10
85°	2	3
90°	0	



TEST NUMBER: P791677

CATALOG NUMBER: LER6D30D010-EC6DR6520359027-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	4737.2
2.5°	4733.7
5°	4707.2
7.5°	4691.9
10°	4649.5
12.5°	4563.1
15°	4419.7
17.5°	4195.6
20°	3914.3
22.5°	3610.8
25°	3289.9
27.5°	2946.7
30°	2614.7
32.5°	2286.8
35°	1959.6
37.5°	1633.1
40°	1322.7
42.5°	1031.7
45°	771.3
47.5°	537.4
50°	365.5
52.5°	252.0
55°	173.3
57.5°	117.0
60°	79.4
62.5°	55.0
65°	36.9
67.5°	18.8
70°	12.5
72.5°	11.8
75°	10.4
77.5°	7.0
80°	4.9
82.5°	3.5
85°	2.1
87.5°	1.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)