

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791804

Luminaire Tested: LER6D35BD010-EC6DR2520359050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791804
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR2520359050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3810.4 lumens
Efficiency: N/A
Efficacy: 123.7 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791804
CATALOG NUMBER: LER6D35BD010-EC6DR2520359050-6LBS1H

Luminous Intensity Polar Plot

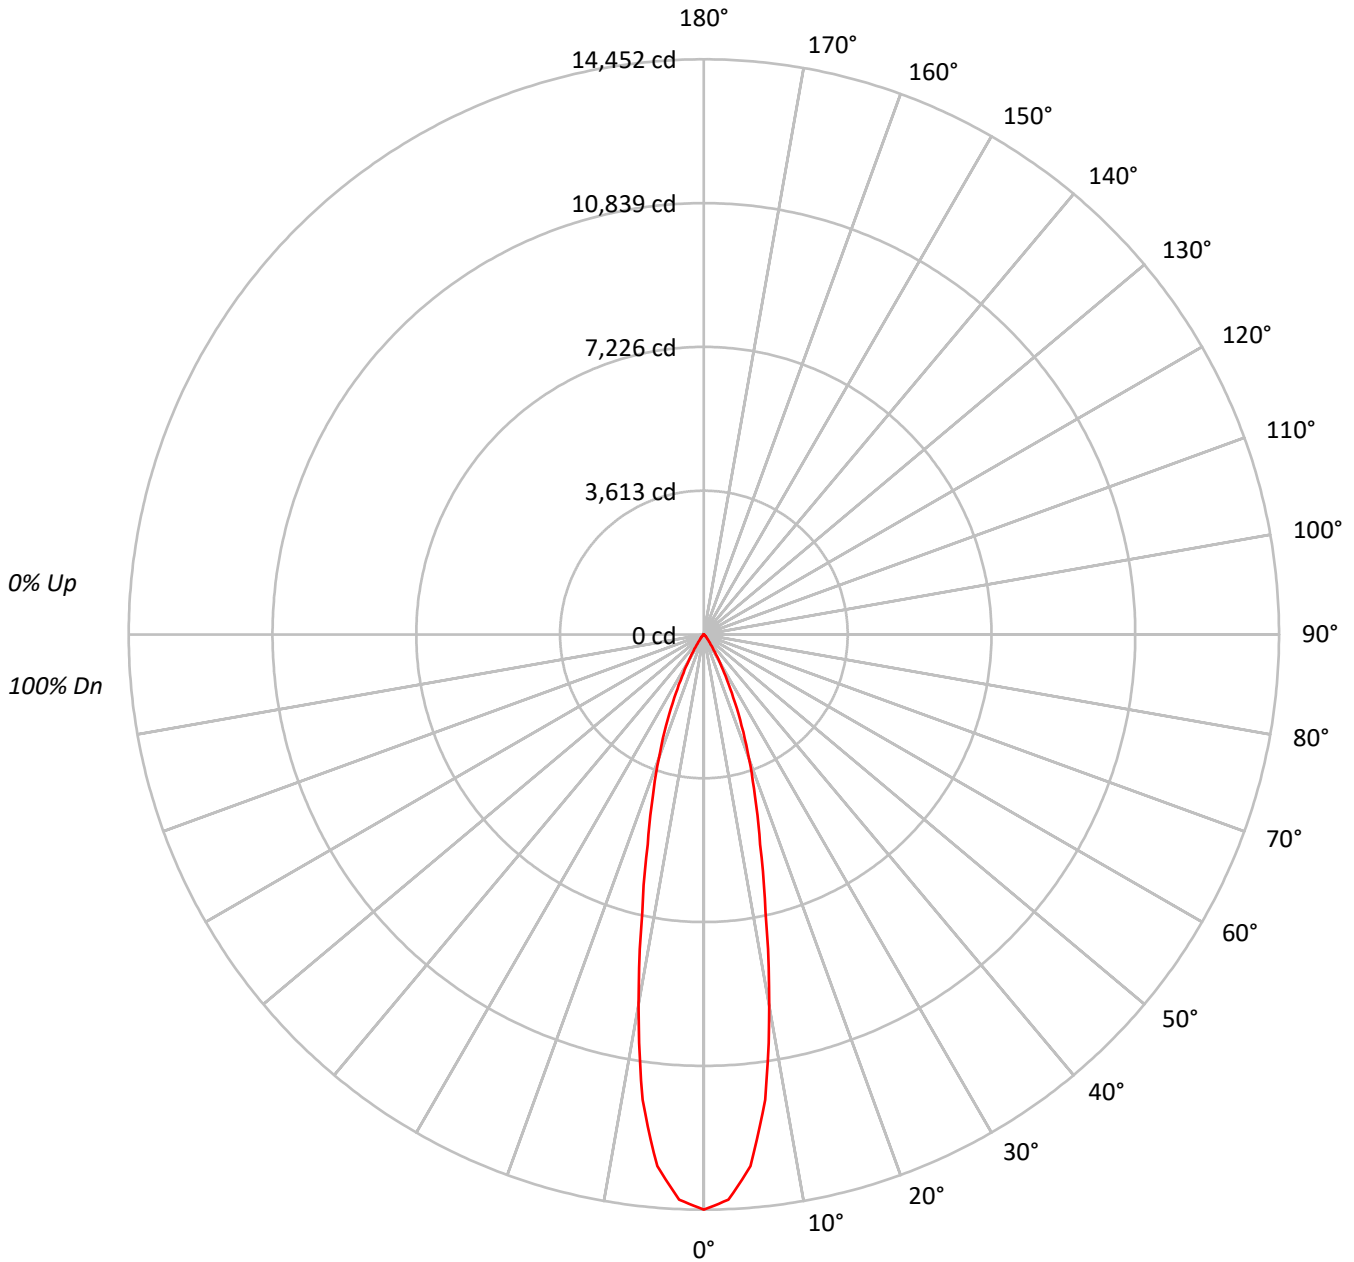



TEST NUMBER: P791804

CATALOG NUMBER: LER6D35BD010-EC6DR2520359050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																		
RC	80									70									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																														
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																												
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																												
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																												
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																												
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																												
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82																												
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																												
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																												
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																												
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																												
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1579025
5°	1470663
10°	1049064
15°	617857
20°	384445
25°	210985
30°	96490
35°	36547
40°	16545
45°	9951
50°	4131
55°	2667
60°	1857
65°	1267
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9951 cd/sqm



TEST NUMBER: P791804

CATALOG NUMBER: LER6D35BD010-EC6DR2520359050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1152.4	30.2
10°-20°	1560.8	41.0
20°-30°	826.0	21.7
30°-40°	203.9	5.4
40°-50°	49.8	1.3
50°-60°	13.1	0.3
60°-70°	4.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3539.2	92.9
0°-40°	3743.1	98.2
0°-60°	3805.9	99.9
0°-90°	3810.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3810.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14452	
5°	13409	###
15°	5462	1561
25°	1750	826
35°	274	204
45°	64	50
55°	14	13
65°	5	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791804

CATALOG NUMBER: LER6D35BD010-EC6DR2520359050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	14451.9
2.5°	14214.4
5°	13408.9
7.5°	11790.6
10°	9455.6
12.5°	7147.9
15°	5462.2
17.5°	4257.0
20°	3306.4
22.5°	2479.6
25°	1750.1
27.5°	1173.6
30°	764.8
32.5°	465.3
35°	274.0
37.5°	167.7
40°	116.0
42.5°	88.7
45°	64.4
47.5°	38.9
50°	24.3
52.5°	17.6
55°	14.0
57.5°	10.9
60°	8.5
62.5°	6.7
65°	4.9
67.5°	1.8
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)