

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791833

Luminaire Tested: LER6D35BD010-EC6DR3020359035-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791833
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR3020359035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3940.3 lumens
Efficiency: N/A
Efficacy: 127.9 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P791833

CATALOG NUMBER: LER6D35BD010-EC6DR3020359035-6LBDP1LI

Luminous Intensity Polar Plot

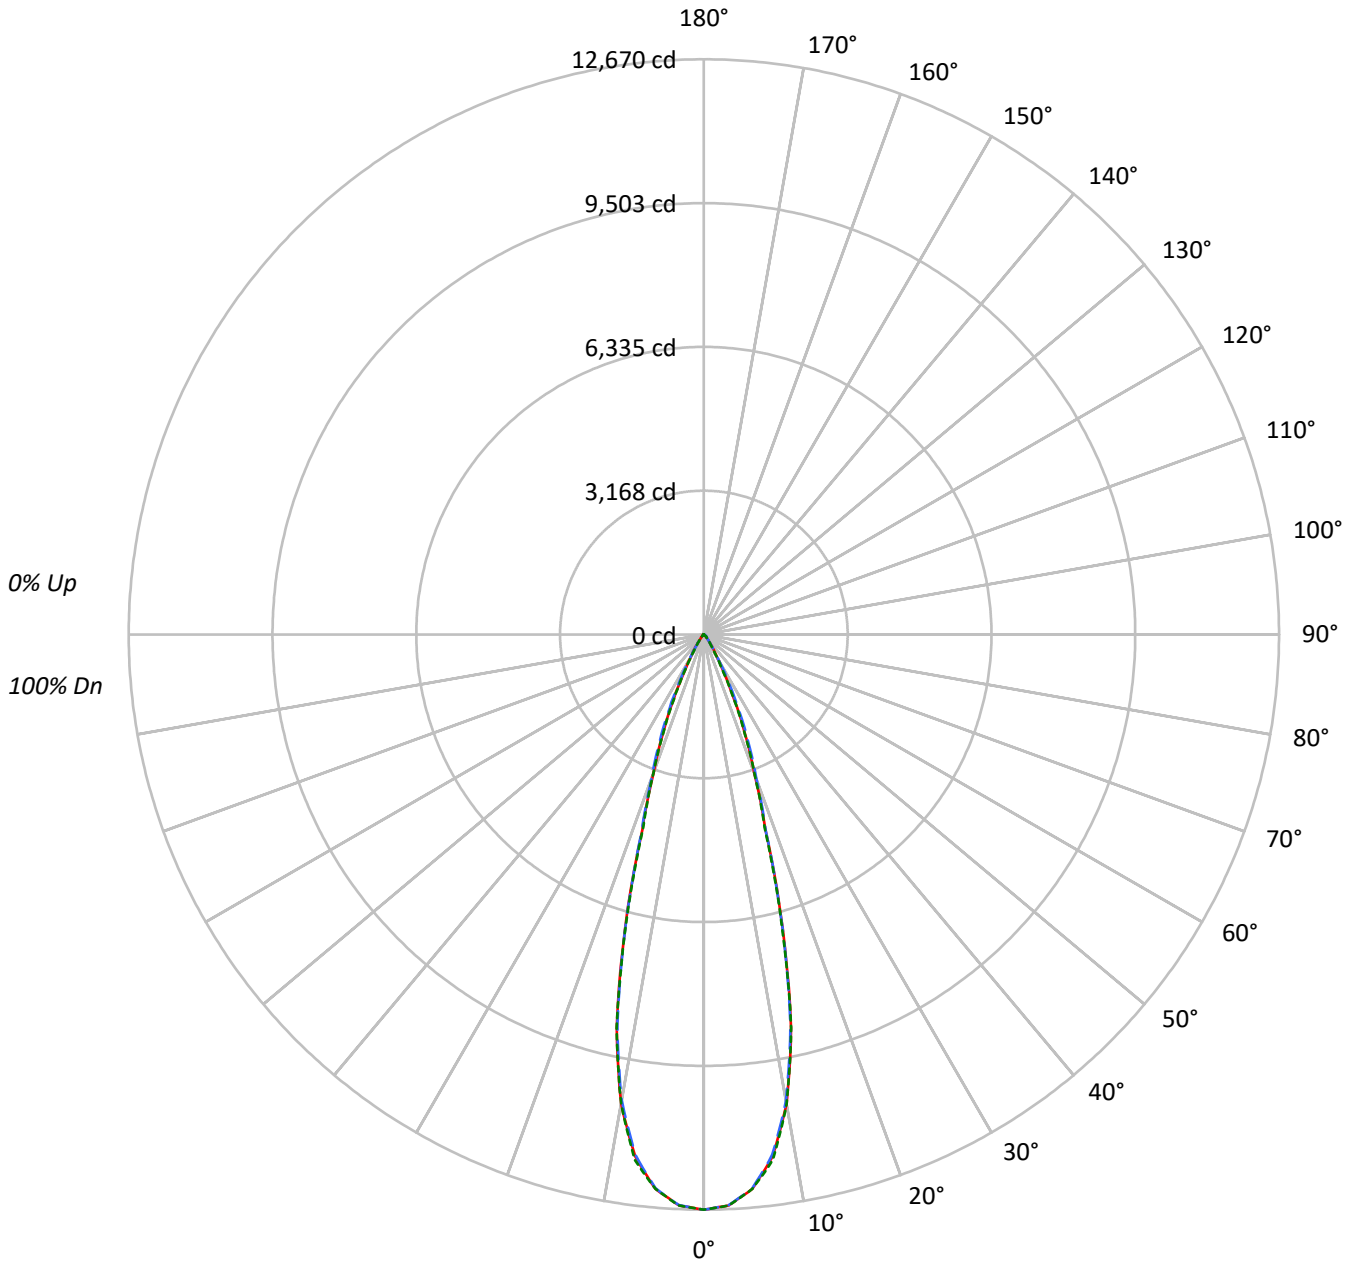



TEST NUMBER: P791833

CATALOG NUMBER: LER6D35BD010-EC6DR3020359035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 115 | 113 | 111 | 109 | 112 | 110 | 109 | 107 | 106 | 105 | 104 | 103 | 102 | 101 | 99 | 99 | 98 | 96 | | | | | | | | | | | | | | | | | | | |
| 2 | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 100 | 102 | 100 | 98 | 99 | 97 | 96 | 97 | 95 | 94 | 92 | | | | | | | | | | | | | | | | | | | |
| 3 | 107 | 102 | 98 | 95 | 105 | 101 | 97 | 94 | 98 | 95 | 93 | 96 | 93 | 91 | 94 | 92 | 90 | 89 | | | | | | | | | | | | | | | | | | | |
| 4 | 103 | 98 | 93 | 90 | 102 | 96 | 93 | 90 | 94 | 91 | 89 | 93 | 90 | 88 | 91 | 89 | 87 | 85 | | | | | | | | | | | | | | | | | | | |
| 5 | 100 | 94 | 89 | 86 | 98 | 93 | 89 | 86 | 91 | 88 | 85 | 90 | 86 | 84 | 88 | 86 | 83 | 82 | | | | | | | | | | | | | | | | | | | |
| 6 | 97 | 90 | 85 | 82 | 95 | 89 | 85 | 82 | 88 | 84 | 81 | 87 | 83 | 81 | 85 | 83 | 80 | 79 | | | | | | | | | | | | | | | | | | | |
| 7 | 94 | 87 | 82 | 79 | 92 | 86 | 82 | 79 | 85 | 81 | 78 | 84 | 81 | 78 | 83 | 80 | 78 | 77 | | | | | | | | | | | | | | | | | | | |
| 8 | 91 | 84 | 79 | 76 | 90 | 83 | 79 | 76 | 82 | 78 | 76 | 81 | 78 | 75 | 80 | 77 | 75 | 74 | | | | | | | | | | | | | | | | | | | |
| 9 | 88 | 81 | 76 | 73 | 87 | 80 | 76 | 73 | 80 | 76 | 73 | 79 | 75 | 73 | 78 | 75 | 73 | 72 | | | | | | | | | | | | | | | | | | | |
| 10 | 85 | 78 | 74 | 71 | 85 | 78 | 74 | 71 | 77 | 73 | 71 | 76 | 73 | 71 | 76 | 73 | 70 | 69 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° | 45° | 90° |
|-----|--------|--------|--------|
| 0° | 969805 | 969805 | 969805 |
| 5° | 941968 | 940869 | 942014 |
| 10° | 815886 | 810135 | 815692 |
| 15° | 532327 | 529466 | 526803 |
| 20° | 264699 | 274628 | 264348 |
| 25° | 133340 | 150358 | 130603 |
| 30° | 53384 | 58166 | 46517 |
| 35° | 24762 | 23716 | 19875 |
| 40° | 10691 | 11871 | 10072 |
| 45° | 7545 | 9364 | 7610 |
| 50° | 2596 | 6811 | 2739 |
| 55° | 1495 | 2816 | 1575 |
| 60° | 1041 | 1240 | 1041 |
| 65° | 670 | 670 | 670 |
| 70° | 425 | 269 | 425 |
| 75° | 0 | 177 | 0 |
| 80° | 0 | 0 | 0 |
| 85° | 0 | 0 | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 9364 cd/sqm



TEST NUMBER: P791833

CATALOG NUMBER: LER6D35BD010-EC6DR3020359035-6LBDP1LI

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 1114.1 | 28.3 |
| 10°-20° | 1794.3 | 45.5 |
| 20°-30° | 775.4 | 19.7 |
| 30°-40° | 176.7 | 4.5 |
| 40°-50° | 60.7 | 1.5 |
| 50°-60° | 14.8 | 0.4 |
| 60°-70° | 3.8 | 0.1 |
| 70°-80° | 0.4 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 3683.8 | 93.5 |
| 0°-40° | 3860.6 | 98.0 |
| 0°-60° | 3936.1 | 99.9 |
| 0°-90° | 3940.3 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3940.3 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | 22.5° | 45° | 67.5° | 90° | Flux |
|-----|-------|-------|-------|-------|-------|------|
| 0° | 12670 | 12670 | 12670 | 12670 | 12670 | |
| 5° | 12260 | 12248 | 12245 | 12271 | 12260 | 1115 |
| 15° | 6718 | 6637 | 6682 | 6660 | 6648 | 1799 |
| 25° | 1579 | 1638 | 1780 | 1597 | 1546 | 756 |
| 35° | 265 | 271 | 254 | 252 | 213 | 180 |
| 45° | 70 | 86 | 86 | 86 | 70 | 49 |
| 55° | 11 | 12 | 21 | 12 | 12 | 11 |
| 65° | 4 | 4 | 4 | 4 | 4 | 4 |
| 75° | 0 | 0 | 1 | 0 | 0 | 1 |
| 85° | 0 | 0 | 0 | 0 | 0 | 0 |
| 90° | 0 | 0 | 0 | 0 | 0 | 0 |



TEST NUMBER: P791833

CATALOG NUMBER: LER6D35BD010-EC6DR3020359035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

| | 0° | 22.5° | 45° | 67.5° | 90° |
|-------|---------|---------|---------|---------|---------|
| 0° | 12670.0 | 12670.0 | 12670.0 | 12670.0 | 12670.0 |
| 2.5° | 12586.1 | 12577.4 | 12582.3 | 12588.6 | 12591.0 |
| 5° | 12259.5 | 12247.7 | 12245.2 | 12270.7 | 12260.1 |
| 7.5° | 11600.7 | 11583.9 | 11558.4 | 11616.3 | 11670.4 |
| 10° | 10497.2 | 10478.5 | 10423.2 | 10450.5 | 10494.7 |
| 12.5° | 8868.0 | 8807.7 | 8806.4 | 8893.5 | 8881.7 |
| 15° | 6717.6 | 6636.7 | 6681.5 | 6659.7 | 6647.9 |
| 17.5° | 4517.4 | 4486.3 | 4546.0 | 4527.9 | 4450.2 |
| 20° | 3249.6 | 3257.7 | 3371.5 | 3314.3 | 3245.3 |
| 22.5° | 2371.3 | 2400.5 | 2535.5 | 2388.1 | 2334.0 |
| 25° | 1578.8 | 1638.5 | 1780.3 | 1596.8 | 1546.4 |
| 27.5° | 971.0 | 998.4 | 1142.1 | 958.6 | 931.2 |
| 30° | 604.0 | 590.3 | 658.1 | 564.8 | 526.3 |
| 32.5° | 396.2 | 378.8 | 400.6 | 359.5 | 328.4 |
| 35° | 265.0 | 270.6 | 253.8 | 251.9 | 212.7 |
| 37.5° | 165.5 | 190.3 | 168.0 | 179.2 | 136.9 |
| 40° | 107.0 | 138.1 | 118.8 | 131.3 | 100.8 |
| 42.5° | 87.7 | 106.4 | 97.7 | 103.9 | 89.6 |
| 45° | 69.7 | 86.5 | 86.5 | 86.5 | 70.3 |
| 47.5° | 38.6 | 57.9 | 74.0 | 59.1 | 41.1 |
| 50° | 21.8 | 29.2 | 57.2 | 30.5 | 23.0 |
| 52.5° | 14.9 | 16.8 | 39.2 | 17.4 | 15.6 |
| 55° | 11.2 | 11.8 | 21.1 | 12.4 | 11.8 |
| 57.5° | 8.7 | 9.3 | 11.2 | 9.3 | 8.7 |
| 60° | 6.8 | 6.8 | 8.1 | 7.5 | 6.8 |
| 62.5° | 5.0 | 5.0 | 5.6 | 5.0 | 5.0 |
| 65° | 3.7 | 3.7 | 3.7 | 3.7 | 3.7 |
| 67.5° | 1.9 | 2.5 | 2.5 | 2.5 | 2.5 |
| 70° | 1.9 | 1.2 | 1.2 | 1.2 | 1.9 |
| 72.5° | 1.2 | 0.6 | 0.6 | 0.6 | 0.6 |
| 75° | 0.0 | 0.0 | 0.6 | 0.0 | 0.0 |
| 77.5° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 80° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 82.5° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 85° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 87.5° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 90° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)