

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791925

Luminaire Tested: LER6D35BD010-EC6DR4020359030-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791925
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR4020359030-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4387.8 lumens
Efficiency: N/A
Efficacy: 142.5 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791925
CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1LI

Luminous Intensity Polar Plot

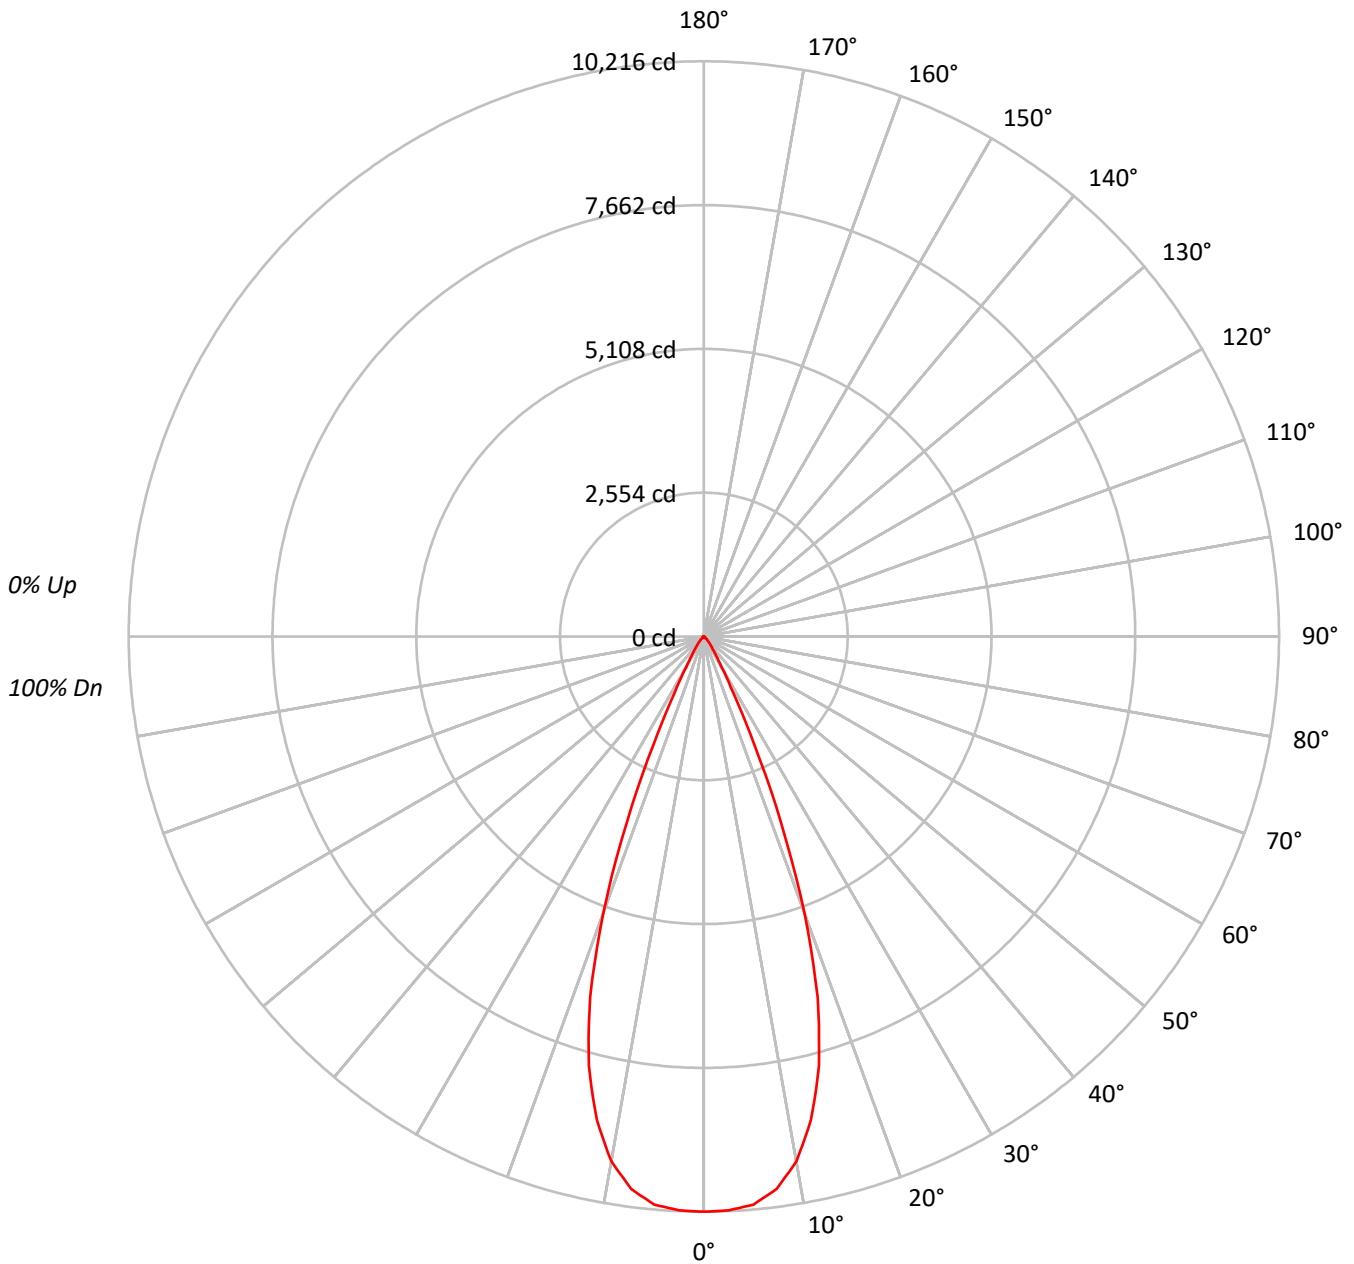



TEST NUMBER: P791925

CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96	96	96	96
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92	92	92	92
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88	88	88	88
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84	84	84	84
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81	81	81	81
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77	77	77	77
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74	74	74	74
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72	72	72	72
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69	69	69	69
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67	67	67	67

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1116197
5°	1110776
10°	1049918
15°	892568
20°	608351
25°	253830
30°	79811
35°	37094
40°	20510
45°	9410
50°	4572
55°	2495
60°	1311
65°	465
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9410 cd/sqm



TEST NUMBER: P791925

CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	945.7	21.6
10°-20°	2118.5	48.3
20°-30°	1060.5	24.2
30°-40°	194.4	4.4
40°-50°	53.6	1.2
50°-60°	12.6	0.3
60°-70°	2.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4124.7	94.0
0°-40°	4319.0	98.4
0°-60°	4385.3	99.9
0°-90°	4387.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4387.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10216	
5°	10128	946
15°	7891	2119
25°	2106	1060
35°	278	194
45°	61	54
55°	13	13
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791925
CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	10215.9
2.5°	10201.0
5°	10127.6
7.5°	9893.6
10°	9463.3
12.5°	8792.5
15°	7890.8
17.5°	6718.1
20°	5232.1
22.5°	3567.0
25°	2105.5
27.5°	1113.0
30°	632.6
32.5°	408.8
35°	278.1
37.5°	198.7
40°	143.8
42.5°	98.5
45°	60.9
47.5°	38.8
50°	26.9
52.5°	19.1
55°	13.1
57.5°	8.4
60°	6.0
62.5°	3.6
65°	1.8
67.5°	1.2
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)