

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P791926

Luminaire Tested: LER6D35BD010-EC6DR4020359030-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P791926
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR4020359030-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3969.8 lumens
Efficiency: N/A
Efficacy: 128.9 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P791926
CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1MW

Luminous Intensity Polar Plot

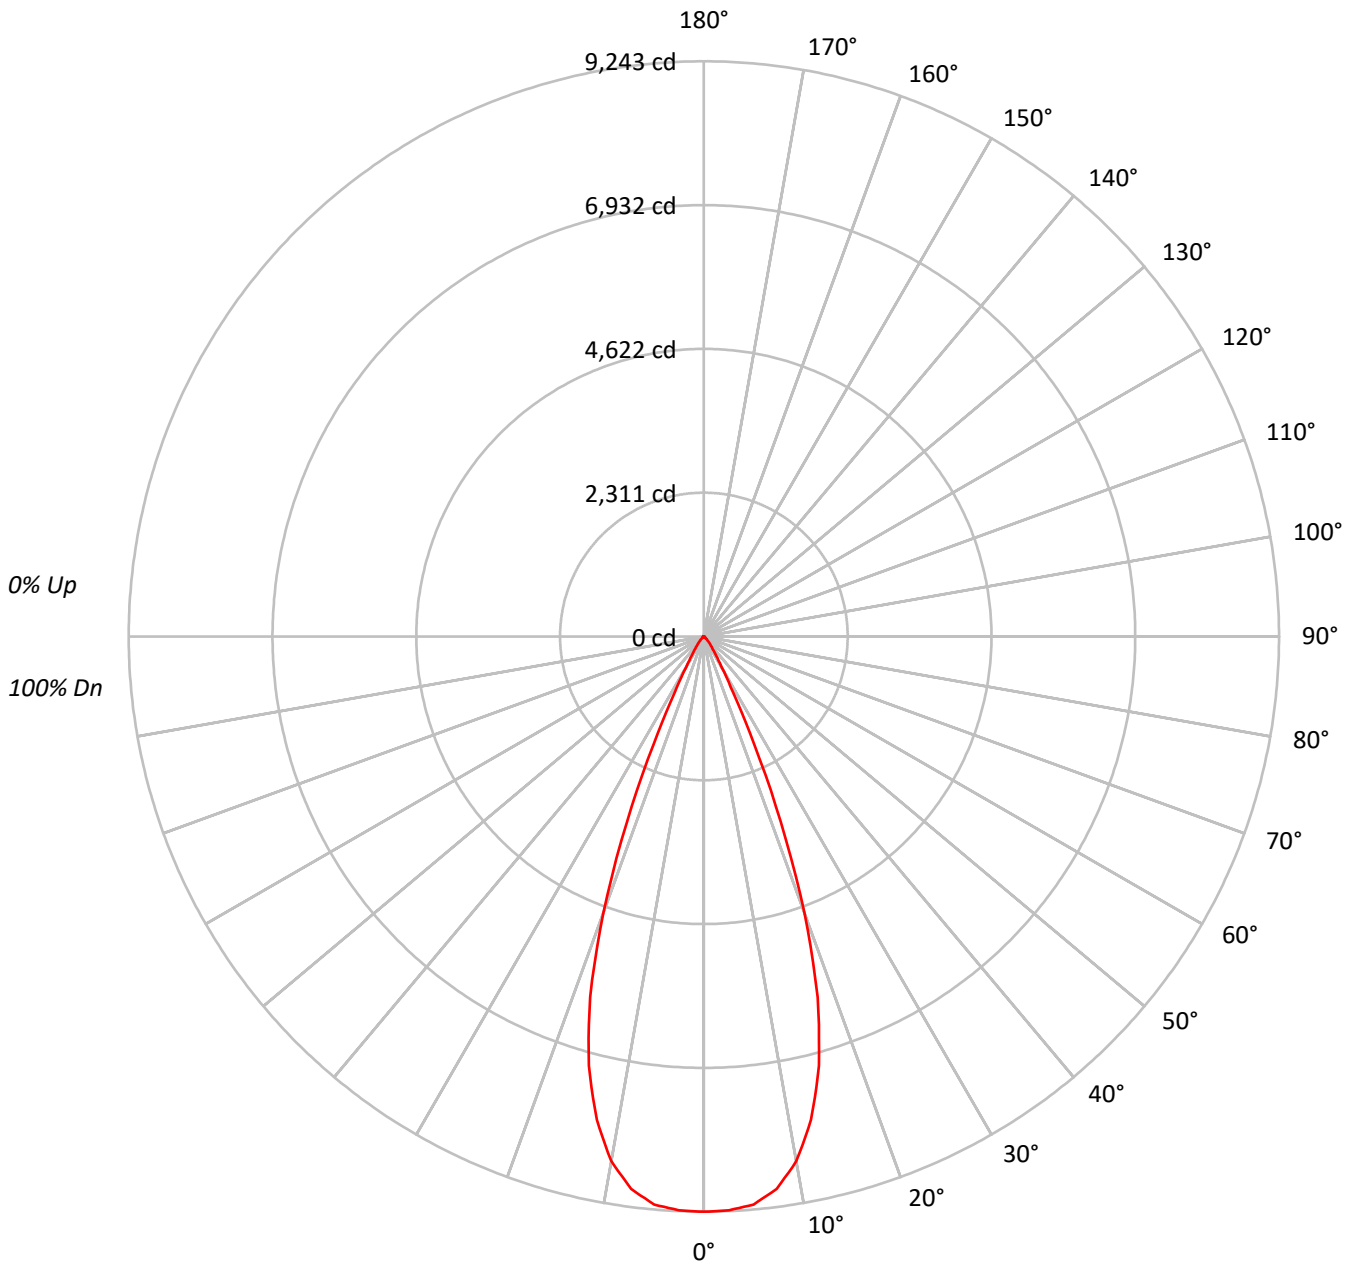



TEST NUMBER: P791926

CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																	
RC	80									50									30									10									0								
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0															
RCR																																													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100									100																		
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96									96																		
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92									92																		
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88									88																		
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84									84																		
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81									81																		
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77									77																		
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74									74																		
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72									72																		
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69									69																		
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67									67																		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1009875
5°	1004970
10°	949911
15°	807540
20°	550401
25°	229647
30°	72203
35°	33559
40°	18556
45°	8514
50°	4131
55°	2267
60°	1180
65°	414
70°	160
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8514 cd/sqm



TEST NUMBER: P791926

CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	855.6	21.6
10°-20°	1916.7	48.3
20°-30°	959.4	24.2
30°-40°	175.9	4.4
40°-50°	48.5	1.2
50°-60°	11.4	0.3
60°-70°	2.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3731.8	94.0
0°-40°	3907.6	98.4
0°-60°	3967.6	99.9
0°-90°	3969.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3969.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9243	
5°	9163	856
15°	7139	1917
25°	1905	959
35°	252	176
45°	55	49
55°	12	11
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P791926
CATALOG NUMBER: LER6D35BD010-EC6DR4020359030-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	9242.8
2.5°	9229.3
5°	9162.9
7.5°	8951.2
10°	8561.9
12.5°	7955.0
15°	7139.1
17.5°	6078.2
20°	4733.7
22.5°	3227.2
25°	1904.9
27.5°	1007.0
30°	572.3
32.5°	369.9
35°	251.6
37.5°	179.8
40°	130.1
42.5°	89.1
45°	55.1
47.5°	35.1
50°	24.3
52.5°	17.3
55°	11.9
57.5°	7.6
60°	5.4
62.5°	3.2
65°	1.6
67.5°	1.1
70°	0.5
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)