

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792143

Luminaire Tested: LER6D35BD010-EC6DR6520359024-6LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P792143
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR6520359024-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2127.0 lumens
Efficiency: N/A
Efficacy: 69.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792143

CATALOG NUMBER: LER6D35BD010-EC6DR6520359024-6LBDP1B

Luminous Intensity Polar Plot

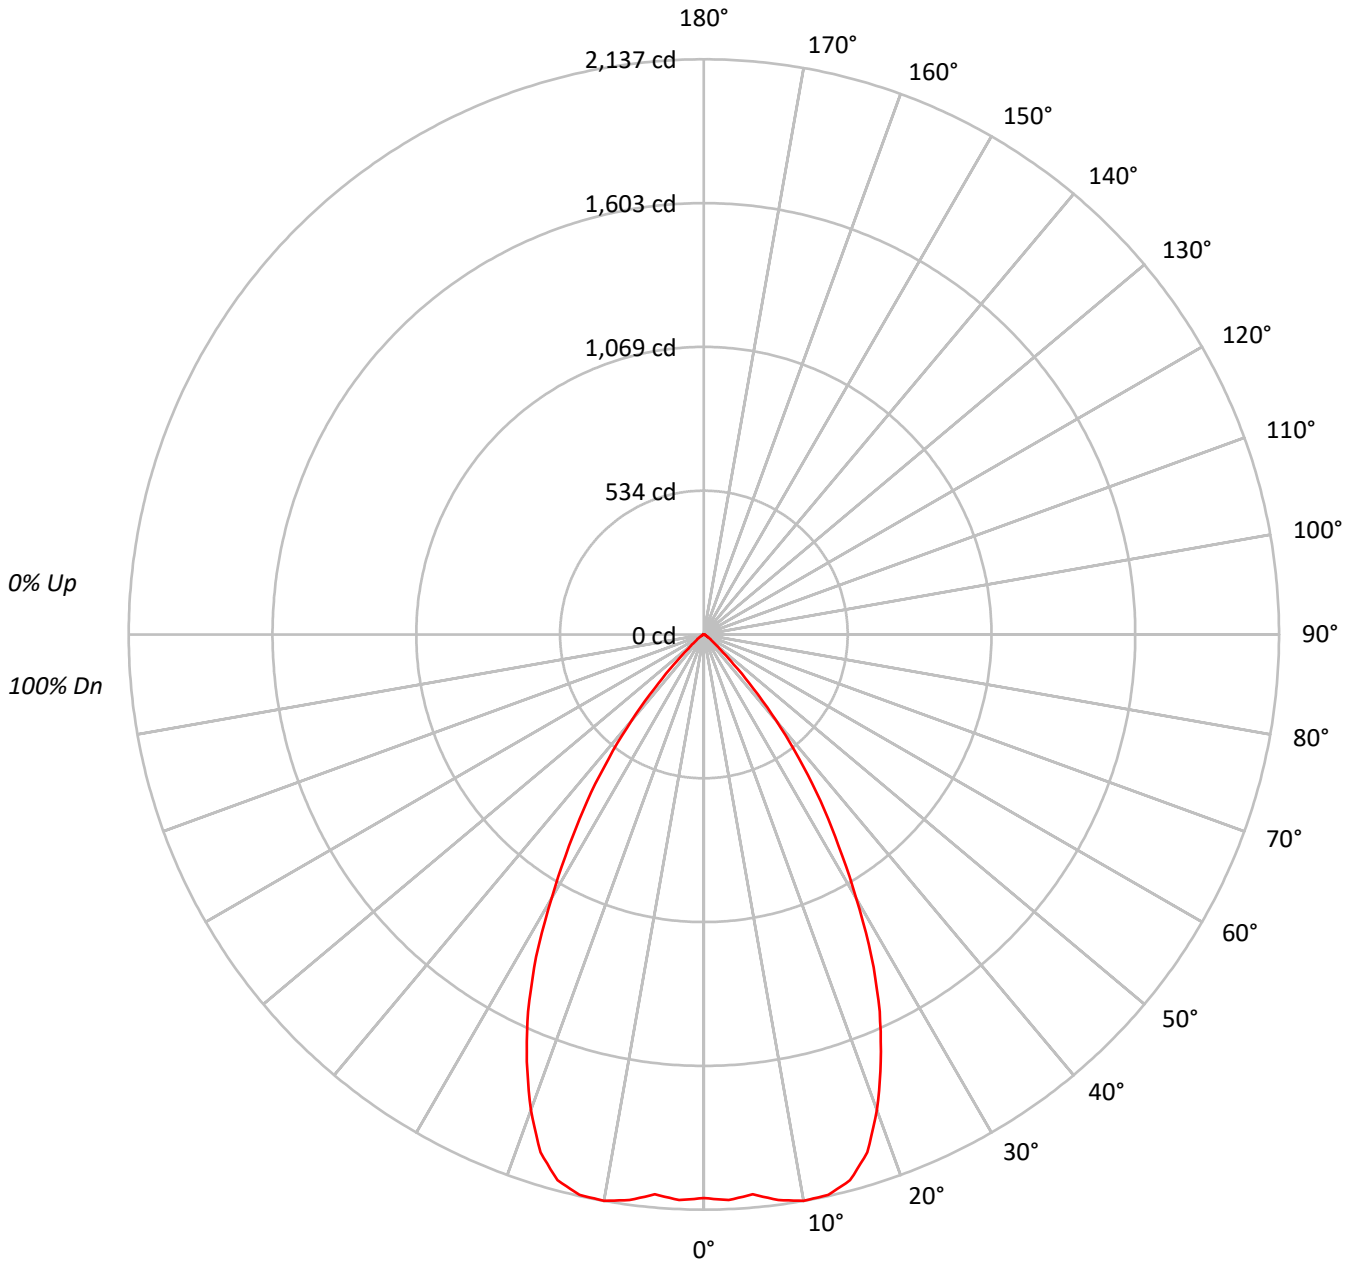



TEST NUMBER: P792143

CATALOG NUMBER: LER6D35BD010-EC6DR6520359024-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	228803
5°	228986
10°	237048
15°	237451
20°	218605
25°	186271
30°	142590
35°	100744
40°	59462
45°	24136
50°	8754
55°	4877
60°	2797
65°	1551
70°	1629
75°	1266
80°	1321
85°	1128

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24136 cd/sqm



TEST NUMBER: P792143

CATALOG NUMBER: LER6D35BD010-EC6DR6520359024-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	201.6	9.5
10°-20°	581.7	27.3
20°-30°	697.9	32.8
30°-40°	469.0	22.0
40°-50°	140.4	6.6
50°-60°	24.8	1.2
60°-70°	7.1	0.3
70°-80°	3.5	0.2
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1481.2	69.6
0°-40°	1950.1	91.7
0°-60°	2115.3	99.5
0°-90°	2127.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2127.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2094	
5°	2088	202
15°	2099	582
25°	1545	698
35°	755	469
45°	156	140
55°	26	25
65°	6	7
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P792143

CATALOG NUMBER: LER6D35BD010-EC6DR6520359024-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	2094.1
2.5°	2103.0
5°	2087.8
7.5°	2119.4
10°	2136.6
12.5°	2132.5
15°	2099.2
17.5°	2017.6
20°	1880.1
22.5°	1718.2
25°	1545.1
27.5°	1349.5
30°	1130.2
32.5°	931.4
35°	755.3
37.5°	581.2
40°	416.9
42.5°	272.3
45°	156.2
47.5°	82.7
50°	51.5
52.5°	35.7
55°	25.6
57.5°	18.5
60°	12.8
62.5°	8.3
65°	6.0
67.5°	5.4
70°	5.1
72.5°	3.9
75°	3.0
77.5°	2.7
80°	2.1
82.5°	1.5
85°	0.9
87.5°	0.6
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)