

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792162

Luminaire Tested: LER6D35BD010-EC6DR6520359030-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P792162
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR6520359030-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2875.0 lumens
Efficiency: N/A
Efficacy: 93.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792162

CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBDP1MW

Luminous Intensity Polar Plot

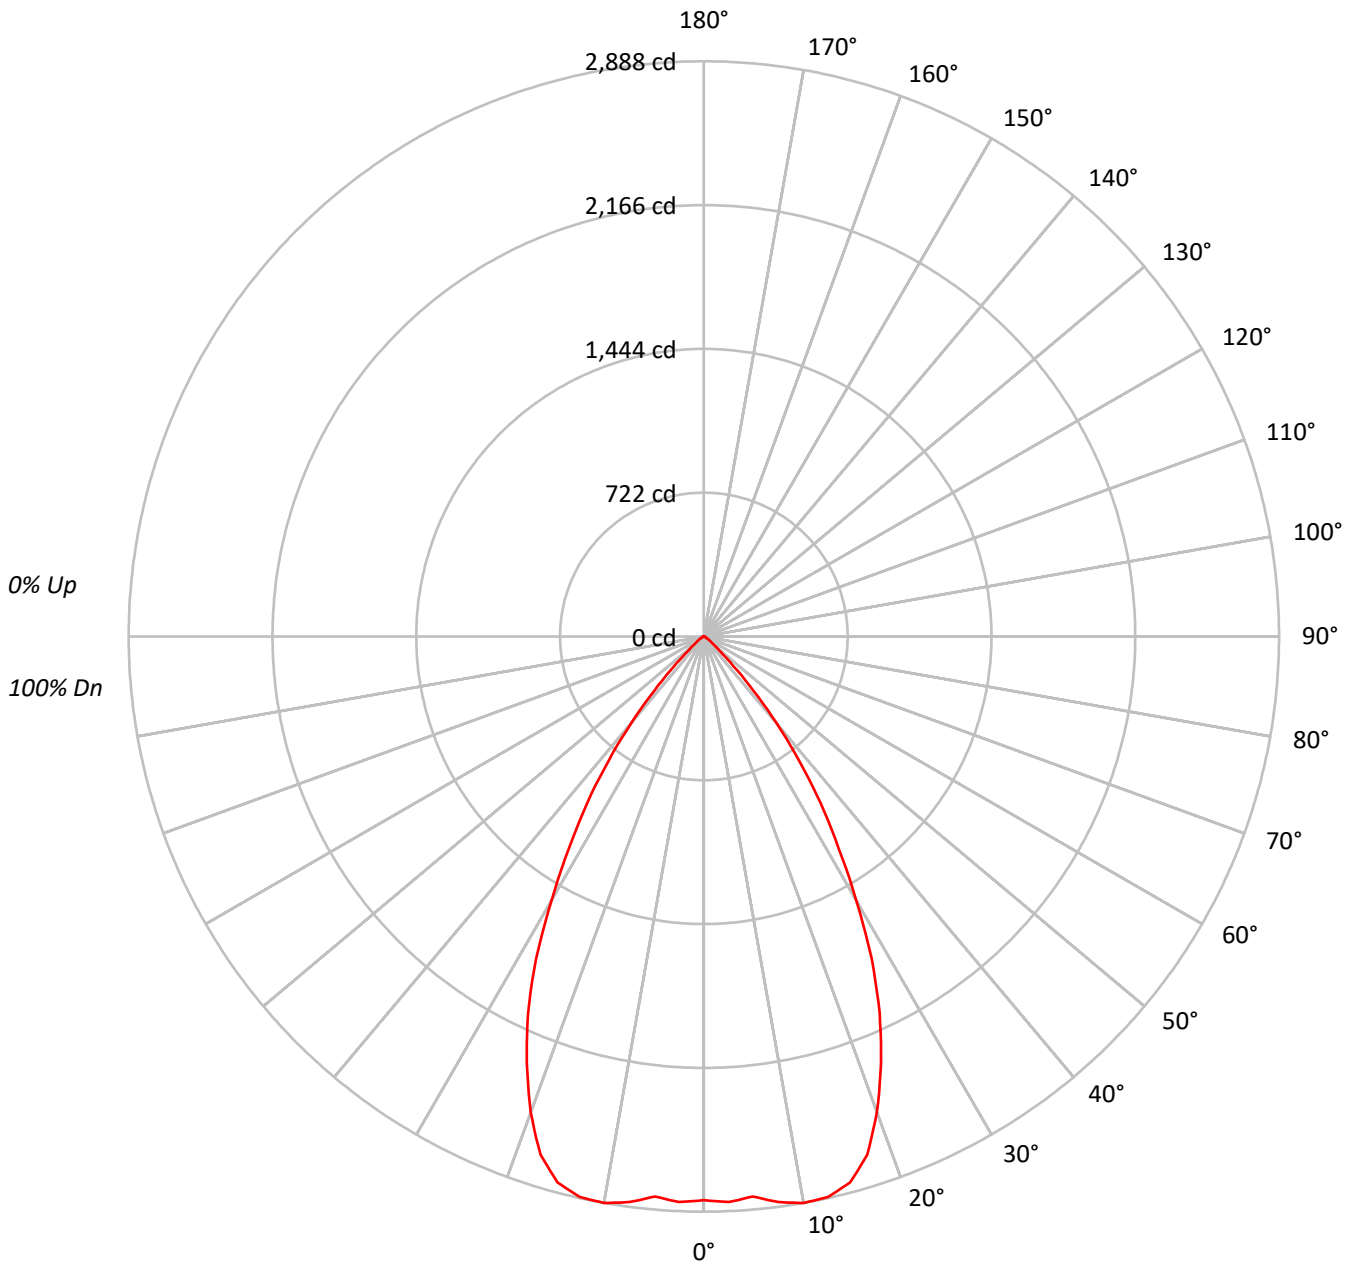



TEST NUMBER: P792162

CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	309273
5°	309534
10°	320435
15°	320964
20°	295496
25°	251781
30°	192753
35°	136170
40°	80386
45°	32634
50°	11831
55°	6591
60°	3780
65°	2068
70°	2172
75°	1689
80°	1762
85°	1504

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 32634 cd/sqm



TEST NUMBER: P792162

CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	272.6	9.5
10°-20°	786.2	27.3
20°-30°	943.3	32.8
30°-40°	633.9	22.1
40°-50°	189.8	6.6
50°-60°	33.5	1.2
60°-70°	9.5	0.3
70°-80°	4.6	0.2
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2002.1	69.6
0°-40°	2636.1	91.7
0°-60°	2859.4	99.5
0°-90°	2875.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2875.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2831	
5°	2822	273
15°	2838	786
25°	2088	943
35°	1021	634
45°	211	190
55°	35	33
65°	8	10
75°	4	5
85°	1	1
90°	0	



TEST NUMBER: P792162

CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2830.6
2.5°	2842.7
5°	2822.2
7.5°	2864.8
10°	2888.2
12.5°	2882.5
15°	2837.5
17.5°	2727.3
20°	2541.4
22.5°	2322.6
25°	2088.5
27.5°	1824.2
30°	1527.8
32.5°	1259.0
35°	1020.9
37.5°	785.6
40°	563.6
42.5°	368.1
45°	211.2
47.5°	111.8
50°	69.6
52.5°	48.3
55°	34.6
57.5°	24.9
60°	17.3
62.5°	11.3
65°	8.0
67.5°	7.2
70°	6.8
72.5°	5.2
75°	4.0
77.5°	3.6
80°	2.8
82.5°	2.0
85°	1.2
87.5°	0.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)