

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792166

Luminaire Tested: LER6D35BD010-EC6DR6520359030-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792166  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D35BD010-EC6DR6520359030-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3333.0 lumens  
Efficiency: N/A  
Efficacy: 108.2 lumens/watt  
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96  
Luminous Opening: Circular (Dia: 0.48' x H: 0')  
CIE Type: Direct


Input Watts (W): 30.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P792166  
CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBS1MW

### Luminous Intensity Polar Plot

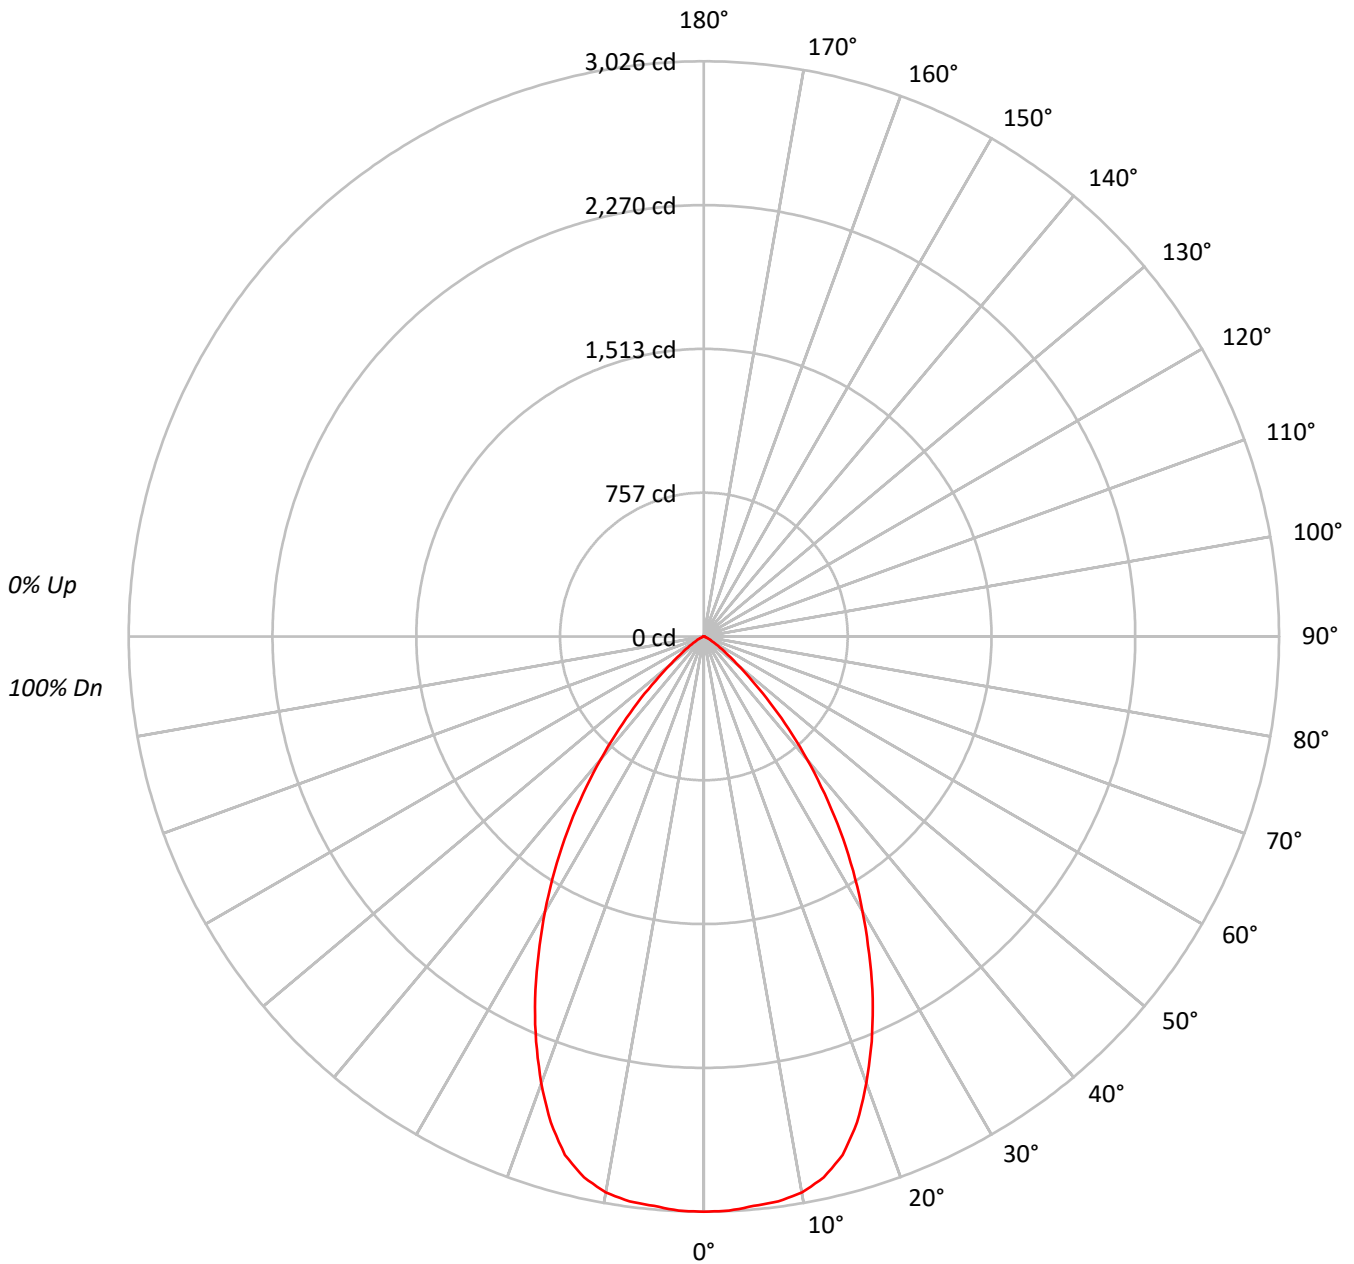



TEST NUMBER: P792166  
 CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78																			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72																			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66																			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61																			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56																			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52																			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49																			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	176748
5°	176297
10°	176147
15°	170720
20°	155418
25°	135437
30°	112643
35°	89258
40°	64424
45°	40695
50°	21216
55°	11272
60°	5922
65°	3261
70°	1366
75°	1512
80°	1043
85°	871

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 40695 cd/sqm



TEST NUMBER: P792166

CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	286.2	8.6
10°-20°	783.7	23.5
20°-30°	957.9	28.7
30°-40°	777.3	23.3
40°-50°	387.3	11.6
50°-60°	108.0	3.2
60°-70°	24.5	0.7
70°-80°	6.4	0.2
80°-90°	1.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2027.8	60.8
0°-40°	2805.1	84.2
0°-60°	3300.4	99.0
0°-90°	3333.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3333.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3026	
5°	3007	286
15°	2824	784
25°	2102	958
35°	1252	777
45°	493	387
55°	111	108
65°	24	25
75°	7	6
85°	1	2
90°	0	



TEST NUMBER: P792166  
CATALOG NUMBER: LER6D35BD010-EC6DR6520359030-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3026.3
2.5°	3024.0
5°	3007.1
7.5°	2997.4
10°	2970.2
12.5°	2915.1
15°	2823.5
17.5°	2680.3
20°	2500.6
22.5°	2306.7
25°	2101.7
27.5°	1882.5
30°	1670.3
32.5°	1460.9
35°	1251.9
37.5°	1043.3
40°	845.0
42.5°	659.1
45°	492.7
47.5°	343.3
50°	233.5
52.5°	161.0
55°	110.7
57.5°	74.7
60°	50.7
62.5°	35.1
65°	23.6
67.5°	12.0
70°	8.0
72.5°	7.6
75°	6.7
77.5°	4.4
80°	3.1
82.5°	2.2
85°	1.3
87.5°	0.9
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)