

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792226

Luminaire Tested: LER6D35BD010-EC6DR7020359040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P792226
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D35BD010-EC6DR7020359040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3171.6 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792226

CATALOG NUMBER: LER6D35BD010-EC6DR7020359040-6LBDP1MW

Luminous Intensity Polar Plot

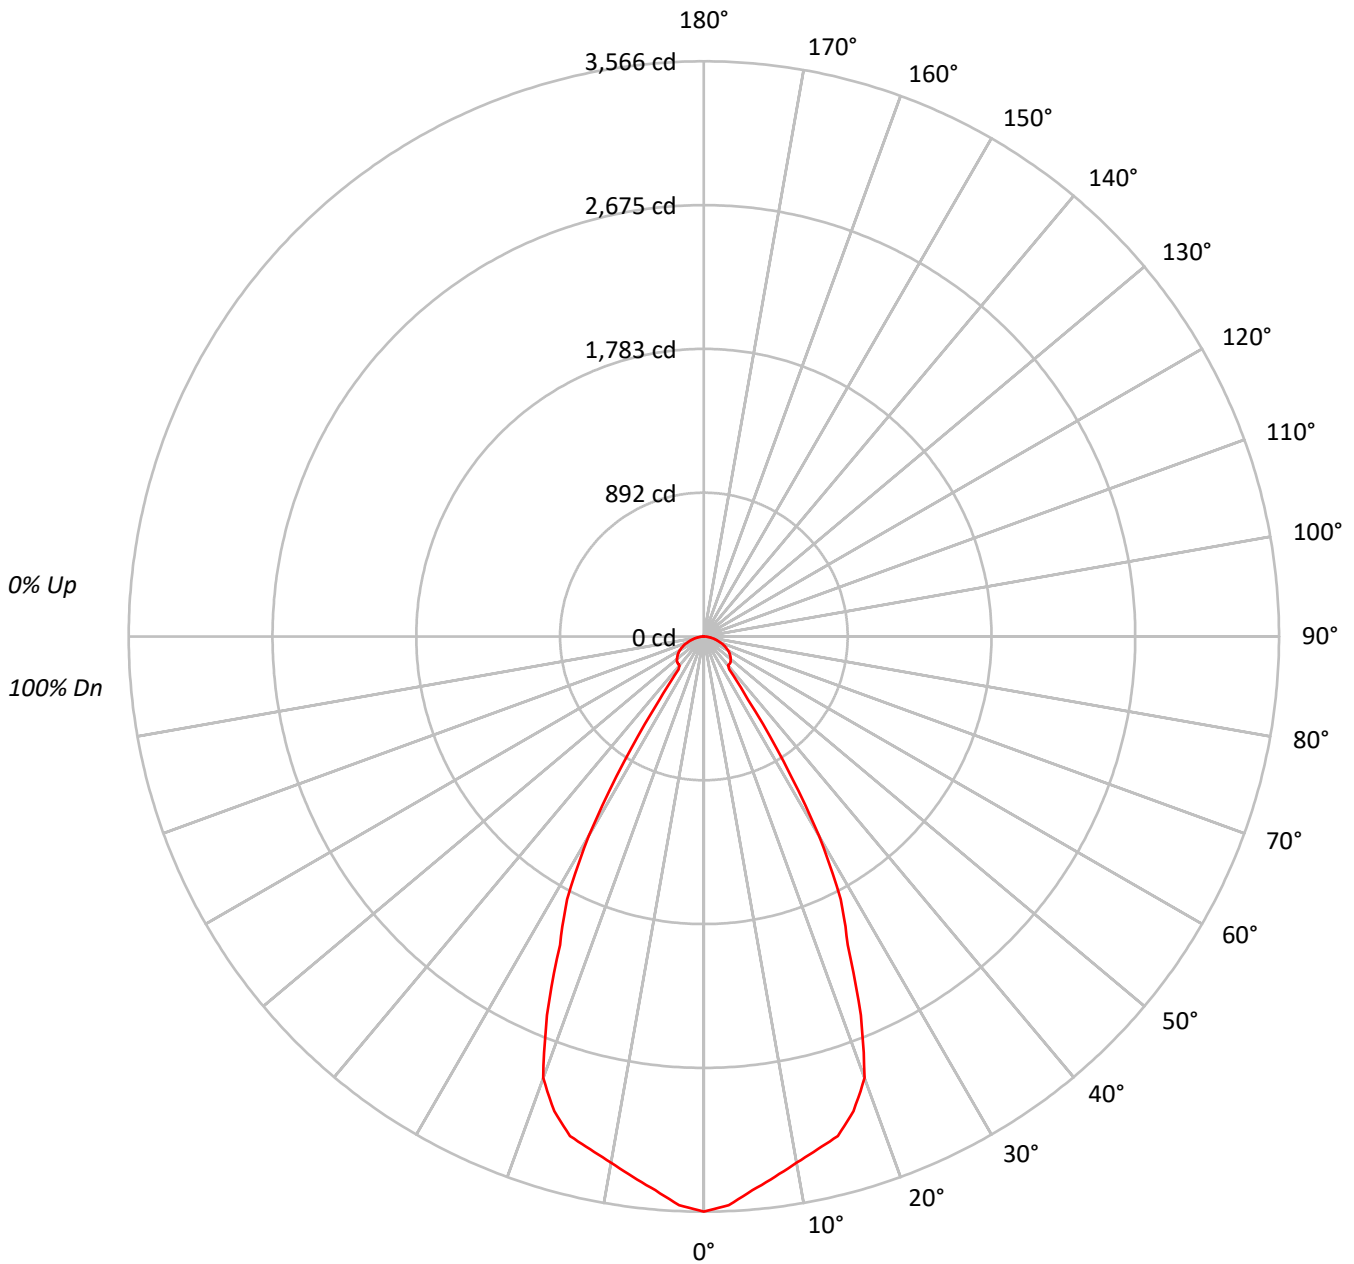



TEST NUMBER: P792226

CATALOG NUMBER: LER6D35BD010-EC6DR7020359040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	389591
5°	378017
10°	367476
15°	362658
20°	338645
25°	254409
30°	179846
35°	63704
40°	33504
45°	35678
50°	36954
55°	37641
60°	37870
65°	37074
70°	34981
75°	32421
80°	28755
85°	23317

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 37884 cd/sqm



TEST NUMBER: P792226

CATALOG NUMBER: LER6D35BD010-EC6DR7020359040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	325.1	10.3
10°-20°	891.7	28.1
20°-30°	982.1	31.0
30°-40°	375.2	11.8
40°-50°	177.2	5.6
50°-60°	176.2	5.6
60°-70°	141.0	4.4
70°-80°	81.1	2.6
80°-90°	22.0	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2198.9	69.3
0°-40°	2574.1	81.2
0°-60°	2927.5	92.3
0°-90°	3171.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3171.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3566	
5°	3447	325
15°	3206	892
25°	2110	982
35°	478	375
45°	231	177
55°	198	176
65°	143	141
75°	77	81
85°	19	22
90°	0	



TEST NUMBER: P792226

CATALOG NUMBER: LER6D35BD010-EC6DR7020359040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3565.7
2.5°	3528.5
5°	3446.6
7.5°	3378.3
10°	3312.2
12.5°	3256.4
15°	3206.1
17.5°	3084.7
20°	2912.5
22.5°	2541.1
25°	2110.3
27.5°	1837.1
30°	1425.5
32.5°	920.8
35°	477.6
37.5°	258.0
40°	234.9
42.5°	233.2
45°	230.9
47.5°	225.8
50°	217.4
52.5°	207.8
55°	197.6
57.5°	186.3
60°	173.3
62.5°	158.6
65°	143.4
67.5°	126.5
70°	109.5
72.5°	92.6
75°	76.8
77.5°	60.4
80°	45.7
82.5°	32.2
85°	18.6
87.5°	7.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)