

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792279

Luminaire Tested: LER6D40BD010-EC6DR2540509050-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792279
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR2540509050-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3357.9 lumens
Efficiency: N/A
Efficacy: 95.4 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792279

CATALOG NUMBER: LER6D40BD010-EC6DR2540509050-6LBDP1B

Luminous Intensity Polar Plot

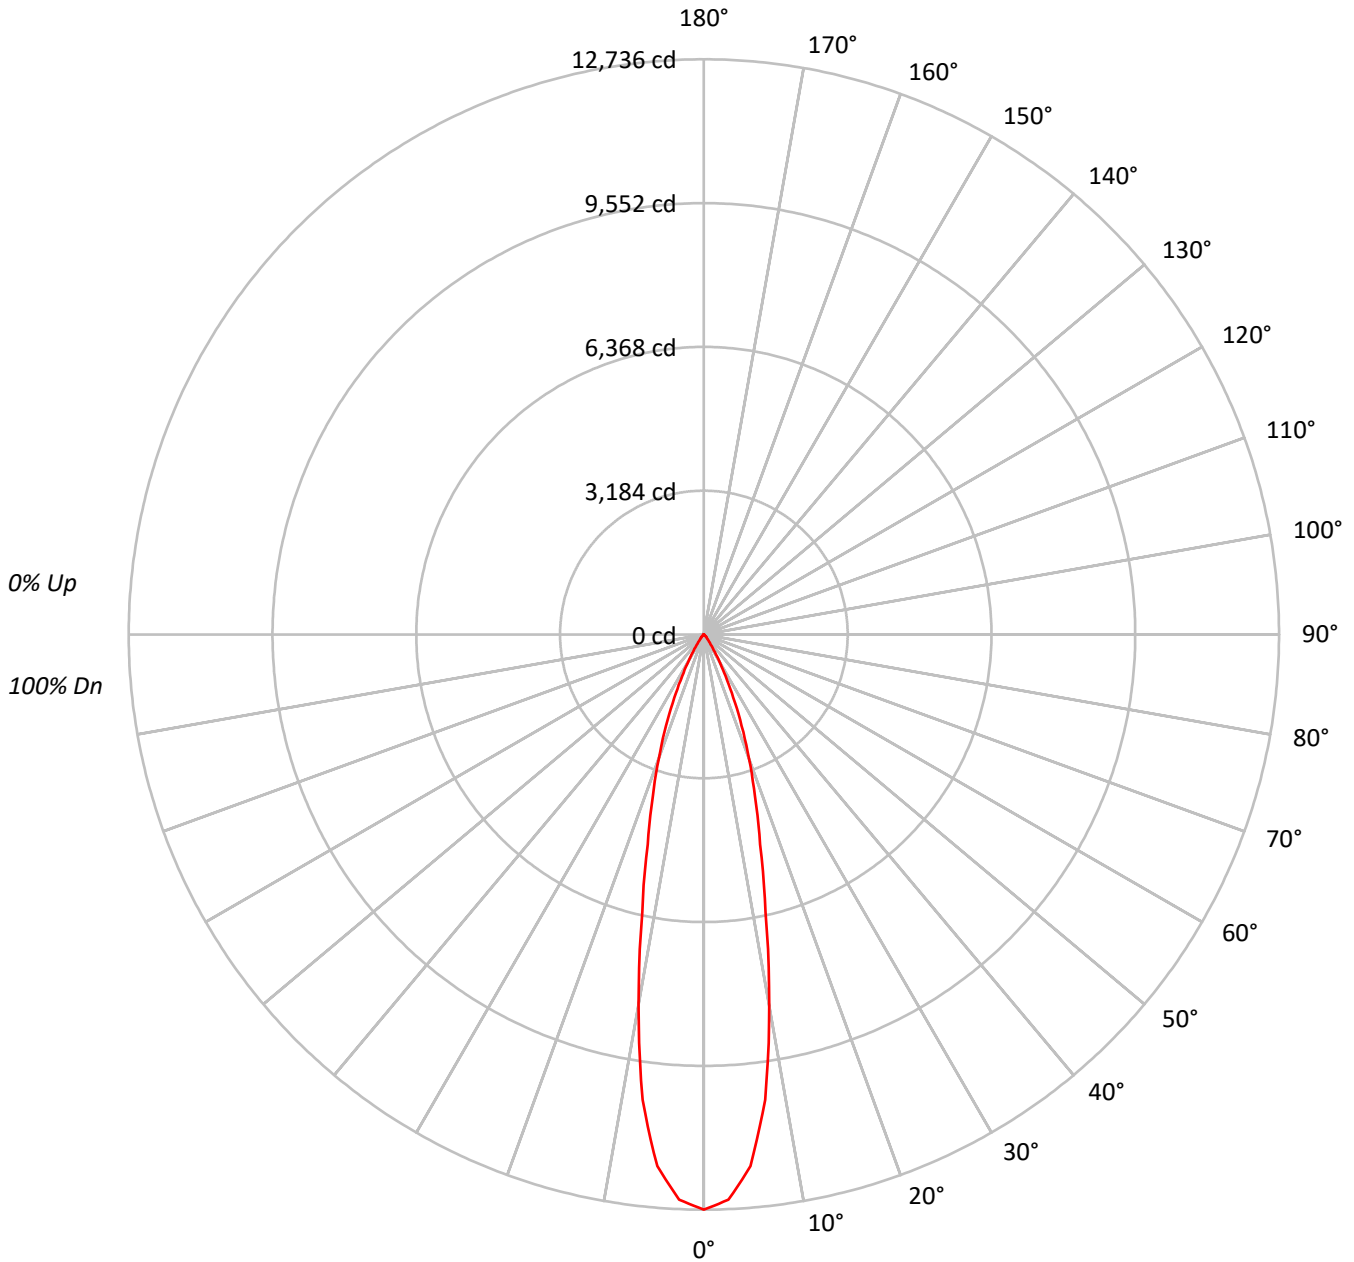



TEST NUMBER: P792279

CATALOG NUMBER: LER6D40BD010-EC6DR2540509050-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1391523
5°	1296022
10°	924493
15°	544491
20°	338784
25°	185933
30°	85034
35°	32199
40°	14577
45°	8761
50°	3638
55°	2343
60°	1639
65°	1112
70°	160
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8761 cd/sqm



TEST NUMBER: P792279

CATALOG NUMBER: LER6D40BD010-EC6DR2540509050-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1015.5	30.2
10°-20°	1375.5	41.0
20°-30°	727.9	21.7
30°-40°	179.7	5.4
40°-50°	43.8	1.3
50°-60°	11.5	0.3
60°-70°	3.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3118.9	92.9
0°-40°	3298.6	98.2
0°-60°	3353.9	99.9
0°-90°	3357.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3357.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12736	
5°	11817	###
15°	4814	1375
25°	1542	728
35°	241	180
45°	57	44
55°	12	12
65°	4	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792279

CATALOG NUMBER: LER6D40BD010-EC6DR2540509050-6LBDP1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	12735.8
2.5°	12526.5
5°	11816.6
7.5°	10390.5
10°	8332.8
12.5°	6299.1
15°	4813.6
17.5°	3751.5
20°	2913.7
22.5°	2185.2
25°	1542.3
27.5°	1034.2
30°	674.0
32.5°	410.1
35°	241.4
37.5°	147.7
40°	102.2
42.5°	78.2
45°	56.7
47.5°	34.3
50°	21.4
52.5°	15.5
55°	12.3
57.5°	9.6
60°	7.5
62.5°	5.9
65°	4.3
67.5°	1.6
70°	0.5
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)