

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792288

Luminaire Tested: LER6D40BD010-EC6DR3040509024-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792288
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR3040509024-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3746.0 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792288

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBDP1H

Luminous Intensity Polar Plot

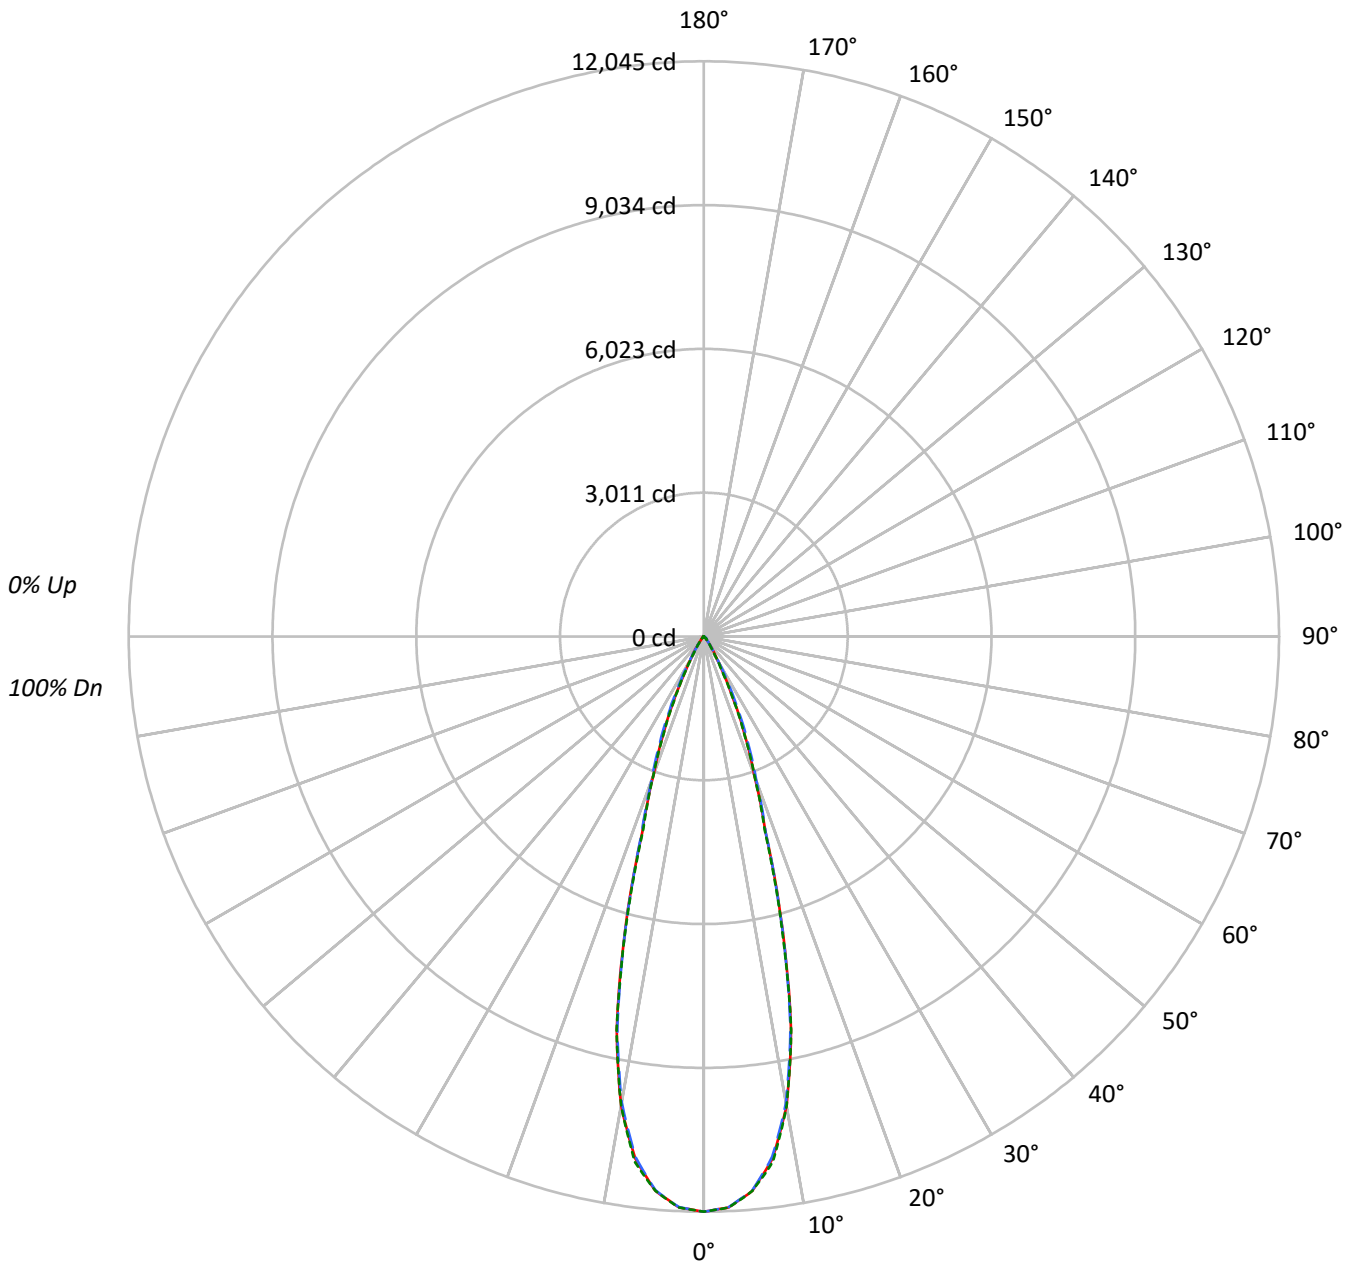



TEST NUMBER: P792288

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	921981	921981	921981
5°	895513	894468	895559
10°	775656	770185	775470
15°	506073	503355	500827
20°	251649	261090	251307
25°	126760	142942	124168
30°	50750	55302	44219
35°	23538	22548	18903
40°	10162	11291	9572
45°	7166	8898	7231
50°	2465	6478	2608
55°	1415	2682	1495
60°	995	1179	995
65°	634	634	634
70°	403	269	403
75°	0	177	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 8898 cd/sqm



TEST NUMBER: P792288

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1059.2	28.3
10°-20°	1705.8	45.5
20°-30°	737.1	19.7
30°-40°	168.0	4.5
40°-50°	57.7	1.5
50°-60°	14.1	0.4
60°-70°	3.6	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3502.2	93.5
0°-40°	3670.2	98.0
0°-60°	3742.0	99.9
0°-90°	3746.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3746.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	12045	12045	12045	12045	12045	
5°	11655	11644	11641	11666	11656	1060
15°	6386	6309	6352	6331	6320	1710
25°	1501	1558	1692	1518	1470	718
35°	252	257	241	240	202	171
45°	66	82	82	82	67	47
55°	11	11	20	12	11	10
65°	4	4	4	4	4	3
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P792288

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	12045.2	12045.2	12045.2	12045.2	12045.2
2.5°	11965.4	11957.1	11961.9	11967.8	11970.1
5°	11654.9	11643.7	11641.3	11665.6	11655.5
7.5°	11028.7	11012.7	10988.4	11043.4	11094.9
10°	9979.6	9961.8	9909.2	9935.2	9977.2
12.5°	8430.7	8373.4	8372.2	8455.0	8443.7
15°	6386.3	6309.4	6352.0	6331.3	6320.1
17.5°	4294.6	4265.0	4321.8	4304.7	4230.7
20°	3089.4	3097.1	3205.3	3150.9	3085.2
22.5°	2254.3	2282.1	2410.5	2270.3	2218.9
25°	1500.9	1557.7	1692.5	1518.1	1470.2
27.5°	923.1	949.2	1085.8	911.3	885.3
30°	574.2	561.2	625.7	537.0	500.3
32.5°	376.7	360.2	380.8	341.8	312.2
35°	251.9	257.3	241.3	239.5	202.3
37.5°	157.3	181.0	159.7	170.3	130.1
40°	101.7	131.3	113.0	124.8	95.8
42.5°	83.4	101.1	92.8	98.8	85.2
45°	66.2	82.2	82.2	82.2	66.8
47.5°	36.7	55.0	70.4	56.2	39.0
50°	20.7	27.8	54.4	29.0	21.9
52.5°	14.2	16.0	37.3	16.6	14.8
55°	10.6	11.2	20.1	11.8	11.2
57.5°	8.3	8.9	10.6	8.9	8.3
60°	6.5	6.5	7.7	7.1	6.5
62.5°	4.7	4.7	5.3	4.7	4.7
65°	3.5	3.5	3.5	3.5	3.5
67.5°	1.8	2.4	2.4	2.4	2.4
70°	1.8	1.2	1.2	1.2	1.8
72.5°	1.2	0.6	0.6	0.6	0.6
75°	0.0	0.0	0.6	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)