

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792291

Luminaire Tested: LER6D40BD010-EC6DR3040509024-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792291
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR3040509024-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3697.1 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792291

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBS1B

Luminous Intensity Polar Plot

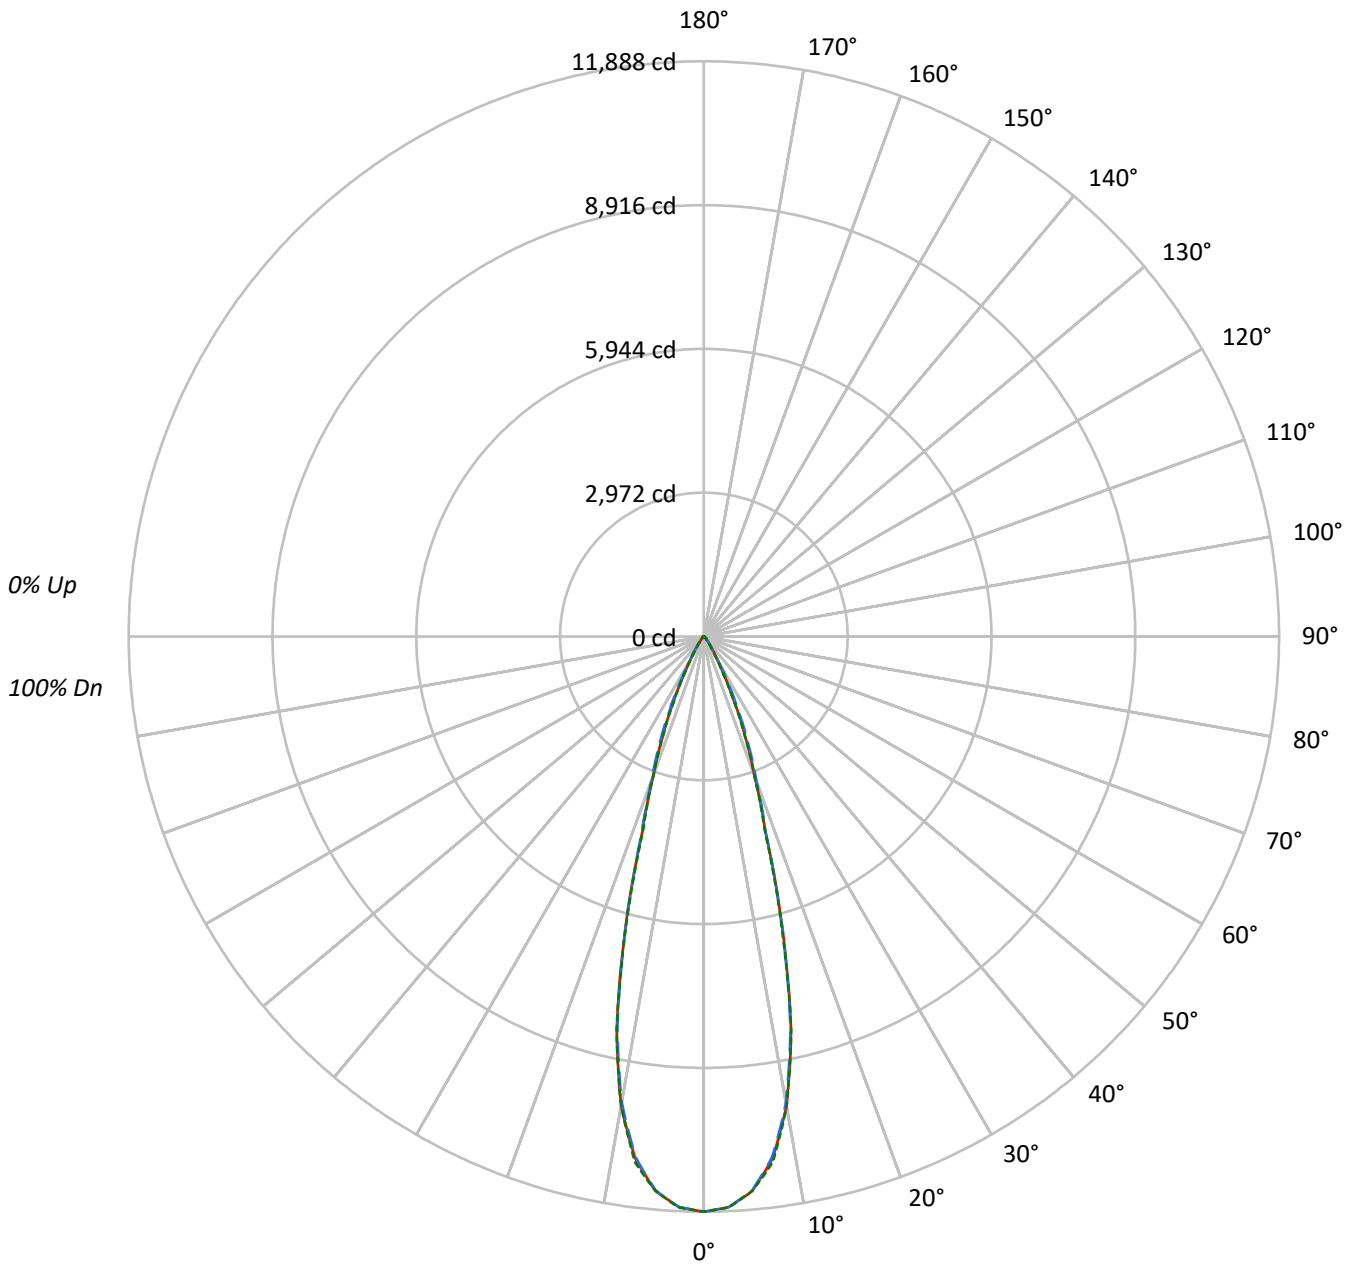



TEST NUMBER: P792291

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	909933	909933	909933
5°	883804	882774	883850
10°	765513	760112	765327
15°	499456	496778	494282
20°	248359	257677	248025
25°	125105	141076	122546
30°	50088	54578	43644
35°	23230	22249	18651
40°	10032	11141	9452
45°	7079	8779	7144
50°	2429	6395	2572
55°	1401	2642	1481
60°	980	1163	980
65°	634	634	634
70°	403	269	403
75°	0	177	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 8779 cd/sqm



TEST NUMBER: P792291

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1045.3	28.3
10°-20°	1683.5	45.5
20°-30°	727.5	19.7
30°-40°	165.8	4.5
40°-50°	56.9	1.5
50°-60°	13.9	0.4
60°-70°	3.6	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3456.4	93.5
0°-40°	3622.2	98.0
0°-60°	3693.1	99.9
0°-90°	3697.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3697.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	11888	11888	11888	11888	11888	
5°	11502	11492	11489	11513	11503	1046
15°	6303	6227	6269	6248	6238	1688
25°	1481	1537	1670	1498	1451	709
35°	249	254	238	236	200	169
45°	65	81	81	81	66	46
55°	10	11	20	12	11	10
65°	4	4	4	4	4	3
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P792291

CATALOG NUMBER: LER6D40BD010-EC6DR3040509024-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	11887.8	11887.8	11887.8	11887.8	11887.8
2.5°	11809.0	11800.8	11805.5	11811.3	11813.6
5°	11502.5	11491.5	11489.1	11513.1	11503.1
7.5°	10884.5	10868.7	10844.8	10899.1	10949.8
10°	9849.1	9831.6	9779.6	9805.3	9846.7
12.5°	8320.5	8263.9	8262.7	8344.4	8333.3
15°	6302.8	6226.9	6269.0	6248.5	6237.5
17.5°	4238.5	4209.3	4265.3	4248.4	4175.4
20°	3049.0	3056.6	3163.4	3109.7	3044.9
22.5°	2224.9	2252.3	2379.0	2240.6	2189.8
25°	1481.3	1537.3	1670.4	1498.2	1451.0
27.5°	911.1	936.8	1071.6	899.4	873.7
30°	566.7	553.9	617.5	530.0	493.8
32.5°	371.8	355.4	375.9	337.3	308.2
35°	248.6	253.9	238.1	236.4	199.6
37.5°	155.3	178.6	157.6	168.1	128.4
40°	100.4	129.6	111.5	123.1	94.6
42.5°	82.3	99.8	91.6	97.5	84.0
45°	65.4	81.1	81.1	81.1	66.0
47.5°	36.2	54.3	69.5	55.4	38.5
50°	20.4	27.4	53.7	28.6	21.6
52.5°	14.0	15.8	36.8	16.3	14.6
55°	10.5	11.1	19.8	11.7	11.1
57.5°	8.2	8.8	10.5	8.8	8.2
60°	6.4	6.4	7.6	7.0	6.4
62.5°	4.7	4.7	5.3	4.7	4.7
65°	3.5	3.5	3.5	3.5	3.5
67.5°	1.8	2.3	2.3	2.3	2.3
70°	1.8	1.2	1.2	1.2	1.8
72.5°	1.2	0.6	0.6	0.6	0.6
75°	0.0	0.0	0.6	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)