

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792353

Luminaire Tested: LER6D40BD010-EC6DR3540509030-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792353
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR3540509030-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4489.8 lumens
Efficiency: N/A
Efficacy: 127.6 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792353

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBDP1LI

Luminous Intensity Polar Plot

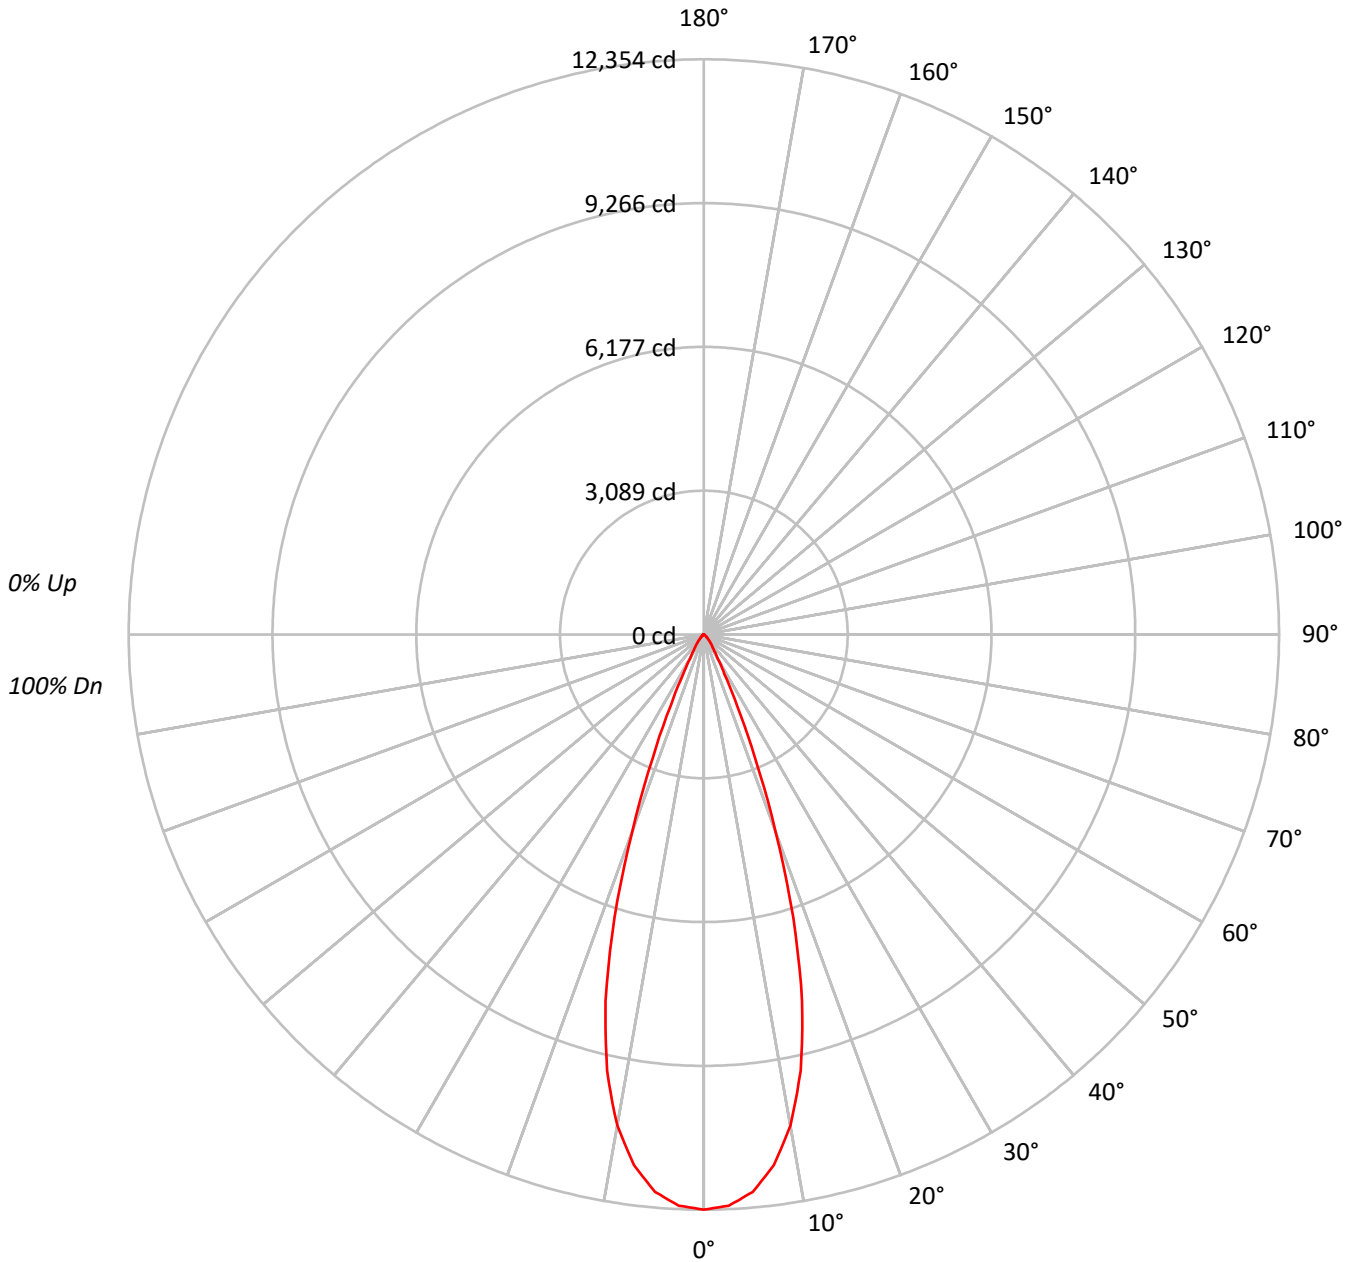



TEST NUMBER: P792353

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96	96	96	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92	92	92	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88	88	88	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84	84	84	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81	81	81	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78	78	78	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75	75	75	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72	72	72	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70	70	70	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68	68	68	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1349753
5°	1318046
10°	1187902
15°	922001
20°	522949
25°	203450
30°	75900
35°	41602
40°	27200
45°	16549
50°	10539
55°	7448
60°	5441
65°	2973
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16549 cd/sqm



TEST NUMBER: P792353

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1105.2	24.6
10°-20°	2157.9	48.1
20°-30°	880.1	19.6
30°-40°	210.6	4.7
40°-50°	87.8	2.0
50°-60°	36.3	0.8
60°-70°	11.4	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4143.2	92.3
0°-40°	4353.8	97.0
0°-60°	4478.0	99.7
0°-90°	4489.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4489.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12354	
5°	12017	###
15°	8151	2158
25°	1688	880
35°	312	211
45°	107	88
55°	39	36
65°	12	11
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792353

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	12353.5
2.5°	12279.4
5°	12017.4
7.5°	11494.6
10°	10707.0
12.5°	9598.1
15°	8151.0
17.5°	6381.2
20°	4497.6
22.5°	2867.9
25°	1687.6
27.5°	954.0
30°	601.6
32.5°	422.4
35°	311.9
37.5°	241.2
40°	190.7
42.5°	146.9
45°	107.1
47.5°	80.2
50°	62.0
52.5°	49.2
55°	39.1
57.5°	31.7
60°	24.9
62.5°	18.2
65°	11.5
67.5°	4.0
70°	0.7
72.5°	0.7
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.7
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)