

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792357

Luminaire Tested: LER6D40BD010-EC6DR3540509030-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792357  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D40BD010-EC6DR3540509030-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 35° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4726.1 lumens  
Efficiency: N/A  
Efficacy: 134.3 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 35.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P792357  
CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBS1LI

### Luminous Intensity Polar Plot

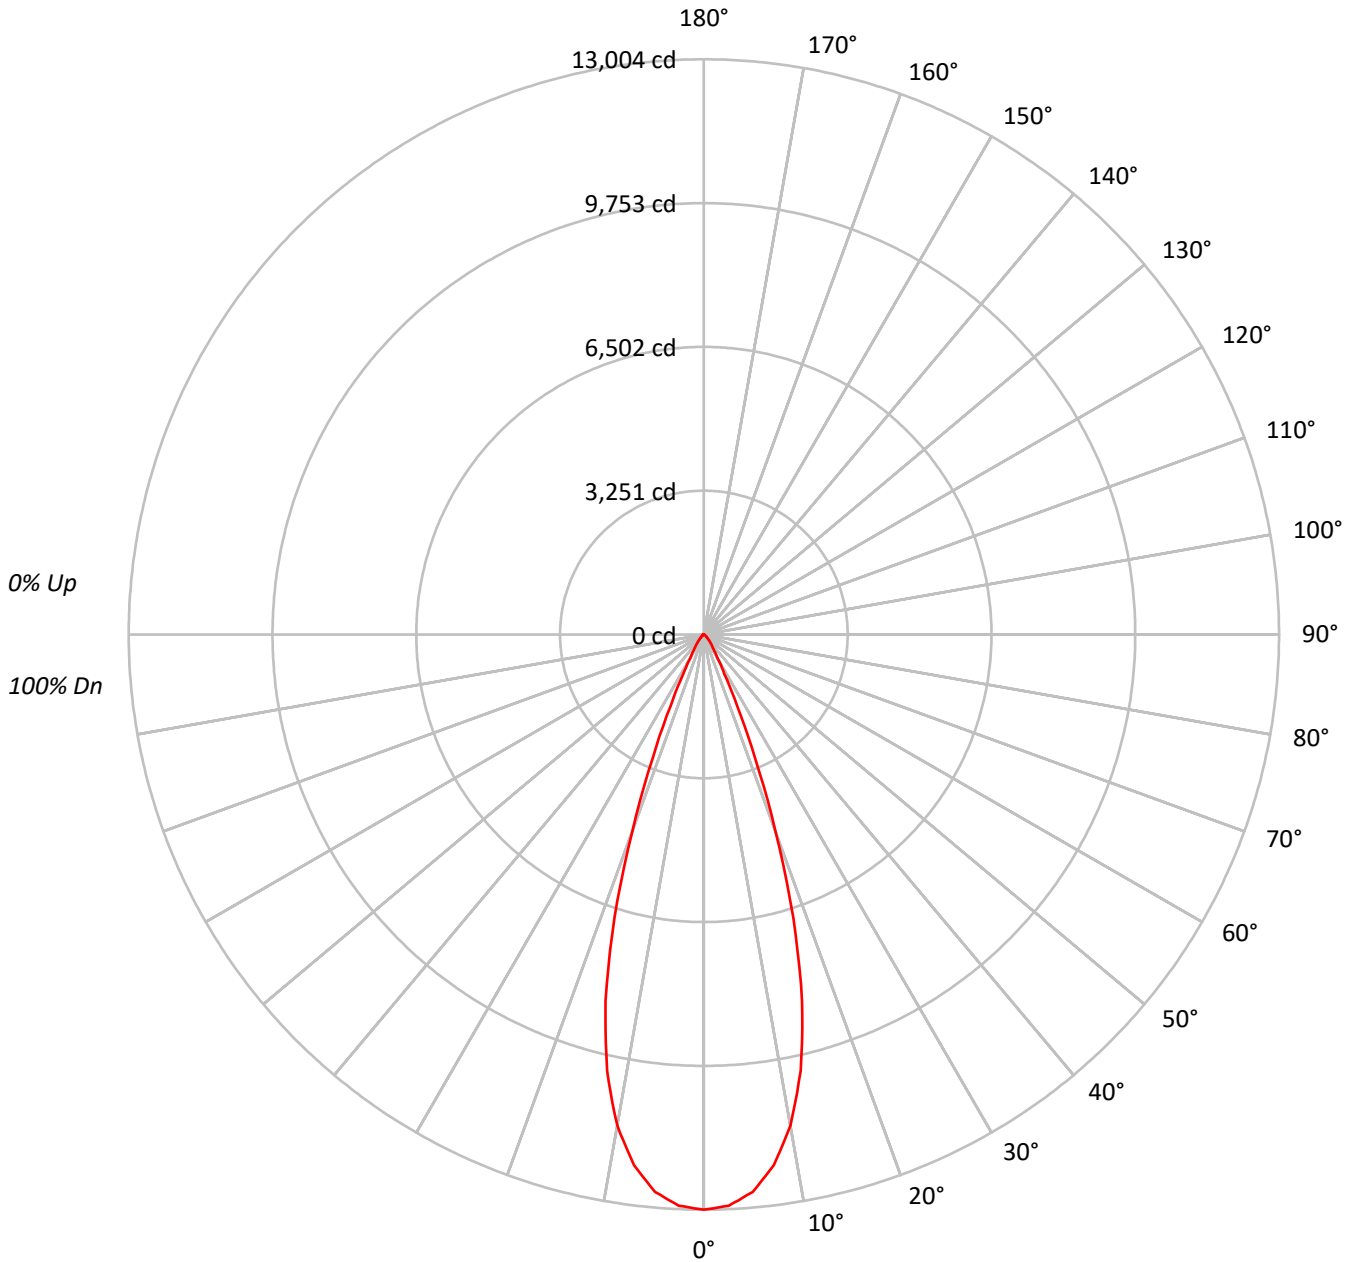



TEST NUMBER: P792357  
 CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1420794
5°	1387417
10°	1250431
15°	970527
20°	550471
25°	214156
30°	79899
35°	43790
40°	28626
45°	17430
50°	11083
55°	7829
60°	5725
65°	3128
70°	224
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 17430 cd/sqm



TEST NUMBER: P792357

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1163.4	24.6
10°-20°	2271.5	48.1
20°-30°	926.4	19.6
30°-40°	221.7	4.7
40°-50°	92.4	2.0
50°-60°	38.2	0.8
60°-70°	12.0	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4361.3	92.3
0°-40°	4583.0	97.0
0°-60°	4713.6	99.7
0°-90°	4726.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4726.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	13004	
5°	12650	###
15°	8580	2271
25°	1776	926
35°	328	222
45°	113	92
55°	41	38
65°	12	12
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792357

CATALOG NUMBER: LER6D40BD010-EC6DR3540509030-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	13003.7
2.5°	12925.7
5°	12649.9
7.5°	12099.6
10°	11270.6
12.5°	10103.3
15°	8580.0
17.5°	6717.1
20°	4734.3
22.5°	3018.9
25°	1776.4
27.5°	1004.2
30°	633.3
32.5°	444.6
35°	328.3
37.5°	253.9
40°	200.7
42.5°	154.6
45°	112.8
47.5°	84.4
50°	65.2
52.5°	51.8
55°	41.1
57.5°	33.3
60°	26.2
62.5°	19.1
65°	12.1
67.5°	4.3
70°	0.7
72.5°	0.7
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.7
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)