

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792440

Luminaire Tested: LER6D40BD010-EC6DR4540509027-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792440
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR4540509027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4450.6 lumens
Efficiency: N/A
Efficacy: 126.4 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792440

CATALOG NUMBER: LER6D40BD010-EC6DR4540509027-6LBDP1H

Luminous Intensity Polar Plot

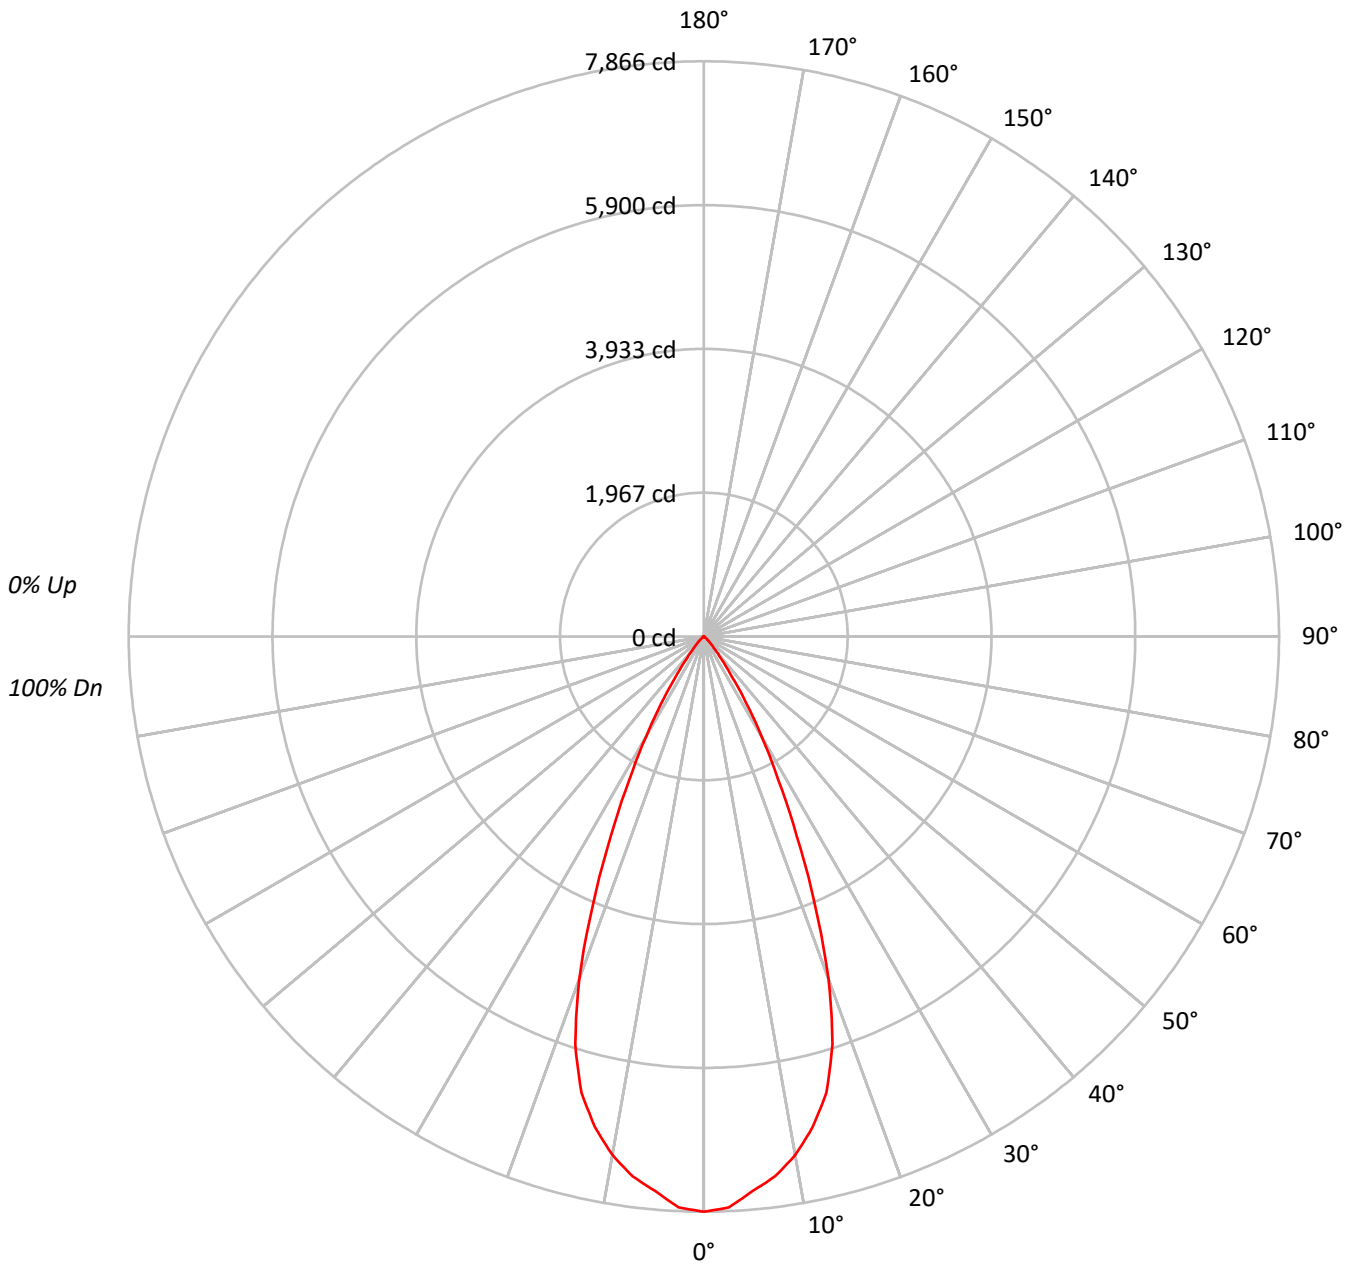



TEST NUMBER: P792440

CATALOG NUMBER: LER6D40BD010-EC6DR4540509027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95				95															
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90				90															
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85				85															
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81				81															
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77				77															
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73				73															
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69				69															
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66				66															
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63				63															
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60				60															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	859500
5°	835023
10°	798891
15°	731153
20°	580062
25°	362138
30°	199603
35°	89620
40°	35301
45°	16642
50°	7887
55°	4134
60°	2032
65°	491
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16642 cd/sqm



TEST NUMBER: P792440

CATALOG NUMBER: LER6D40BD010-EC6DR4540509027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	715.4	16.1
10°-20°	1760.6	39.6
20°-30°	1394.2	31.3
30°-40°	464.3	10.4
40°-50°	92.1	2.1
50°-60°	20.9	0.5
60°-70°	3.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3870.1	87.0
0°-40°	4334.4	97.4
0°-60°	4447.5	99.9
0°-90°	4450.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4450.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7866	
5°	7613	715
15°	6464	1761
25°	3004	1394
35°	672	464
45°	108	92
55°	22	21
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792440

CATALOG NUMBER: LER6D40BD010-EC6DR4540509027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	7866.5
2.5°	7815.1
5°	7613.4
7.5°	7447.0
10°	7200.7
12.5°	6872.8
15°	6463.8
17.5°	5848.8
20°	4988.8
22.5°	3964.2
25°	3003.9
27.5°	2199.6
30°	1582.1
32.5°	1076.0
35°	671.9
37.5°	398.5
40°	247.5
42.5°	162.7
45°	107.7
47.5°	69.3
50°	46.4
52.5°	30.9
55°	21.7
57.5°	14.2
60°	9.3
62.5°	4.9
65°	1.9
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)