

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792493

Luminaire Tested: LER6D40BD010-EC6DR5040509027-6LBS1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792493  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D40BD010-EC6DR5040509027-6LBS1LI  
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4982.2 lumens  
Efficiency: N/A  
Efficacy: 141.5 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 35.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P792493

CATALOG NUMBER: LER6D40BD010-EC6DR5040509027-6LBS1LI

### Luminous Intensity Polar Plot

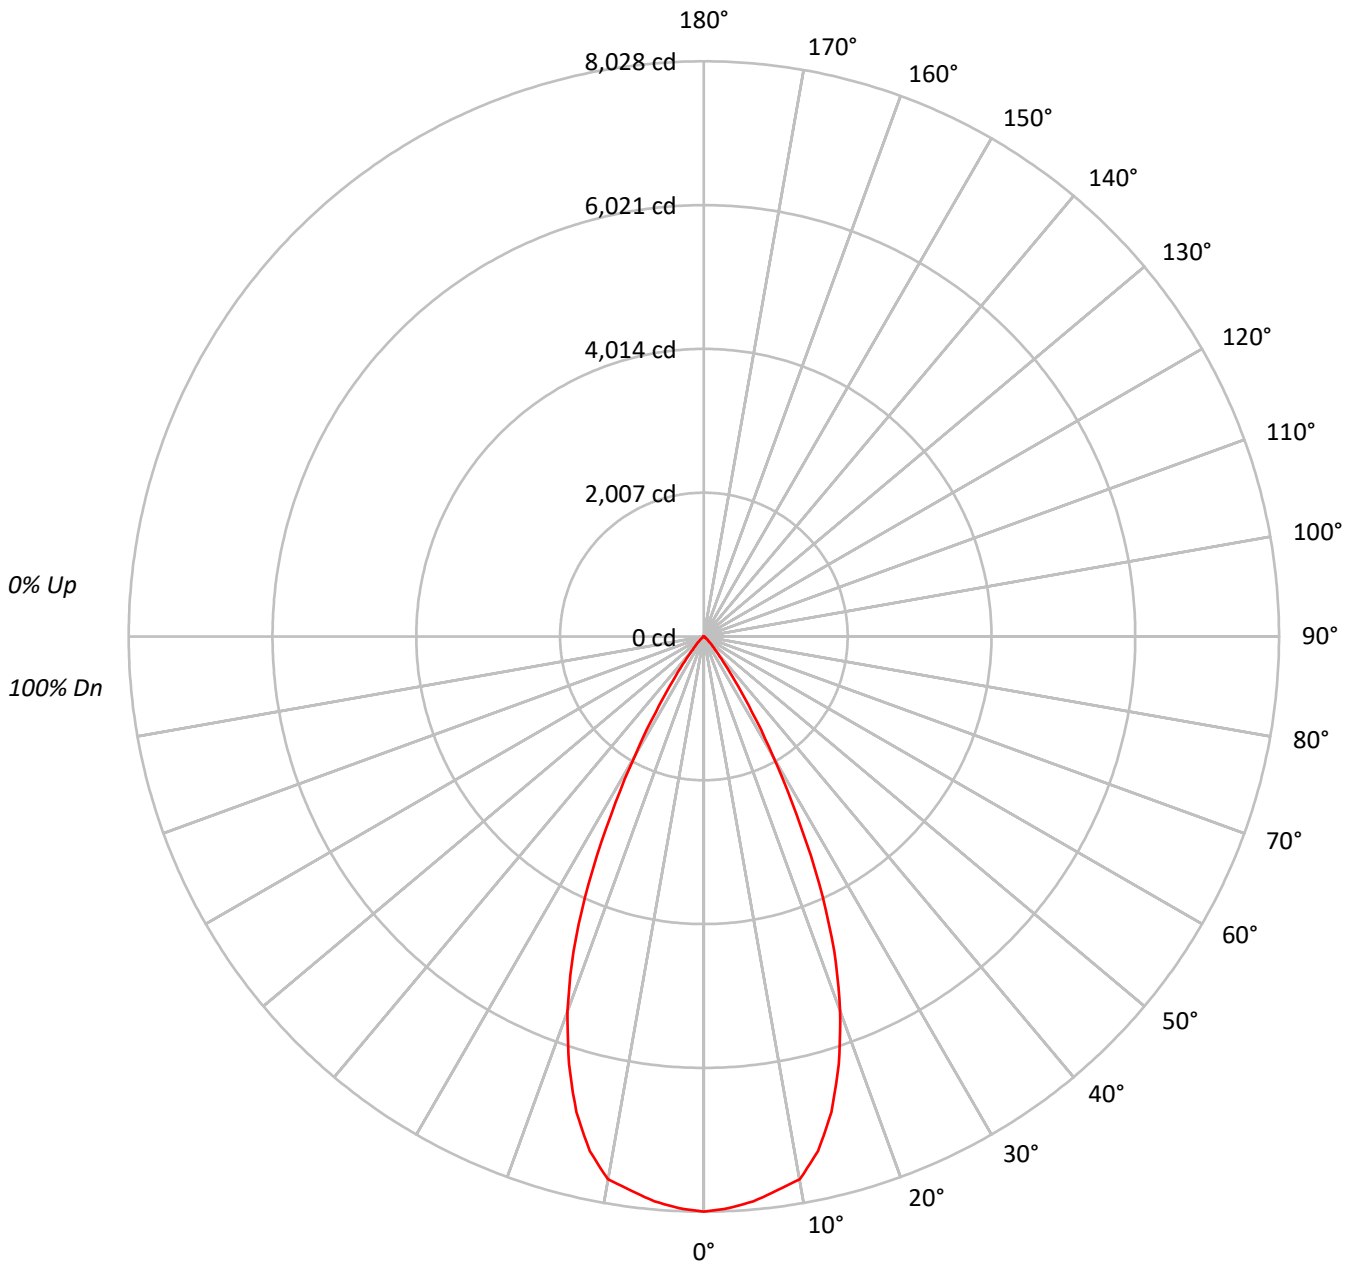



TEST NUMBER: P792493  
 CATALOG NUMBER: LER6D40BD010-EC6DR5040509027-6LBS1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			95
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			90
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			85
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			80
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			76
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			72
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			69
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			65
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			62
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			59

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	877102
5°	867905
10°	853621
15°	777281
20°	646791
25°	459125
30°	243016
35°	99037
40°	36784
45°	16842
50°	6901
55°	3619
60°	1770
65°	517
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 16842 cd/sqm



TEST NUMBER: P792493

CATALOG NUMBER: LER6D40BD010-EC6DR5040509027-6LBS1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	748.0	15.0
10°-20°	1890.3	37.9
20°-30°	1698.0	34.1
30°-40°	531.6	10.7
40°-50°	93.1	1.9
50°-60°	18.6	0.4
60°-70°	2.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4336.2	87.0
0°-40°	4867.8	97.7
0°-60°	4979.4	99.9
0°-90°	4982.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4982.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	8028	
5°	7913	748
15°	6872	1890
25°	3808	1698
35°	742	532
45°	109	93
55°	19	19
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792493

CATALOG NUMBER: LER6D40BD010-EC6DR5040509027-6LBS1LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	8027.6
2.5°	7987.7
5°	7913.2
7.5°	7799.5
10°	7694.0
12.5°	7355.5
15°	6871.6
17.5°	6257.1
20°	5562.7
22.5°	4759.3
25°	3808.4
27.5°	2800.0
30°	1926.2
32.5°	1254.1
35°	742.5
37.5°	426.4
40°	257.9
42.5°	167.8
45°	109.0
47.5°	66.3
50°	40.6
52.5°	27.7
55°	19.0
57.5°	12.9
60°	8.1
62.5°	4.7
65°	2.0
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)