

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792520

Luminaire Tested: LER6D40BD010-EC6DR5040509050-6LBDP1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792520  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D40BD010-EC6DR5040509050-6LBDP1H  
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 50° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4947.4 lumens  
Efficiency: N/A  
Efficacy: 140.6 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 35.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P792520

CATALOG NUMBER: LER6D40BD010-EC6DR5040509050-6LBDP1H

### Luminous Intensity Polar Plot

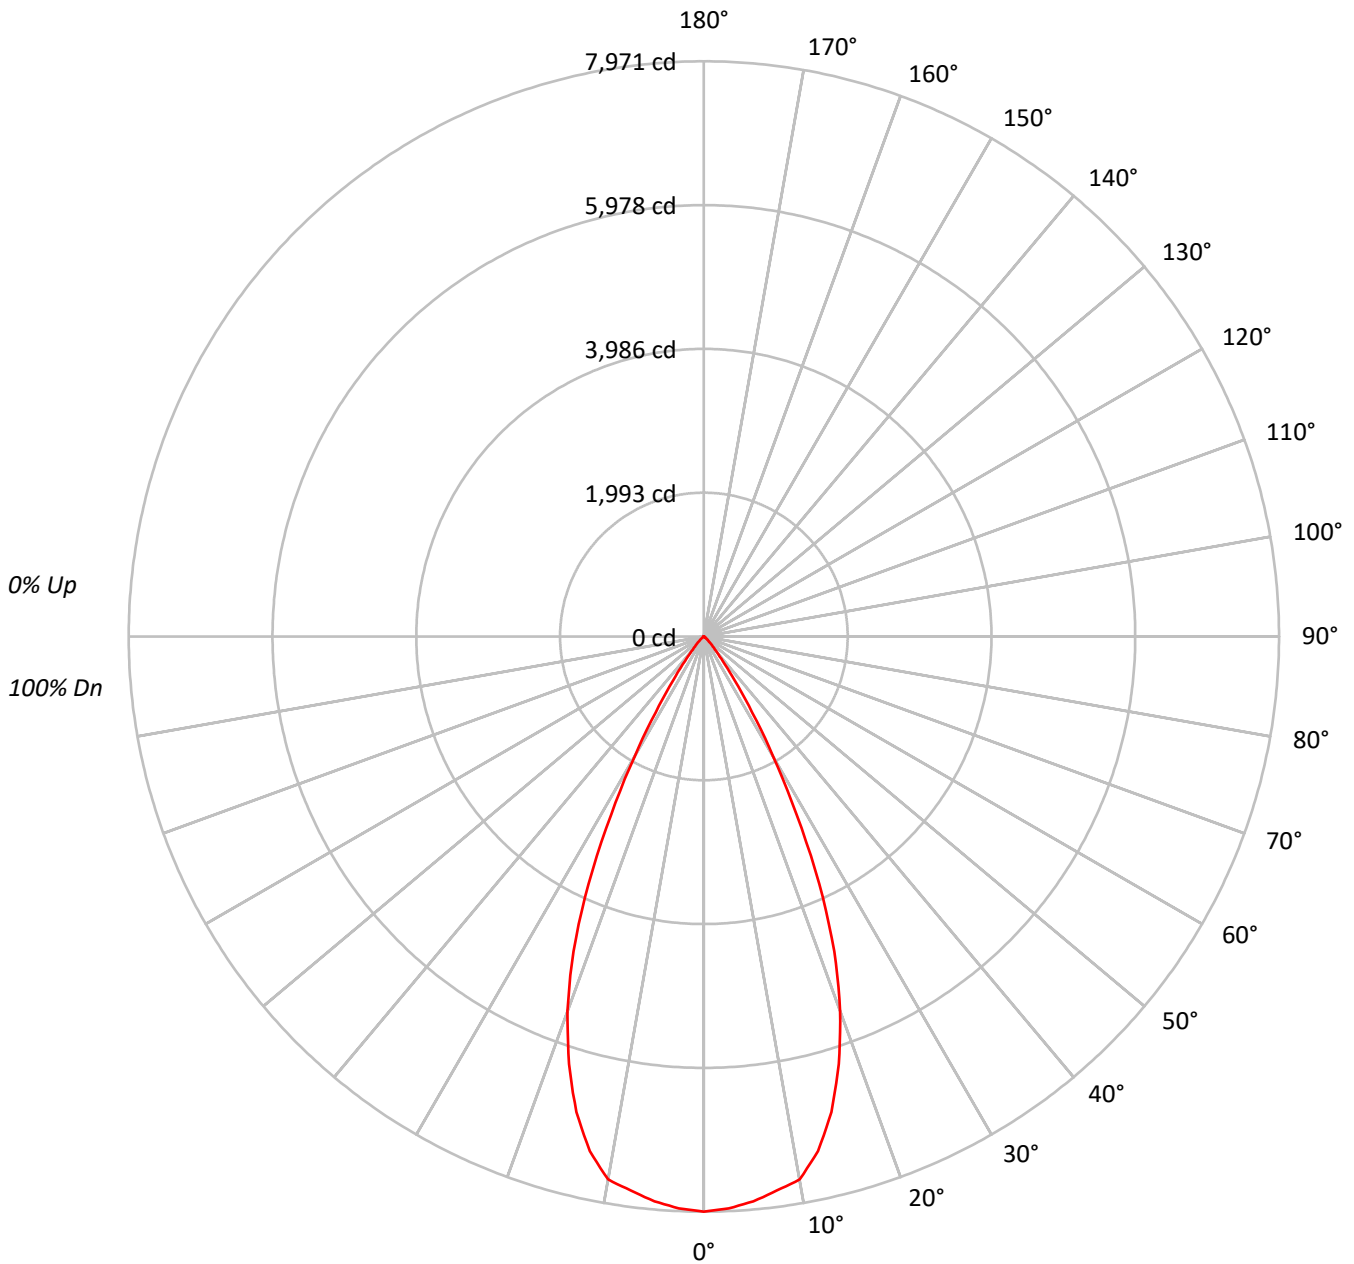



TEST NUMBER: P792520

CATALOG NUMBER: LER6D40BD010-EC6DR5040509050-6LBDP1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	870961
5°	861840
10°	847641
15°	771841
20°	642268
25°	455906
30°	241313
35°	98343
40°	36527
45°	16719
50°	6850
55°	3581
60°	1770
65°	517
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 16719 cd/sqm



TEST NUMBER: P792520

CATALOG NUMBER: LER6D40BD010-EC6DR5040509050-6LBDP1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	742.7	15.0
10°-20°	1877.0	37.9
20°-30°	1686.1	34.1
30°-40°	527.9	10.7
40°-50°	92.4	1.9
50°-60°	18.4	0.4
60°-70°	2.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4305.8	87.0
0°-40°	4833.7	97.7
0°-60°	4944.6	99.9
0°-90°	4947.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4947.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7971	
5°	7858	743
15°	6824	1877
25°	3782	1686
35°	737	528
45°	108	92
55°	19	18
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792520

CATALOG NUMBER: LER6D40BD010-EC6DR5040509050-6LBDP1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	7971.4
2.5°	7931.8
5°	7857.9
7.5°	7744.9
10°	7640.1
12.5°	7304.1
15°	6823.5
17.5°	6213.3
20°	5523.8
22.5°	4726.0
25°	3781.7
27.5°	2780.4
30°	1912.7
32.5°	1245.3
35°	737.3
37.5°	423.4
40°	256.1
42.5°	166.7
45°	108.2
47.5°	65.9
50°	40.3
52.5°	27.6
55°	18.8
57.5°	12.8
60°	8.1
62.5°	4.7
65°	2.0
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)