

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792569

Luminaire Tested: LER6D40BD010-EC6DR5540509050-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792569
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR5540509050-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5120.6 lumens
Efficiency: N/A
Efficacy: 145.5 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792569

CATALOG NUMBER: LER6D40BD010-EC6DR5540509050-6LBDP1LI

Luminous Intensity Polar Plot

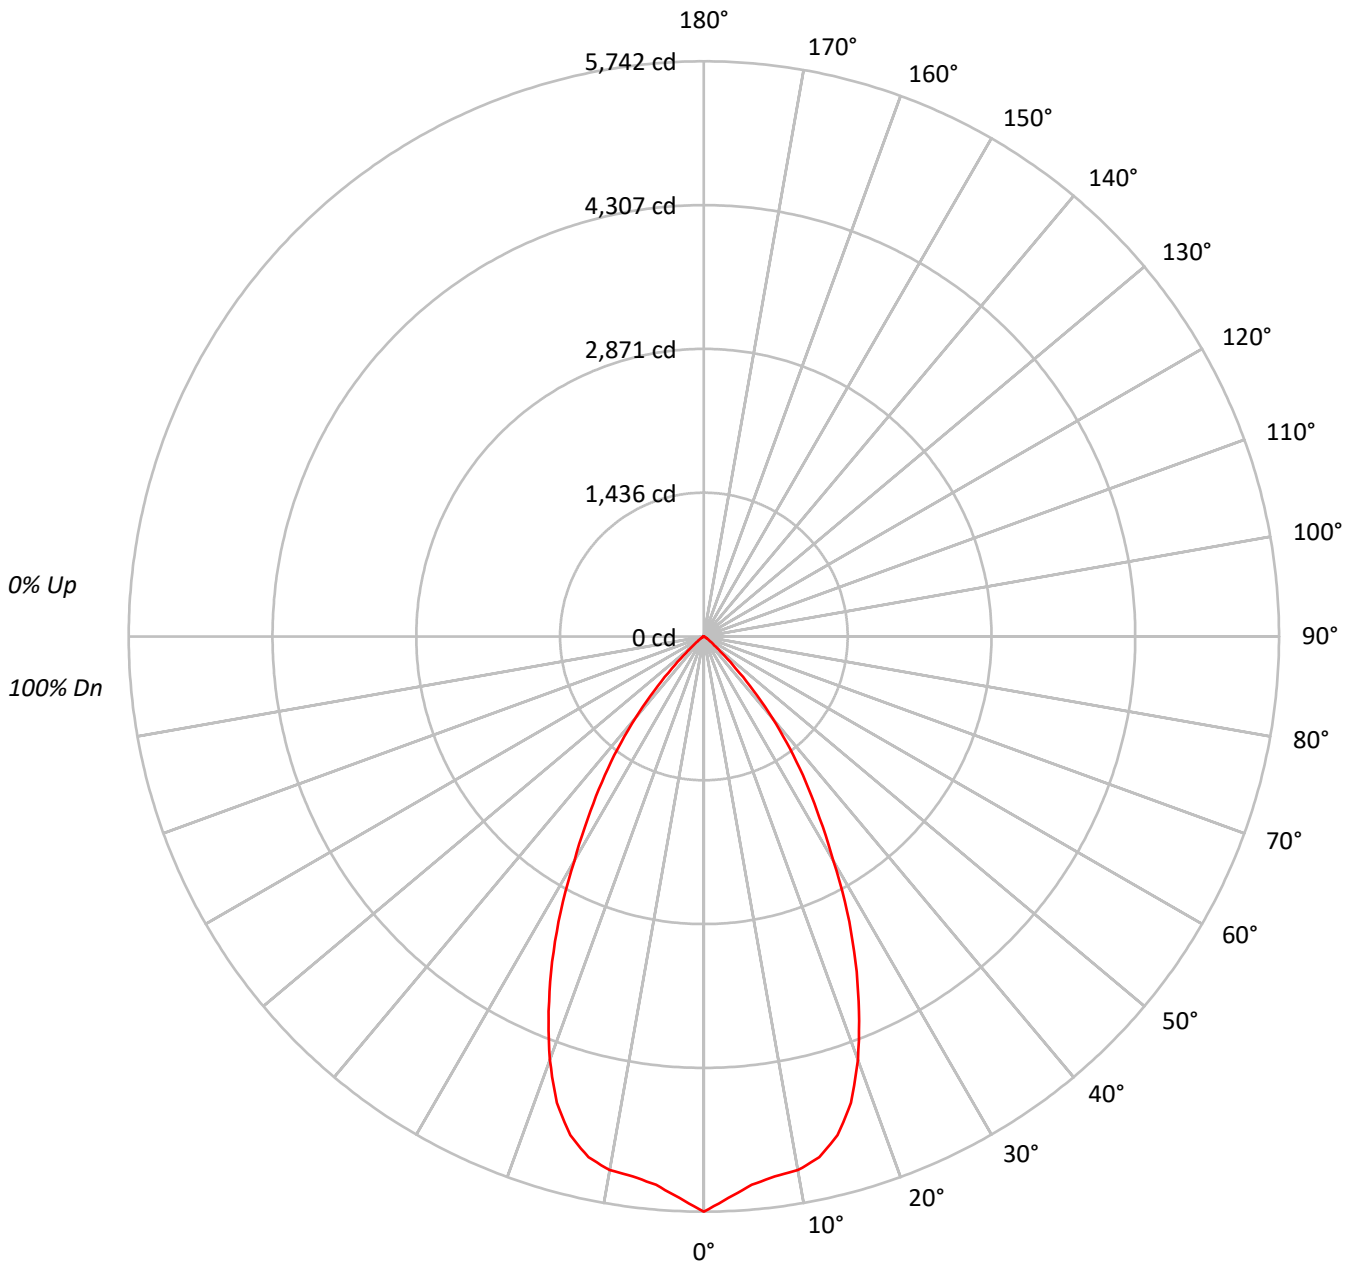



TEST NUMBER: P792569

CATALOG NUMBER: LER6D40BD010-EC6DR5540509050-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94																			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87																			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81																			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75																			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70																			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65																			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61																			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57																			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54																			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	627375
5°	602451
10°	600186
15°	582950
20°	522693
25°	431976
30°	326309
35°	236594
40°	151416
45°	69147
50°	22624
55°	9753
60°	4196
65°	543
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 69147 cd/sqm



TEST NUMBER: P792569

CATALOG NUMBER: LER6D40BD010-EC6DR5540509050-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	522.7	10.2
10°-20°	1426.5	27.9
20°-30°	1625.6	31.7
30°-40°	1106.7	21.6
40°-50°	381.3	7.4
50°-60°	52.7	1.0
60°-70°	5.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3574.8	69.8
0°-40°	4681.5	91.4
0°-60°	5115.5	99.9
0°-90°	5120.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5120.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5742	
5°	5493	523
15°	5154	1427
25°	3583	1626
35°	1774	1107
45°	448	381
55°	51	53
65°	2	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792569

CATALOG NUMBER: LER6D40BD010-EC6DR5540509050-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	5742.0
2.5°	5610.3
5°	5492.9
7.5°	5435.3
10°	5409.7
12.5°	5324.3
15°	5153.6
17.5°	4882.5
20°	4495.4
22.5°	4048.6
25°	3583.2
27.5°	3098.7
30°	2586.4
32.5°	2152.4
35°	1773.8
37.5°	1413.8
40°	1061.6
42.5°	735.7
45°	447.5
47.5°	241.2
50°	133.1
52.5°	79.0
55°	51.2
57.5°	32.7
60°	19.2
62.5°	8.5
65°	2.1
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)