

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792634

Luminaire Tested: LER6D40BD010-EC6DR6540509027-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P792634
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR6540509027-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3285.2 lumens
Efficiency: N/A
Efficacy: 93.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792634

CATALOG NUMBER: LER6D40BD010-EC6DR6540509027-6LBDP1MW

Luminous Intensity Polar Plot

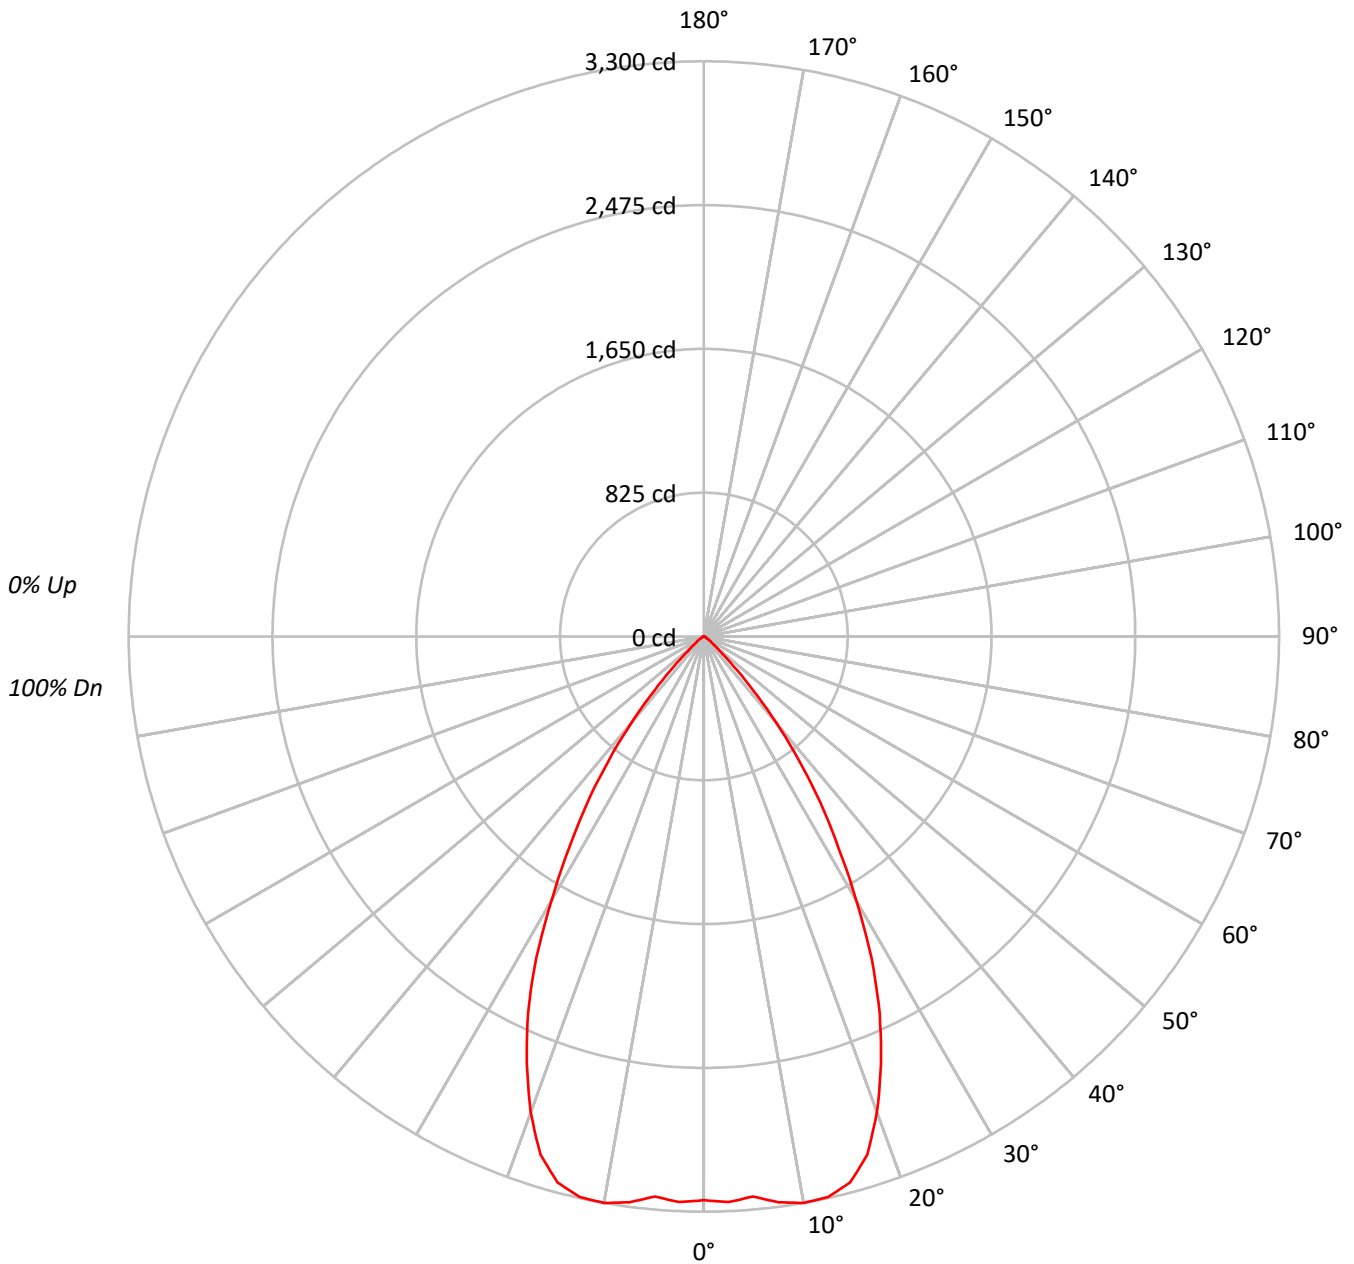



TEST NUMBER: P792634

CATALOG NUMBER: LER6D40BD010-EC6DR6540509027-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	353404
5°	353701
10°	366145
15°	366753
20°	337656
25°	287707
30°	220244
35°	155604
40°	91854
45°	37285
50°	13513
55°	7524
60°	4327
65°	2379
70°	2492
75°	1942
80°	2013
85°	1755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 37285 cd/sqm



TEST NUMBER: P792634

CATALOG NUMBER: LER6D40BD010-EC6DR6540509027-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	311.5	9.5
10°-20°	898.4	27.3
20°-30°	1077.9	32.8
30°-40°	724.4	22.1
40°-50°	216.9	6.6
50°-60°	38.3	1.2
60°-70°	10.9	0.3
70°-80°	5.3	0.2
80°-90°	1.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2287.8	69.6
0°-40°	3012.2	91.7
0°-60°	3267.3	99.5
0°-90°	3285.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3285.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3234	
5°	3225	311
15°	3242	898
25°	2386	1078
35°	1167	724
45°	241	217
55°	40	38
65°	9	11
75°	5	5
85°	1	2
90°	0	



TEST NUMBER: P792634

CATALOG NUMBER: LER6D40BD010-EC6DR6540509027-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	3234.5
2.5°	3248.3
5°	3224.9
7.5°	3273.6
10°	3300.2
12.5°	3293.8
15°	3242.3
17.5°	3116.4
20°	2904.0
22.5°	2654.0
25°	2386.5
27.5°	2084.5
30°	1745.7
32.5°	1438.7
35°	1166.6
37.5°	897.7
40°	644.0
42.5°	420.6
45°	241.3
47.5°	127.8
50°	79.5
52.5°	55.2
55°	39.5
57.5°	28.5
60°	19.8
62.5°	12.9
65°	9.2
67.5°	8.3
70°	7.8
72.5°	6.0
75°	4.6
77.5°	4.1
80°	3.2
82.5°	2.3
85°	1.4
87.5°	0.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)