

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792650

Luminaire Tested: LER6D40BD010-EC6DR6540509035-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P792650
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR6540509035-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3420.1 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P792650

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBDP1MW

Luminous Intensity Polar Plot

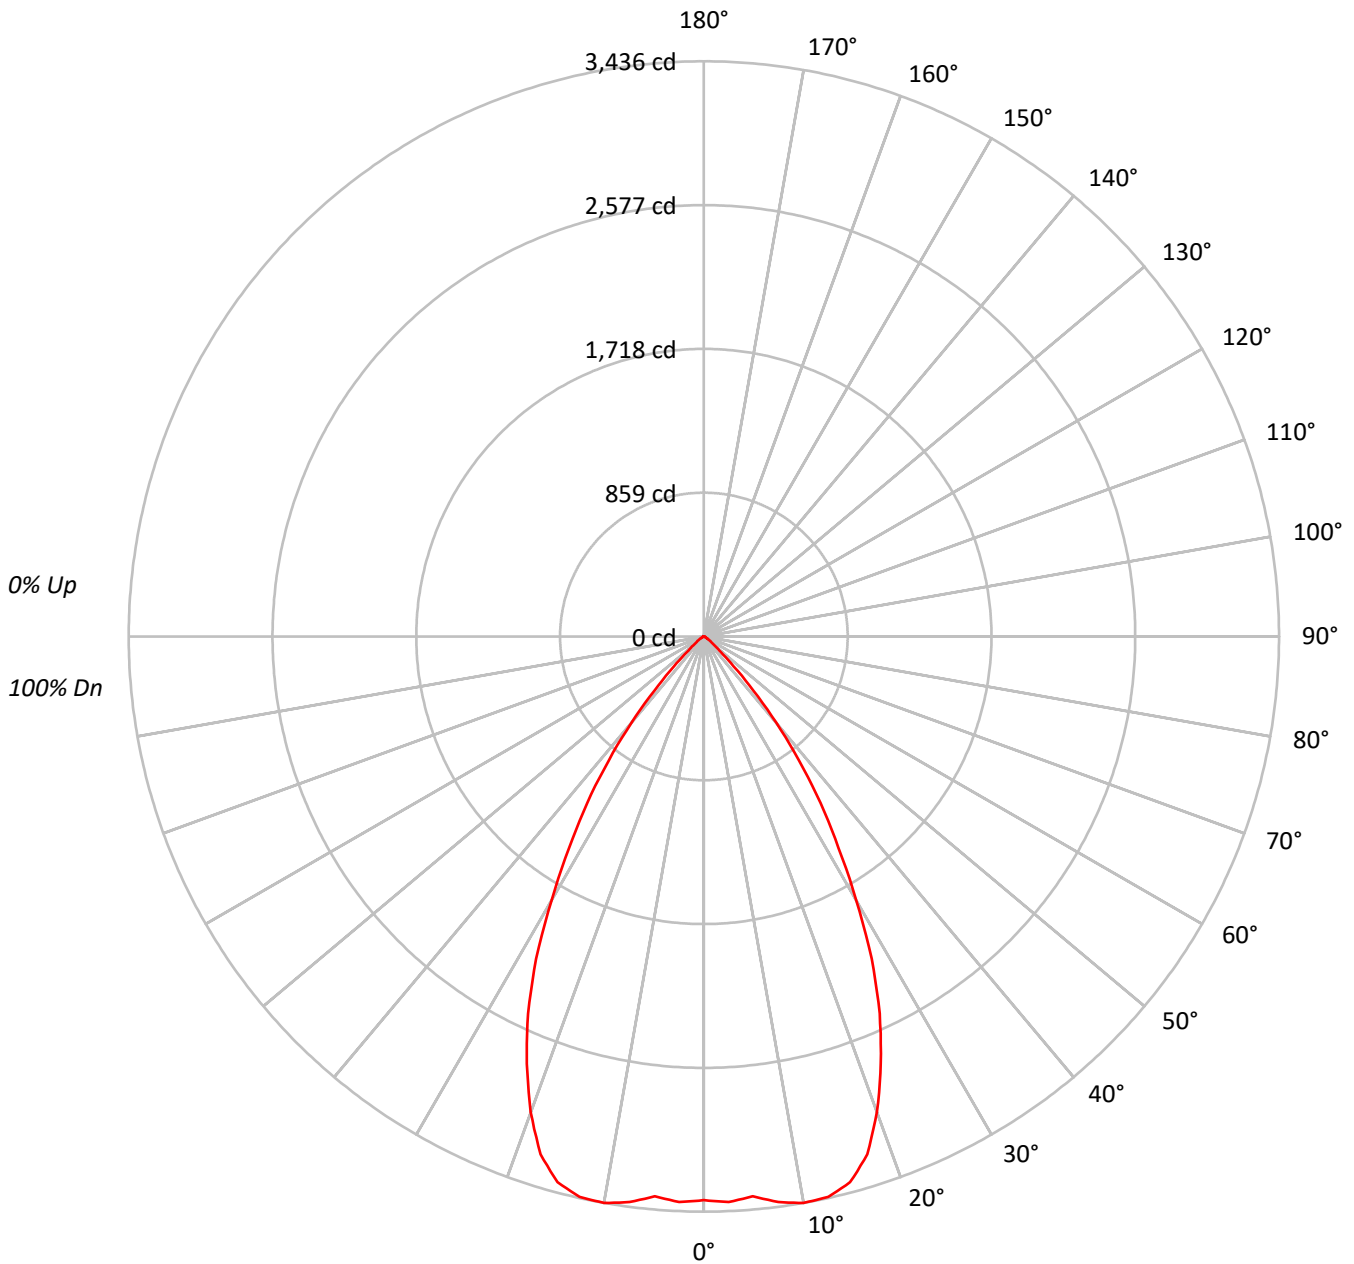



TEST NUMBER: P792650

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	367925
5°	368222
10°	381189
15°	381820
20°	351528
25°	299521
30°	229289
35°	161993
40°	95619
45°	38815
50°	14074
55°	7848
60°	4502
65°	2482
70°	2588
75°	2026
80°	2076
85°	1755

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 38815 cd/sqm



TEST NUMBER: P792650

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	324.2	9.5
10°-20°	935.3	27.3
20°-30°	1122.2	32.8
30°-40°	754.2	22.1
40°-50°	225.7	6.6
50°-60°	39.9	1.2
60°-70°	11.3	0.3
70°-80°	5.5	0.2
80°-90°	1.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2381.8	69.6
0°-40°	3135.9	91.7
0°-60°	3401.5	99.5
0°-90°	3420.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3420.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3367	
5°	3357	324
15°	3376	935
25°	2484	1122
35°	1214	754
45°	251	226
55°	41	40
65°	10	11
75°	5	6
85°	1	2
90°	0	



TEST NUMBER: P792650

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3367.4
2.5°	3381.7
5°	3357.3
7.5°	3408.0
10°	3435.8
12.5°	3429.1
15°	3375.5
17.5°	3244.4
20°	3023.3
22.5°	2763.0
25°	2484.5
27.5°	2170.1
30°	1817.4
32.5°	1497.8
35°	1214.5
37.5°	934.6
40°	670.4
42.5°	437.8
45°	251.2
47.5°	133.0
50°	82.8
52.5°	57.4
55°	41.2
57.5°	29.7
60°	20.6
62.5°	13.4
65°	9.6
67.5°	8.6
70°	8.1
72.5°	6.2
75°	4.8
77.5°	4.3
80°	3.3
82.5°	2.4
85°	1.4
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)