

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792652

Luminaire Tested: LER6D40BD010-EC6DR6540509035-6LBS1H

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P792652  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LER6D40BD010-EC6DR6540509035-6LBS1H  
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4172.7 lumens  
Efficiency: N/A  
Efficacy: 118.5 lumens/watt  
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96  
Luminous Opening: Circular (Dia: 0.48' x H: 0')  
CIE Type: Direct

Input Watts (W): 35.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P792652

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBS1H

### Luminous Intensity Polar Plot

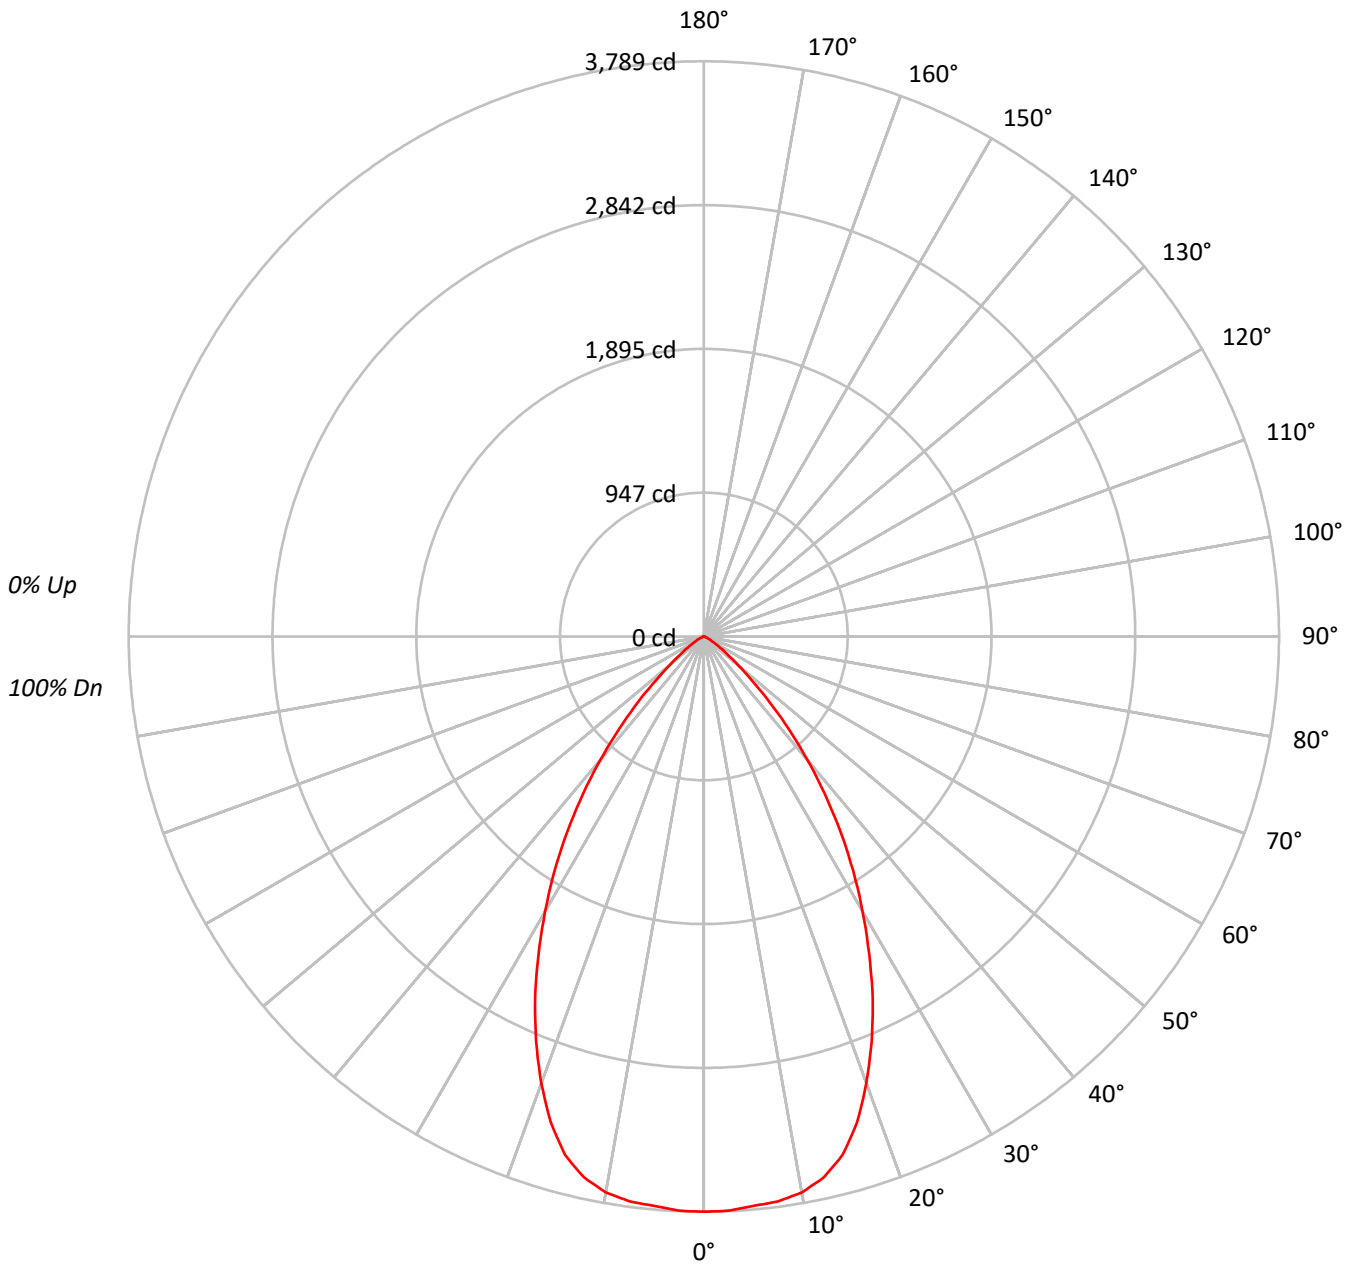



TEST NUMBER: P792652

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBS1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78																			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72																			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66																			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61																			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56																			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52																			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49																			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	221275
5°	220713
10°	220525
15°	213729
20°	194573
25°	169559
30°	141022
35°	111738
40°	80648
45°	50953
50°	26558
55°	14113
60°	7417
65°	4077
70°	1708
75°	1896
80°	1312
85°	1139

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 50953 cd/sqm



TEST NUMBER: P792652

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBS1H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	358.3	8.6
10°-20°	981.1	23.5
20°-30°	1199.3	28.7
30°-40°	973.0	23.3
40°-50°	484.9	11.6
50°-60°	135.2	3.2
60°-70°	30.7	0.7
70°-80°	8.0	0.2
80°-90°	2.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2538.7	60.8
0°-40°	3511.7	84.2
0°-60°	4131.8	99.0
0°-90°	4172.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4172.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3789	
5°	3765	358
15°	3535	981
25°	2631	1199
35°	1567	973
45°	617	485
55°	139	135
65°	30	31
75°	8	8
85°	2	2
90°	0	



TEST NUMBER: P792652

CATALOG NUMBER: LER6D40BD010-EC6DR6540509035-6LBS1H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3788.7
2.5°	3785.9
5°	3764.7
7.5°	3752.5
10°	3718.5
12.5°	3649.5
15°	3534.8
17.5°	3355.5
20°	3130.6
22.5°	2887.8
25°	2631.2
27.5°	2356.7
30°	2091.1
32.5°	1828.9
35°	1567.2
37.5°	1306.1
40°	1057.8
42.5°	825.1
45°	616.9
47.5°	429.8
50°	292.3
52.5°	201.5
55°	138.6
57.5°	93.5
60°	63.5
62.5°	44.0
65°	29.5
67.5°	15.0
70°	10.0
72.5°	9.5
75°	8.4
77.5°	5.6
80°	3.9
82.5°	2.8
85°	1.7
87.5°	1.1
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)