

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P792710

Luminaire Tested: LER6D40BD010-EC6DR7040509040-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P792710
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER6D40BD010-EC6DR7040509040-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4777.8 lumens
Efficiency: N/A
Efficacy: 135.7 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P792710
CATALOG NUMBER: LER6D40BD010-EC6DR7040509040-6LBS1MW

Luminous Intensity Polar Plot

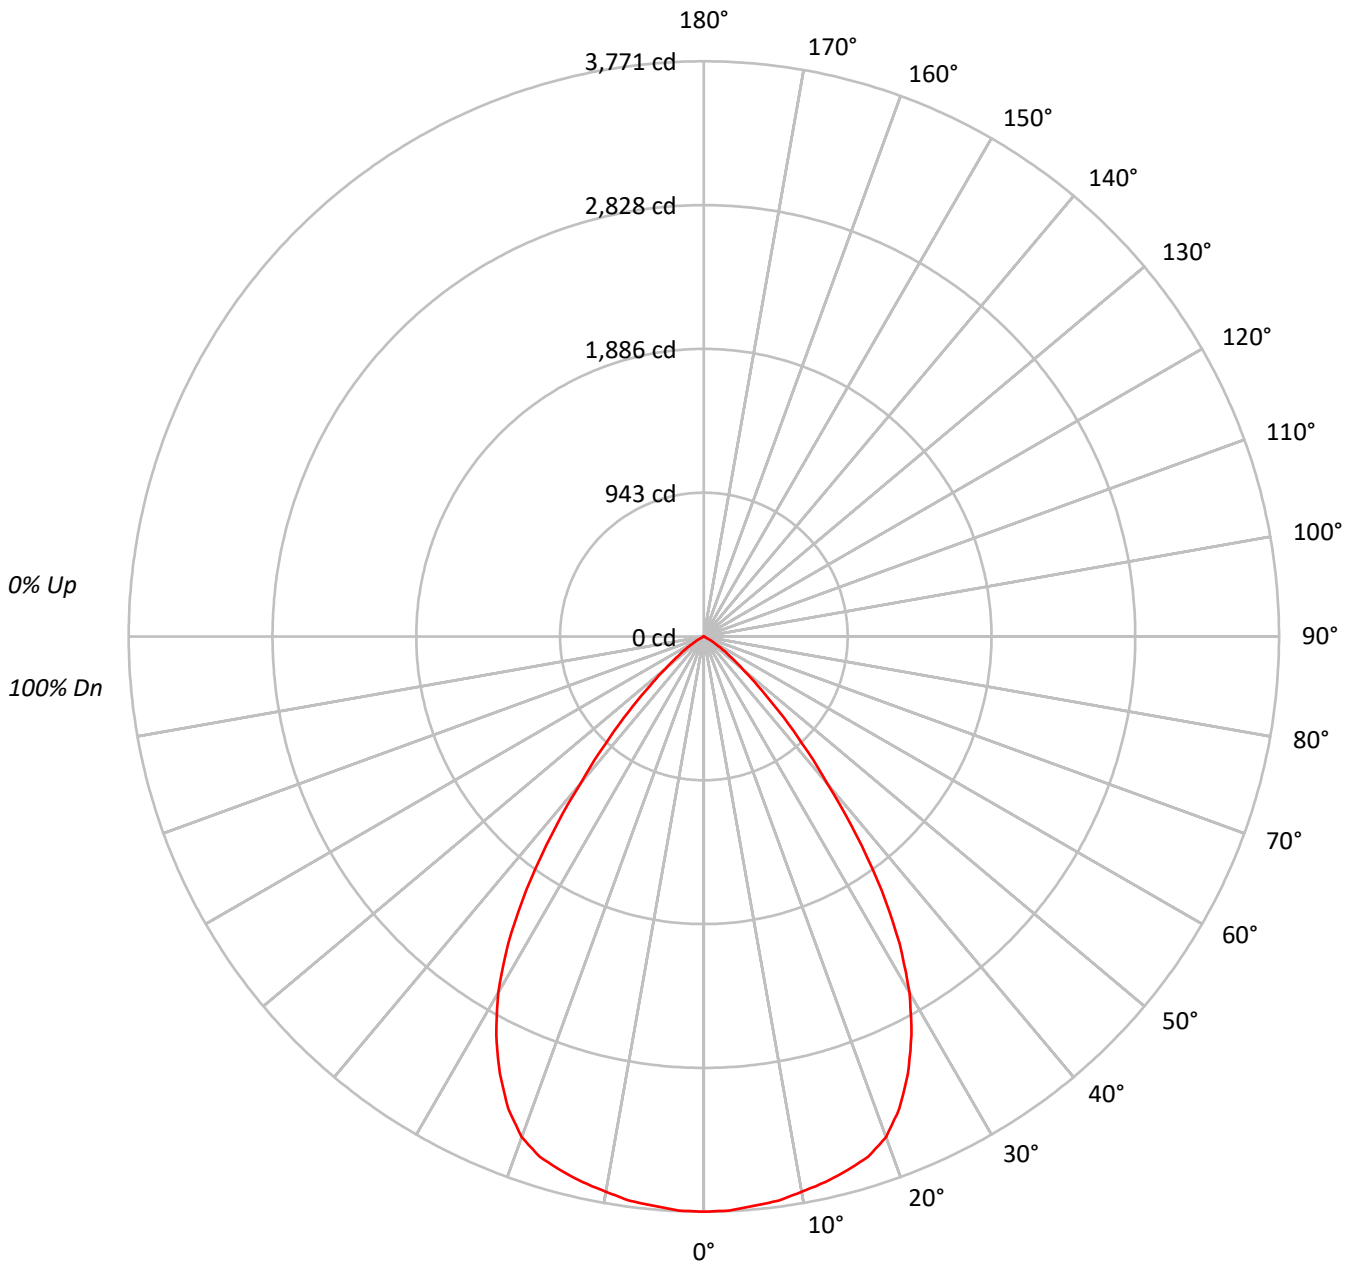



TEST NUMBER: P792710

CATALOG NUMBER: LER6D40BD010-EC6DR7040509040-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78																			
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71																			
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65																			
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60																			
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56																			
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51																			
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48																			
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	412033
5°	410997
10°	410113
15°	409997
20°	405990
25°	381379
30°	339998
35°	271074
40°	179999
45°	107606
50°	55787
55°	29316
60°	10380
65°	181
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 107606 cd/sqm



TEST NUMBER: P792710

CATALOG NUMBER: LER6D40BD010-EC6DR7040509040-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	356.4	7.5
10°-20°	1022.1	21.4
20°-30°	1441.8	30.2
30°-40°	1244.7	26.1
40°-50°	557.4	11.7
50°-60°	145.9	3.1
60°-70°	9.5	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2820.3	59.0
0°-40°	4065.0	85.1
0°-60°	4768.3	99.8
0°-90°	4777.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4777.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3771	
5°	3747	356
15°	3625	1022
25°	3164	1442
35°	2032	1245
45°	696	557
55°	154	146
65°	1	10
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P792710

CATALOG NUMBER: LER6D40BD010-EC6DR7040509040-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3771.1
2.5°	3767.0
5°	3747.3
7.5°	3731.0
10°	3696.5
12.5°	3665.3
15°	3624.6
17.5°	3577.8
20°	3491.7
22.5°	3349.9
25°	3163.5
27.5°	2947.1
30°	2694.9
32.5°	2386.3
35°	2032.3
37.5°	1641.7
40°	1262.0
42.5°	958.9
45°	696.4
47.5°	480.1
50°	328.2
52.5°	226.5
55°	153.9
57.5°	92.9
60°	47.5
62.5°	14.9
65°	0.7
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)